

16 VIA DE LUNA HOTEL PENSACOLA BEACH

A COMMERCIAL DEVELOPMENT IN UNSECTIONALIZED, TOWNSHIP 3 SOUTH, RANGE 29 WEST, ESCAMBIA COUNTY, FLORIDA SITE IMPROVEMENT PLANS

Approved
ESCAMBIA COUNTY DRC PLAN REVIEW
Printed Name: Sharon Rich Date: 6-1-2021
Development Name: 16 Via De Luna Hotel
This document has been reviewed in accordance with the requirements of applicable Escambia County Regulations and Ordinances, and does not in any way relieve the submitting Architect, Engineer, Surveyor or other signatory from responsibility of details as drawn. A development project must be obtained through the development Review Process prior to the construction of the project. The County does not constitute approval by any other agency. All additional state/federal permits shall be provided to the county prior to approval of a final plat or the issuance of a state/federal permit. All additional state/federal permits shall be provided to the county prior to approval of a final plat or the issuance of a building permit.

DUTY TO INDEMNIFY:

THE CONTRACTOR SHALL DEFEND, INDEMNIFY, KEEP AND SAVE HARMLESS THE OWNER AND ENGINEER AND THEIR RESPECTIVE MEMBERS, REPRESENTATIVES, AGENTS AND EMPLOYEES, IN BOTH INDIVIDUAL AND OFFICIAL CAPACITIES, AGAINST ALL SUITS, CLAIMS, DAMAGES, LOSSES AND EXPENSES, INCLUDING ATTORNEY'S FEES, CAUSED BY, GROWING OUT OF, OR INCIDENTAL TO THE PERFORMANCE OF THE WORK UNDER THE CONTRACT BY THE CONTRACTOR OR ITS SUBCONTRACTORS TO THE FULL EXTENT AS ALLOWED BY THE LAWS OF THE STATE OF FLORIDA AND NOT BEYOND ANY EXTENT WHICH WOULD RENDER THESE PROVISIONS VOID OR UNENFORCEABLE. IN THE EVENT OF ANY SUCH INJURY (INCLUDING DEATH) OR LOSS OR DAMAGE, OR CLAIMS THEREFORE, THE CONTRACTOR SHALL GIVE PROMPT NOTICE TO THE OWNER.

UTILITIES NOTE

CONTRACTOR SHALL FIELD VERIFY LOCATION OF EXISTING UTILITIES AND COORDINATE WITH UTILITY COMPANIES 48 HOURS PRIOR TO CONSTRUCTION.

UTILITY COMPANIES

CONTRACTOR SHALL HAVE ALL EXISTING BURIED UTILITIES "LINE SPOTTED" BY CALLING 1-800-432-4770 "CALL SUNSHINE" OR BY CONTACTING LOCAL UTILITY COMPANIES.

WATER & SEWER: ESCAMBIA COUNTY UTILITY AUTHORITY
P.O. DRAWER 15311
PENSACOLA, FL 32514
CONTACT: BILL JOHNSON
PHONE: (850) 476-5110

TELEPHONE: AT&T
205 RAILROAD AVENUE
CHIPLEY, FL 32428
CONTACT: C.J. POTTER
PHONE: (800) 252-1133

TV CABLE: COX COMMUNICATIONS
2421 EXECUTIVE PLAZA ROAD
PENSACOLA, FL 32504
CONTACT: LISA DEES
PHONE: (850) 477-2695 EXT. 4559

ELECTRIC: GULF POWER
ONE ENERGY PLACE
PENSACOLA, FL 32520
CONTACT: MIKE PUENTES
PHONE: (850) 429-2630

GAS: GULF BREEZE NATURAL GAS
1070 SHORELINE DRIVE
GULF BREEZE, FL 32561
CONTACT: ENGINEERING DEPT.
PHONE: (850) 934-5108

DATE PREPARED:

4 MAY 2021

REVISIONS:

1 JUNE 2021

PREPARED BY:

CHOCTAW ENGINEERING, INC.
112 TRUXTON AVENUE
FT. WALTON BEACH, FL 32547
PHONE: (850) 862-6611
FAX: (850) 863-8059
cei@choctaweng.com

CEI PROJECT NO.: 2017-161-B

PREPARED FOR:

PENSACOLA BEACHSIDE REOSRT, LLC
113 BAYBRIDGE DRIVE
GULF BREEZE, FLORIDA 32561
PHONE: 934-3609
PRESIDENT: RICH CHISM

PROJECT ADDRESS:

16 VIA DE LUNA
PENSACOLA, FLORIDA 32561

BENCHMARK INFORMATION:


BENCHMARK NO. 1:
SRIA #8 ELEV. = 4.56' (NAVD88)

BENCHMARK NO. 2
C-324-36-3
4" SQUARE CONCRETE MONUMENT
AT NORTHEAST PROPERTY CORNER
ELEVATION= 4.64' (NAVD88)

LEGAL DESCRIPTION: (AS FURNISHED)

PARCEL NO. 3 SOUTH, EL VEDADO VILLA A SUBDIVISION OF A PORTION OF SANTA ROSA ISLAND, HERETOFORE KNOWN AS RETAIL AREA NO. 1, EAST ON SANTA ROSA ISLAND, ESCAMBIA COUNTY, FLORIDA, ACCORDING TO THE PLAT RECORDED IN PLAT BOOK 2 AT PAGE 84 OF THE PUBLIC RECORDS OF SAID COUNTY.

NOTE:
DEVELOPER SHALL OBTAIN SEPARATE PERMITS FROM SRIA, ESCAMBIA COUNTY AND FDEP PRIOR TO COMMENCEMENT OF CONSTRUCTION FOR ALL WORK SEAWARD OF THE COASTAL CONSTRUCTION LINE (LAZY RIVER/POOL, DUNE WALKOVER, ETC.)

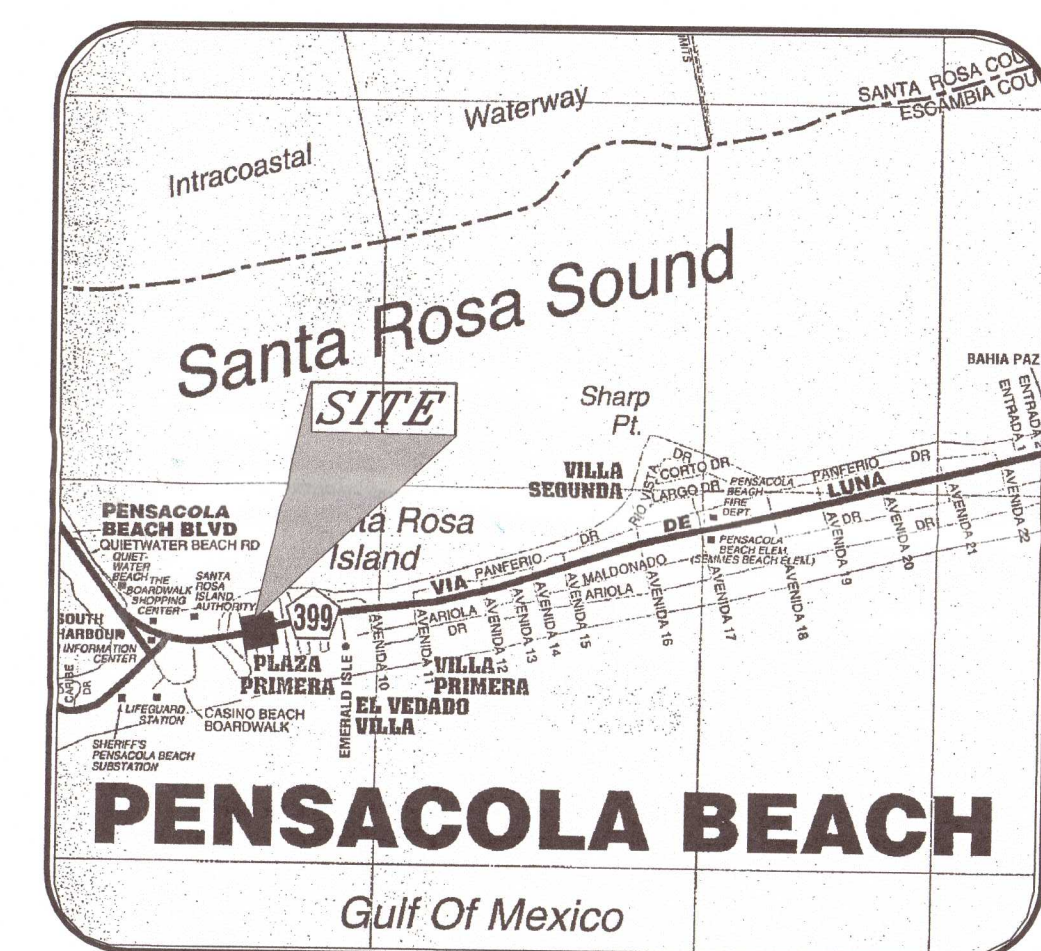



LOCATION MAP
NOT TO SCALE

INDEX:

1. COVER SHEET
2. DEMOLITION PLAN
3. SITE PLAN
4. GRADING PLAN
5. DRAINAGE PLAN
6. UTILITY PLAN
7. TREE LOCATION PLAN
8. MISCELLANEOUS DETAILS
9. ECUA WATER-SEWER DETAILS (1 OF 2)
10. ECUA WATER-SEWER DETAILS (2 OF 2)
11. SPECIFICATIONS (1 OF 2)
12. SPECIFICATIONS (2 OF 2)

MARK C. SINER, REGISTERED P.E.
FLORIDA CERTIFICATE NO. 48831

REVIEWED BY
SANTA R
ISLAND AUTHORITY
6/1/21

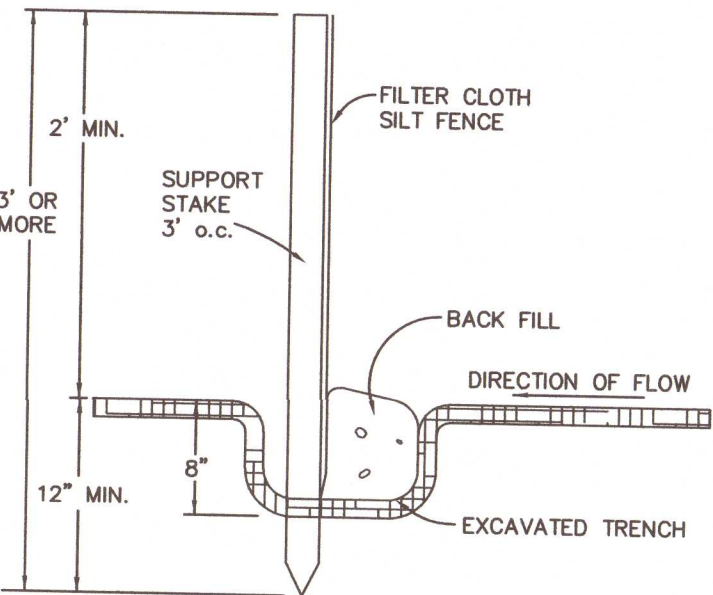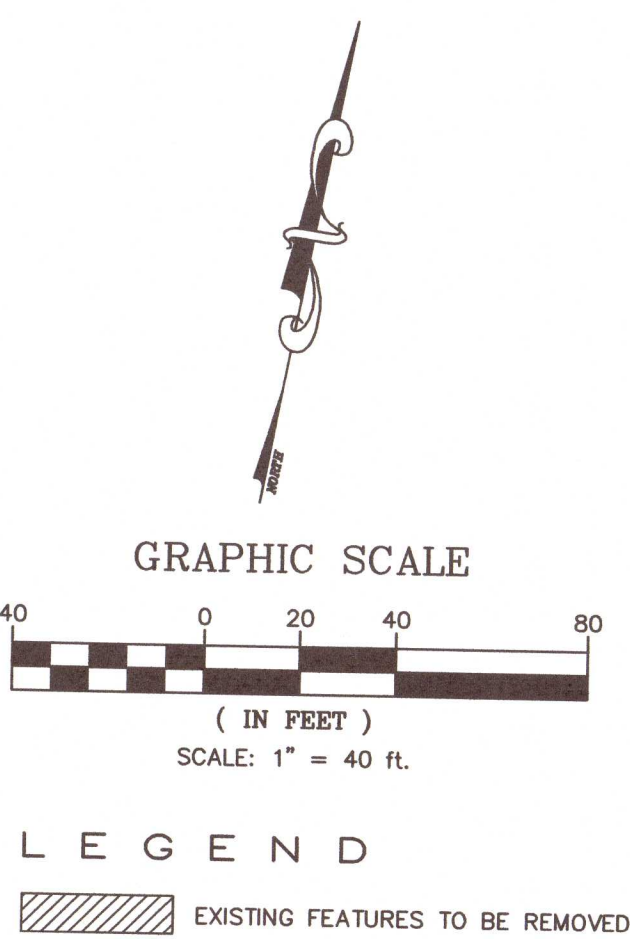

SILT FENCE DETAIL
N.T.S.

EROSION NOTES:

- ALL SILT FENCING SHALL BE INSTALLED AND SPACED ACCORDING TO FOOT INDEX #102.
- EROSION PROTECTION, SUCH AS STAKED BALED HAY AND SILT FENCE BARRIERS, MUST BE INSTALLED PRIOR TO START OF CONSTRUCTION.
- SILT FENCE BARRIER SHALL BE INSTALLED AS SHOWN ON PLANS, AND IN ALL AREAS SUBJECT TO SOIL EROSION SEDIMENTATION, SPECIALLY IN ADJACENT TO ALL BODIES OF WATER AND WETLAND AREAS WHERE THERE IS A POTENTIAL FOR DOWNSTREAM WATER QUALITY DEGRADATION.
- SEDIMENT AND EROSION CONTROL DEVICES SHALL REMAIN IN PLACE THROUGHOUT CONSTRUCTION AND SHALL BE REMOVED AT COMPLETION OF THE PROJECT.

NOTES:

1. APPROVED MATERIALS MEANS MINERALOGICAL COMPOSITION OF WHITE FINE TO MEDIUM GRAINED QUARTZ SAND WITH A MUNSSELL COLOR CHART VALUE OF 9.25 OR HIGHER AND A CHROMA OF 0.5 OR LESS ON THE 2.5.5 7.5, OR 10YR SCALE WHEN CHECKED IN AN AIR DRY CONDITION. FOR ROAD BASE OR FOUNDATION CONSTRUCTION, OYSTER SHELL, LIMESTONE OR WHITE DOLOMITE SHALL BE REASONABLY THE SAME COLOR AS APPROVED SAND AFTER EXPOSURE TO THE SUN AND SHALL NOT CONTAIN ANY OTHER DISCOLORING, STAINING, OR DARKENING MATERIAL.
2. NO PERSON MAY IMPORT OR CAUSE TO BE IMPORTED ONTO SANTA ROSA ISLAND OR PERDIDO KEY LOCATED IN ESCAMBIA COUNTY, FLORIDA ANY CONSTRUCTION OR LANDSCAPING MATERIAL WHICH IS NOT AN APPROVED MATERIAL.
3. NO PERSON MAY USE, OR TRANSFER FOR USE, ANY PROHIBITED MATERIAL IN CONNECTION WITH ANY PAVING, ROAD SURFACING, FILLING, LANDSCAPING, OR LANDSCAPING MATERIAL WHICH IS NOT AN APPROVED MATERIAL.
4. NO PERSON MAY TRANSFER PAVING, ROAD SURFACING, FILLING, OR LANDSCAPING MATERIAL WHICH IS NOT AN APPROVED MATERIAL WHERE SUCH MATERIAL IS TO BE USED IN CONNECTION WITH ANY PAVING, ROAD SURFACING, FILLING, AND LANDSCAPING, CONSTRUCTION WORK OR ANY OTHER IMPROVEMENT TO REAL PROPERTY ON ANY ISLAND, PERDIDO KEY OR SANTA ROSA ISLAND WHETHER LEASED OR NOT.
5. AT THE TIME AS RECONSTRUCTION, REDEVELOPMENT, IMPROVEMENT OR USE OF A SITE UNCOVERS OR EXPOSES "PROHIBITED MATERIALS" SUCH MATERIALS MUST BE IMMEDIATELY REMOVED AND RELOCATED OFF SANTA ROSA ISLAND OR PERDIDO KEY, AS THE CASE MAY BE, USING SUCH SAFEGUARDS AS ARE PROMULGATED BY THE DEPARTMENT TO PREVENT SUCH MATERIALS FROM BEING EXPOSED TO OR CONTACTED BY WIND, WATER, OR OTHERWISE WITHIN THE PARCEL OR ONTO ADJACENT PARCELS OR WATERS. THE REMOVAL OF PROHIBITED MATERIALS SHALL BE REQUIRED TO A DEPTH OF TWO (2) FEET BENEATH THE PLANE OF LAND SURFACE. IF A LAND SURFACE IS IMPACTED FROM EDGE TO EDGE, REMOVAL SHALL BE REQUIRED FOR THE AREA OF DISTURBED LAND TO A DEPTH OF TWO (2) FEET BENEATH THE PLANE OF THE LAND SURFACE AT EACH EDGE, ANY PROHIBITED MATERIALS NOT REQUIRED TO BE REMOVED SHALL BE CONTAINED IN ACCORDANCE WITH THE ORDINANCE.
6. WHENEVER CONSTRUCTION IS TO BE UNDERTAKEN IN THE AREA BETWEEN THE COASTAL CONSTRUCTION CONTROL LINE AND THE LANDWARD LIMIT OF THE SHORELINE PROTECTION ZONE, AND IF SAID CONSTRUCTION WOULD ALTER ANY PORTION OF THE PRIMARY DUNE OF THE COASTAL CONSTRUCTION CONTROL LINE OF A PLANNING BOARD APPROVED DUNE RESTORATION PROGRAM TO MITIGATE ANY DAMAGE WHICH WOULD RESULT FROM THE CONSTRUCTION, SAID RESTORATION PROGRAM SHALL REQUIRE THE IMPLEMENTATION OF A DUNE RESTORATION PROGRAM ON THE BEACH. THE APPLICANT SHALL OBTAIN APPROVAL FROM THE SRIA; THE RESTORATION PLAN WILL THEN BE SUBMITTED TO THE DIRECTOR OF THE DEPARTMENT OF ENVIRONMENTAL PROTECTION FOR REVIEW AND COMMENT. THE DUNE RESTORATION PROGRAM MAY BE FORWARDED TO THE DEP, DIVISION OF BEACHES AND SHORES FOR REVIEW AND COMMENT. AMONG OTHER THINGS, THE DUNE RESTORATION PROGRAM SHALL BE REQUIRED TO STABILIZE DISTURBED DUNES SHALL BE REQUIRED.
7. CONSTRUCTION IN A MANNER AND LOCATED TO AVOID FORMING BARRIERS FOR SEA TURTLES AND HATCHLINGS.
8. CONTRACTOR SHALL MAINTAIN VEHICULAR TRAFFIC ALONG VIA DE LUNA AND PEDESTRIAN TRAFFIC ON SIDEWALK DURING CONSTRUCTION.

NOTES:

1. MATERIAL EXCAVATED FOR DRYWELL TO BE USED FOR FILL MATERIAL THROUGHOUT SITE.
2. CONTRACTOR WILL BE RESPONSIBLE FOR MONITORING CONSTRUCTION AND SUBMITTING THE WATER MANAGEMENT DISTRICT NOTICE OF COMMENCEMENT. ENGINEER-OF-RECORD WILL BE RESPONSIBLE FOR AS-BUILT CERTIFICATIONS WHEN PROJECT IS COMPLETED.

EROSION NOTES:

1. EROSION PROTECTION: SOIL EROSION SEDIMENTATION MUST BE CONTROLLED AND RETAINED ON SITE DURING CONSTRUCTION. THEREFORE, EROSION PROTECTION, SUCH AS STAKED BALED HAY AND SILT FENCE BARRIERS, MUST BE INSTALLED PRIOR TO START OF CONSTRUCTION.
2. SILT FENCE BARRIER SHALL BE INSTALLED IN ALL AREAS SUBJECT TO SOIL EROSION SEDIMENTATION.
3. STORMWATER RETENTION AREAS SHALL BE SODDED.
4. GRADES AT CURBS ARE AT FLOWLINE.
5. STABILIZED CONSTRUCTION ENTRANCE SHALL BE INSTALLED AS THE 1ST STEP OF CLEARING AND GRADING
6. ADDITIONAL TECHNIQUES TO REDUCE SOIL TRACKING OFF OF SITE & ONTO ROADWAY SUCH AS WHEEL WASHING MAY BE REQUIRED.
7. ANY SEDIMENT THAT IS TRACKED ONTO ROADWAY SHALL BE REMOVED IMMEDIATELY BY SWEEPING. THE SEDIMENT COLLECTED BY SWEEPING SHALL BE REMOVED FROM ROADWAY & STABILIZED ON THE SITE.


DEMOLITION NOTES:

1. REMOVE PAVEMENT, BUILDINGS, BASE COURSE AND CURBING.
2. REMOVE EXISTING UTILITY SERVICES. COORDINATE WITH UTILITY COMPANIES AT LEAST 48 HOURS PRIOR TO COMMENCING WORK.
3. CONTRACTOR SHALL DISPOSE OF ALL DEBRIS OFF-SITE AND BE IN COMPLIANCE WITH FEDERAL, STATE AND COUNTY LAWS AND REGULATIONS.
4. CONTRACTOR SHALL RETAIN ALL SOIL EROSION SEDIMENTATION ON-SITE BY USING STAKED SILT FENCE.
5. THE EXISTING WATER SERVICES WITHIN THE PROPERTY MUST BE LOCATED, DISCONNECTED AND CAPPED AT THE MAIN LINE AND REMOVED FROM THE SITE.
6. ANY DAMAGE TO EXISTING ROADS DURING CONSTRUCTION WILL BE REPAIRED BY THE DEVELOPER PRIOR TO FINAL "AS-BUILT" SIGN OFF FROM THE COUNTY.

DEMOLITION SCHEDULE:

1. DEMOLITION OF EXISTING SITE IMPROVEMENTS TO BEGIN WITH 2 WEEKS OF RECEIVING ALL GOVERNMENTAL AGENCY APPROVALS/PERMITS. DEMOLITION WORK TO BE COMPLETED WITHIN 60 DAYS OF COMMENCEMENT OF DEMOLITION ACTIVITIES.

REVIEWED BY
SANTA ROSA
LAND AUTHORITY

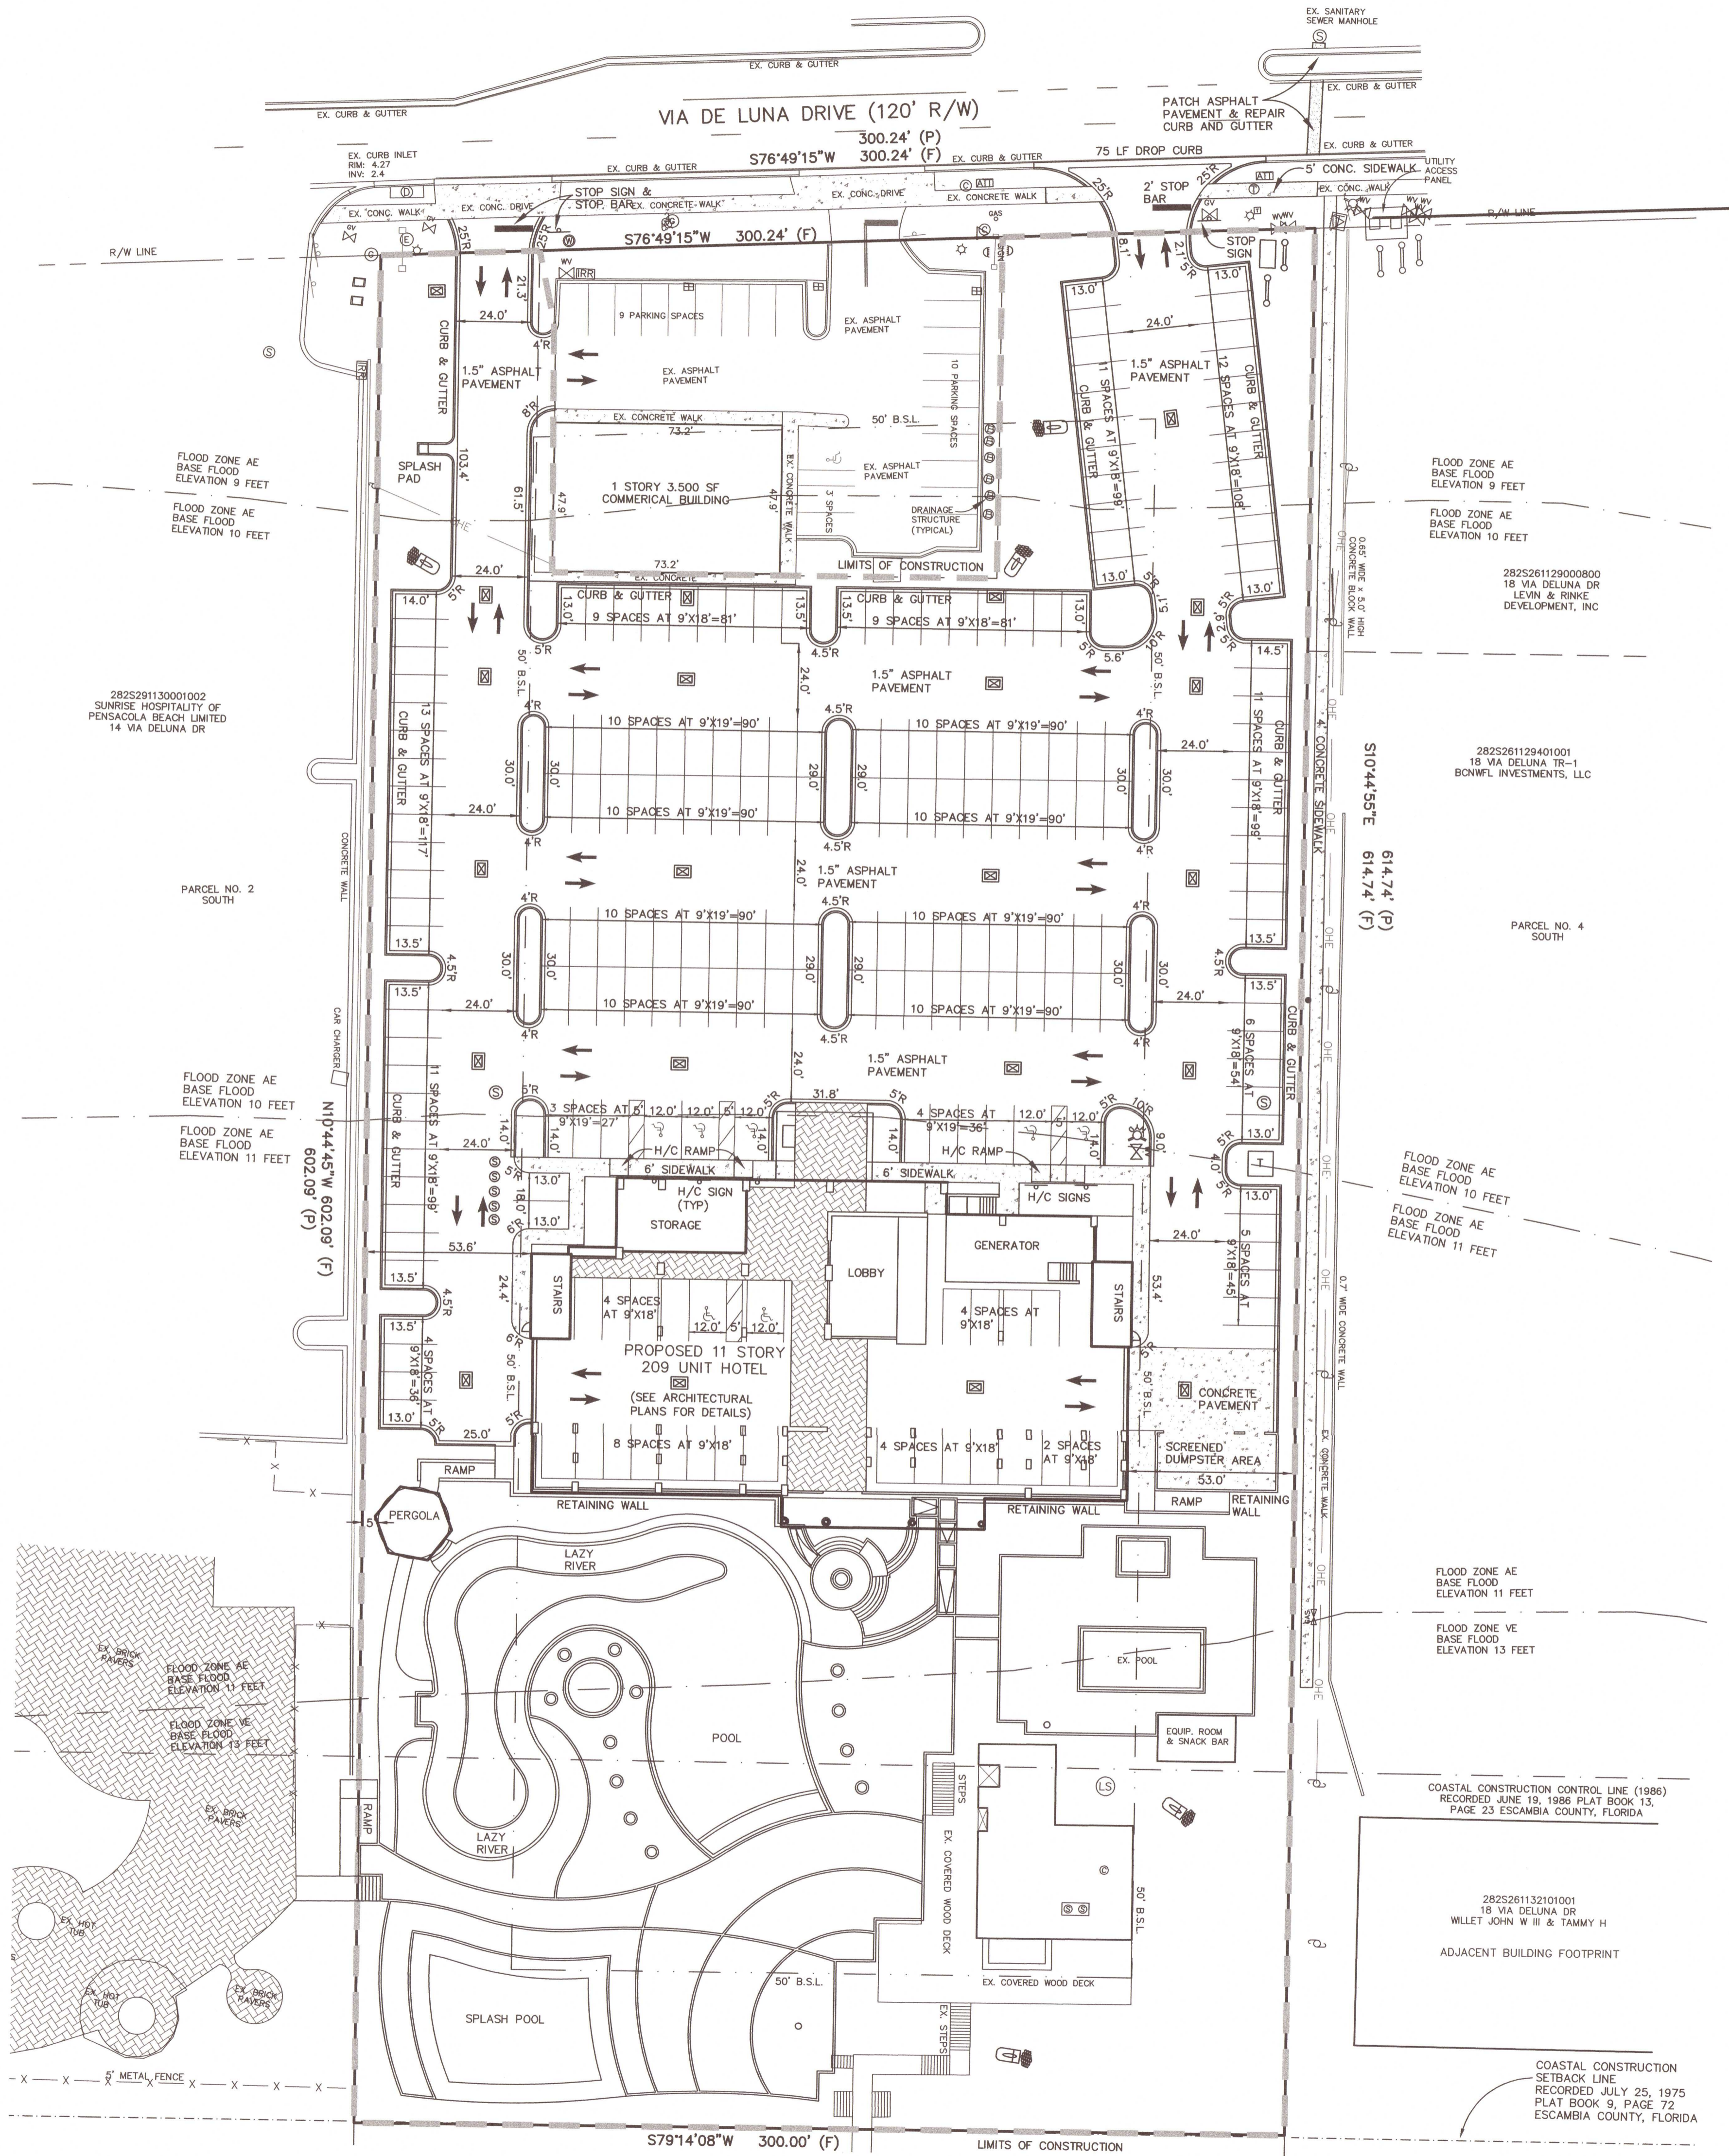

SITE DATA TABLE:

PROPERTY REFERENCE # 28-35-26-1130-001-003
ZONED: HDR/C-PB
FLU: MU-PB
FLOOD ZONE: AE(9), AE(10), AE(11), VE (13)*
BUILDING SETBACKS:
REQUIRED: FRONT = 50'
SIDE = 50'
REAR = 50' FROM 1975 CCCL
BUILDING INFORMATION:
GROSS AREA: 157,792 SF
TOTAL UNITS: 209 ROOMS
HEIGHT: 11 STORIES
BUILDING COVERAGE: 18,190 SF = 10%
TOTAL SITE AREA: 182,515 SF = 4.19 ACRES
SITE DENSITY: 209 UNITS/4.19 ACRES = 50 UNITS/ACRE
IMPERVIOUS AREA EXISTING: 133,850 SF = 73.3%
PERVIOUS AREA EXISTING: 48,665 SF = 26.7%
IMPERVIOUS AREA PROVIDED: 138,555 SF = 76.1%
PERVIOUS AREA REQUIRED: 27,378 SF = 15.0%
PERVIOUS AREA PROVIDED: 43,960 SF = 23.9%
PARKING SPACES REQUIRED: 1 SPACE/ROOM (209 ROOMS) = 209 SPACES
3 SPACE/1,000 SF RETAIL (3,500 SF) = 11 SPACES
TOTAL REQUIRED = 220 SPACES
PARKING SPACES PROVIDED: 229 SPACES (INCLUDES 7 H/C SPACES)


* THE SUBJECT PROPERTY AS SHOWN HEREON IS LOCATED IN FLOOD ZONES VE, BASE FLOOD ELEVATION (BFE) 13 AND FLOOD ZONE AE 11 & 10 & 9, AS DETERMINED FROM THE FEDERAL EMERGENCY MANAGEMENT AGENCY FLOOD INSURANCE RATE MAP OF ESCAMBIA COUNTY, FLORIDA, COMMUNITY 120080, FIRM MAP PANEL NUMBER 12033C0390G, MAP REVISION DATED SEPTEMBER 29, 2006
NOTE:
COASTAL HIGH HAZARD AREA, THE AREA SUBJECT TO HIGH VELOCITY WAVE ACTION FROM STORMS OR SEISMIC SOURCES, COASTAL HIGH HAZARD AREAS ARE ALSO REFERRED TO AS "HIGH HAZARD AREAS SUBJECT TO HIGH VELOCITY WAVE ACTION." THE ENTIRE AREA OF THE SANTA ROSA ISLAND AUTHORITY IS CONSIDERED A COASTAL HIGH HAZARD AREA FOR THE PURPOSES OF THIS ORDINANCE AND THE FLORIDA BUILDING CODE.

GENERAL NOTES:

1. THE PROJECT ENGINEER (ENGINEER OF RECORD) SHALL PROVIDE TO ESCAMBIA COUNTY "AS-BUILT" RECORD DRAWINGS FOR VERIFICATION AND APPROVAL BY ESCAMBIA COUNTY ONE WEEK PRIOR TO REQUESTING A FINAL INSPECTION AND CERTIFICATE OF OCCUPANCY, OR PROVIDE "AS-BUILT" CERTIFICATION THAT THE PROJECT CONSTRUCTION ADHERES TO THE PERMITTED PLANS AND SPECIFICATIONS, THE "AS-BUILT" CERTIFICATION OR THE "AS-BUILT" RECORD DRAWINGS MUST BE SIGNED, SEALED AND DATED BY A REGISTERED FLORIDA PROFESSIONAL ENGINEER.
2. THE CONTRACTOR SHALL INSTALL PRIOR TO THE START OF CONSTRUCTION AND MAINTAIN DURING CONSTRUCTION ALL SEDIMENT CONTROL MEASURES AS REQUIRED TO RETAIN ALL SEDIMENTS ON THE SITE. IMPROPER SEDIMENT CONTROL MEASURES MAY RESULT IN CODE ENFORCEMENT VIOLATION.
3. RETENTION/DETENTION AREAS SHALL BE SUBSTANTIALLY COMPLETE PRIOR TO ANY CONSTRUCTION ACTIVITIES THAT MAY INCREASE STORMWATER RUNOFF RATES. FROM BLINDING DUE TO SEDIMENTS.
4. ALL DISTURBED AREA WHICH ARE NOT PAVED SHALL BE STABILIZED WITH SEEDING, FERTILIZER AND MULCH, HYDROSEED AND/OR SOD.
5. ALL NEW BUILDING ROOF DRAINS, DOWNSPOUTS, OR GUTTERS SHALL BE ROUTED TO CARRY ALL STORMWATER TO RETENTION/DETENTION AREAS.
6. DEVELOPER/CONTRACTOR SHALL RESHAPE PER PLAN SPECIFICATIONS, CLEANOUT ACCUMULATED SILT AND STABILIZE RETENTION/DETENTION PONDS AT THE END OF CONSTRUCTION WHEN ALL DISTURBED AREAS HAVE BEEN STABILIZED AND PRIOR TO REQUEST FOR INSPECTION.
7. CONTRACTOR SHALL MAINTAIN RECORD DRAWINGS DURING CONSTRUCTION WHICH SHOW "AS-BUILT" CONDITIONS OF ALL WORK INCLUDING PIPING, DRAINAGE STRUCTURES, TOPO OF PONDS, OUTLET STRUCTURES, DIMENSIONS, ELEVATIONS, GRADING, ETC. RECORD DRAWINGS SHALL BE PROVIDED TO THE ENGINEER OF RECORD PRIOR TO REQUESTING FINAL INSPECTION.
8. THE OWNER OR HIS AGENT SHALL ARRANGE/SCHEDULE WITH THE COUNTY A FINAL INSPECTION OF THE DEVELOPMENT UPON COMPLETION AND ANY INTERMEDIATE INSPECTIONS AT (850)595-3434. AS-BUILT CERTIFICATION IS REQUIRED PRIOR TO REQUEST FOR FINAL INSPECTION/APPROVAL.
9. NOTIFY SUNSHINE UTILITIES 48 HOURS IN ADVANCE PRIOR TO DIGGING WITHIN R/W; 1-800-432-4770.
10. ALL ASPECTS OF THE STORMWATER/DRAINAGE COMPONENTS AND/OR TRANSPORTATION COMPONENTS SHALL BE COMPLETED PRIOR TO ISSUANCE OF A FINAL CERTIFICATE OF OCCUPANCY.
11. NO DEVIATIONS OR REVISIONS FROM THESE PLANS BY THE CONTRACTOR SHALL BE ALLOWED WITHOUT PRIOR APPROVAL FROM BOTH THE DESIGN ENGINEER AND THE ESCAMBIA COUNTY. ANY DEVIATIONS MAY RESULT IN DELAYS IN OBTAINING A CERTIFICATE OF OCCUPANCY.
12. THE CONTRACTOR SHALL NOTIFY FDOT 48 HOURS IN ADVANCE PRIOR TO INITIATING ANY WORK IN THE STATE R/W.
13. CONTRACTOR TO MAINTAIN VEHICULAR TRAFFIC ALONG VIA DE LUNA AND PEDESTRIAN TRAFFIC ON SIDEWALK DURING CONSTRUCTION.
14. ANY DAMAGE TO EXISTING ROADS DURING CONSTRUCTION WILL BE REPAIRED BY THE DEVELOPER PRIOR TO FINAL "AS-BUILT" SIGN OFF FROM THE COUNTY.
15. CONTRACTOR SHALL OBTAIN BUILDING INSPECTION DEPARTMENT PERMIT(S) FOR ANY RETAINING WALL HIGHER THAN 2 FEET.

NOTE:
DEVELOPER SHALL OBTAIN SEPARATE PERMITS FROM SRIA, ESCAMBIA COUNTY AND FDEP PRIOR TO COMMENCEMENT OF CONSTRUCTION FOR ALL WORK SEAWARD OF THE COASTAL CONSTRUCTION LINE (LAZY RIVER/POOL, DUNE WALKOVER, ETC.)

NOTE:
ALL DIMENSIONS ARE TO FACE OF CURB UNLESS OTHERWISE NOTED.

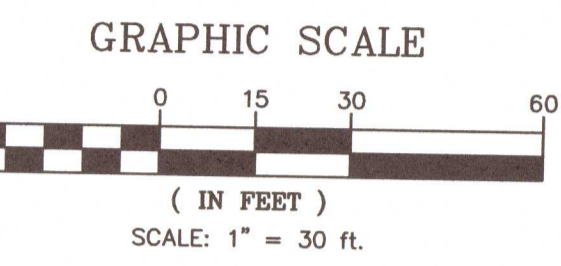

LEGEND

- ASPHALT
- CONCRETE
- SETBACK LINE
- POWER POLE
- GUY ANCHOR
- LIGHT POLE
- OVERHEAD UTILITY LINE
- ELECTRICAL BOX
- TELEVISION BOX
- TRAFFIC SIGNAL BOX
- TELEPHONE BOX
- FENCE
- TRAFFIC ARROW
- CENTERLINE
- SINGLE POLE SIGN
- DOUBLE POLE SIGN
- MONITORING WELL

CHOCTAW ENGINEERING, INC.
ENGINEERING • ENVIRONMENTAL • SURVEYING
112 TRUXTON AVENUE
FORT WALTON BEACH, FLORIDA 32547
PHONE: 850-862-6611
FAX: 850-863-8059
EMAIL: ce@choctaweng.com

CERTIFICATE OF AUTHORIZATION No. 1532


Revisions:
1 JUNE 2001- PER COUNTY COMMENTS

16 VIA DE LUNA HOTEL
PENSACOLA BEACH
SITE PLAN

Not valid unless bearing Engineer's embossed seal.
MARK C. SNIER, P.E.
FL REG. NO. 48831

Job No.: 2017-161-B
Date: 4 MAY 2021
Fld. Vol.: N/A
Scale: 1"=30'
Disk No.: 17161B-ENG
Designed: MCS
Drawn: CRG
Checked: MCS
Sheet

THIS SHEET IS THE PROPERTY OF CEI & IS NOT TO BE REPRODUCED WITHOUT WRITTEN CONSENT FROM CEI.

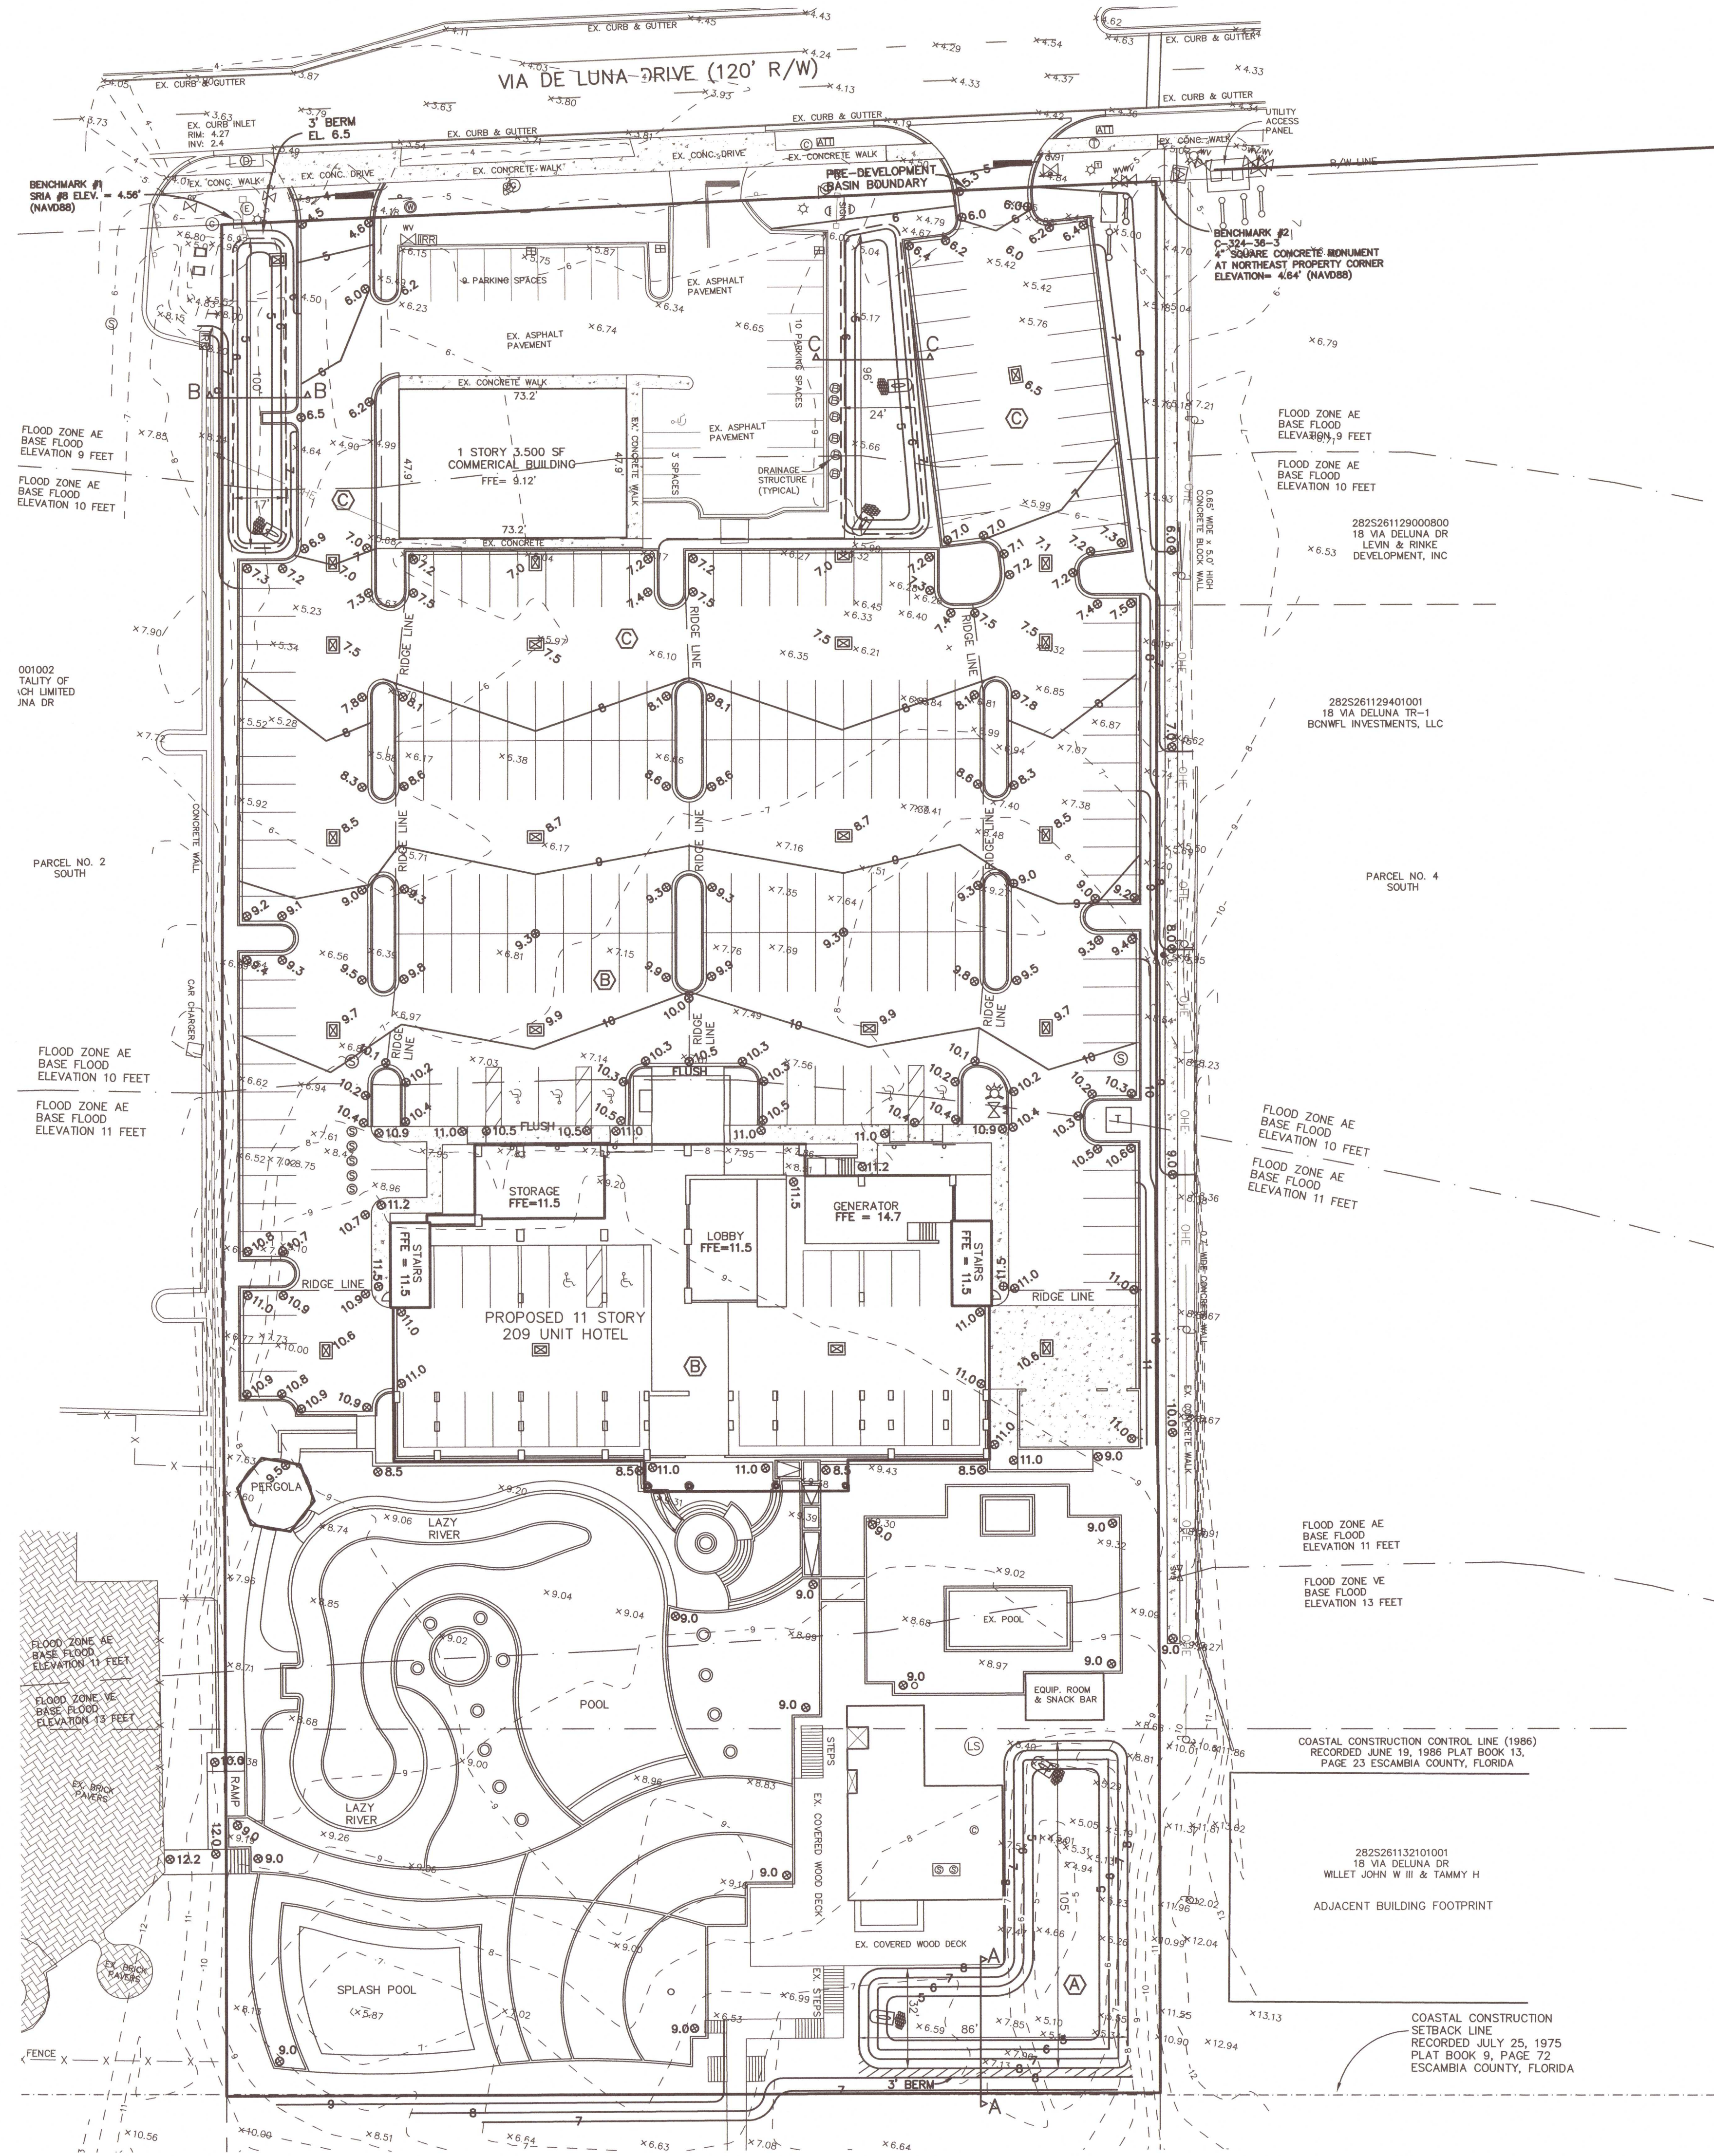

BENCHMARK #2 C-324-36-3
4" SQUARE CONCRETE MONUMENT
AT NORTHEAST PROPERTY CORNER
ELEVATION= 4.64' (NAVD88)




BENCHMARK #1
SRIA #8 ELEV. = 4.56' (NAVD88)

NOTE: DIRECT ALL ROOF DRAINAGE
TO STORMWATER RETENTION AREAS.

NOTE: DIRECT ALL ROOF DRAINAGE
TO CATCH BASINS VIA DOWNSPOUTS


NOTES:

- APPROVED MATERIALS MEANS MINERALOGICAL COMPOSITION OF WHITE FINE TO MEDIUM GRAINED QUARTZ SAND WITH A MUNSSELL COLOR CHART VALUE OF 9.25 OR WHITER AND A CHROMA OF 0.5 OR LESS ON THE 2.5, 5, 7.5, OR 10YR SCALE WHEN CHECKED IN AN AIR DRY CONDITION. FOR ROAD BASE OR FOUNDATION CONSTRUCTION, OYSTER SHELL, LIMESTONE OR WHITE DOLOMITE SHALL BE REASONABLY THE SAME COLOR AS APPROVED SAND AFTER EXPOSURE TO THE SUN AND SHALL NOT CONTAIN CLAY OR OTHER DISCOLORING, STAINING, OR DARKENING MATERIAL.
- NO PERSON MAY IMPORT OR CAUSE TO BE IMPORTED ONTO SANTA ROSA ISLAND OR PERDIDO KEY LOCATED IN ESCAMBIA COUNTY, FLORIDA ANY CONSTRUCTION OR LANDSCAPING MATERIAL WHICH IS NOT AN APPROVED MATERIAL.
- NO PERSON MAY USE, OR TRANSFER FOR USE, ANY PROHIBITED MATERIAL IN CONNECTION WITH ANY PAVING, ROAD SURFACING, FILLING, LANDSCAPING, CONSTRUCTION WORK OR ANY OTHER IMPROVEMENT TO REAL PROPERTY ON PERDIDO KEY OR ANY PART OF SANTA ROSA ISLAND WHETHER LEASED OR NOT.
- NO PERSON MAY TRANSFER FROM PARCEL TO PARCEL ANY CONSTRUCTION MATERIAL WHICH IS NOT AN APPROVED MATERIAL WHERE SUCH MATERIAL IS TO BE USED IN CONNECTION WITH ANY PAVING, ROAD SURFACING, FILLING, LANDSCAPING, CONSTRUCTION WORK OR ANY OTHER IMPROVEMENT TO REAL PROPERTY ON ANY PART OF PERDIDO KEY OR SANTA ROSA ISLAND WHETHER LEASED OR NOT.
- AT SUCH TIME AS RECONSTRUCTION, REDEVELOPMENT, IMPROVEMENT OR USE OF A SITE UNCOVERS OR EXPOSES "PROHIBITED MATERIALS" SUCH MATERIALS MUST BE IMMEDIATELY REMOVED FROM THE SITE AND RELOCATED OFF SANTA ROSA ISLAND OR PERDIDO KEY, AS THE CASE MAY BE, USING SUCH SAFEGUARDS AS ARE PROMULGATED BY THE DEPARTMENT TO PREVENT THE RELEASE OF SUCH MATERIALS BY WIND, WATER, OR OTHERWISE WITHIN THE PARCEL OR ONTO ADJACENT PARCELS OR WATERS. THE REMOVAL OF PROHIBITED MATERIALS SHALL BE REQUIRED TO A DEPTH OF TWO (2) FEET BENEATH THE PLANE OF LAND SURFACE. IF A SAND DUNE IS IMPACTED FROM EDGE TO EDGE, REMOVAL SHALL BE REQUIRED FOR THE AREA OF DISTURBED OR EXPOSED PROHIBITED MATERIAL TO A DEPTH OF TWO (2) FEET BENEATH THE PLANE OF THE LAND SURFACE AT EACH EDGE. ANY PROHIBITED MATERIALS NOT REQUIRED TO BE REMOVED SHALL BE CONTAINED IN ACCORDANCE WITH THIS ORDINANCE.
- WHENEVER CONSTRUCTION IS TO BE UNDERTAKEN IN THE AREA BETWEEN THE COASTAL CONSTRUCTION CONTROL LINE AND THE LANDWARD LIMIT OF THE SHORELINE PROTECTION ZONE, AND IF SAID CONSTRUCTION WOULD ALTER ANY PORTION OF THE PRIMARY DUNE, THE COUNTY SHALL REQUIRE THE IMPLEMENTATION OF A PLANNING BOARD APPROVED DUNE RESTORATION PROGRAM TO MITIGATE ANY DAMAGE WHICH WOULD RESULT FROM THE CONSTRUCTION. IF SAID RESTORATION IS TO OCCUR AT PENSACOLA BEACH, THE APPLICANT SHALL OBTAIN APPROVAL FROM THE SRIA. THE RESTORATION PLAN WILL THEN BE SUBMITTED TO THE DIRECTOR OF THE DEPARTMENT OF GROWTH MANAGEMENT FOR REVIEW AND COMMENT. THE DUNE RESTORATION PROGRAM MAY BE FORWARDED TO THE DEP, DIVISION OF BEACHES AND SHORES FOR REVIEW AND COMMENT. AMONG OTHER THINGS, THE PLANTING OF SEA OATS TO STABILIZE DISTURBED DUNES SHALL BE REQUIRED. DUNE ESTABLISHMENT SHOULD INCLUDE PLANTING (SEA OATS OR SALT RESISTANT VEGETATION), SAND FENCING, WALKOVERS, ETC. SAND FENCING SHALL BE CONSTRUCTED IN A MANNER AND LOCATED TO AVOID FORMING BARRIERS FOR SEA TURTLES AND HATCHLINGS.

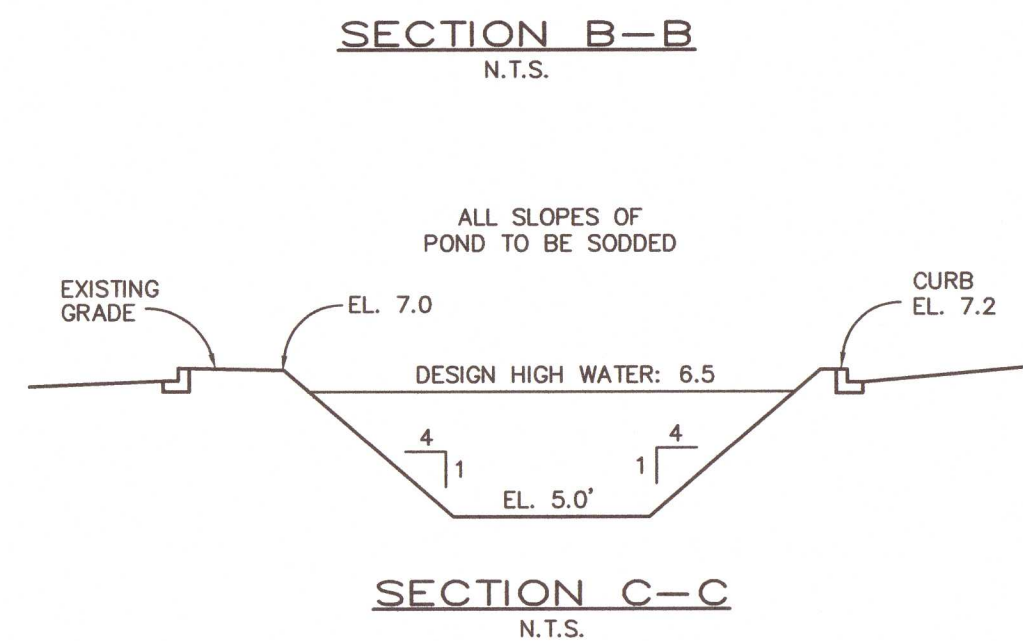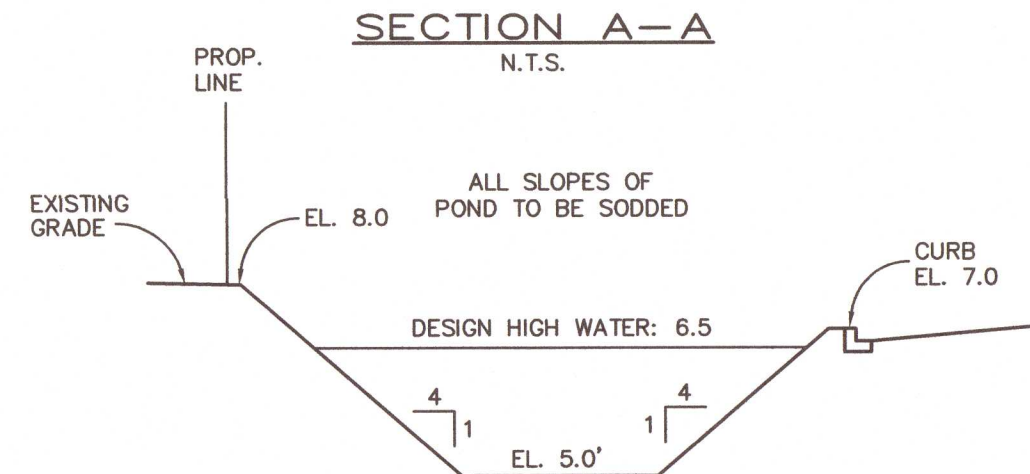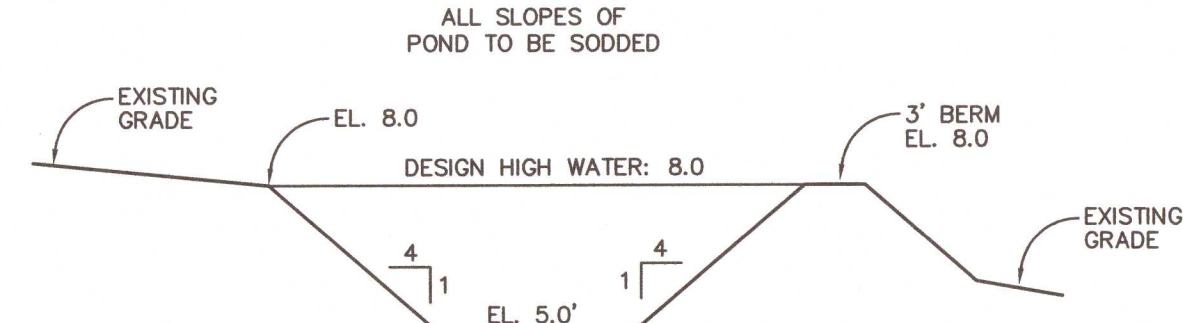

EROSION NOTES:

- EROSION PROTECTION: SOIL EROSION SEDIMENTATION MUST BE CONTROLLED AND RETAINED ON SITE DURING CONSTRUCTION. THEREFORE, EROSION PROTECTION, SUCH AS STAKED BALED HAY AND SILT FENCE BARRIERS, MUST BE INSTALLED PRIOR TO START OF CONSTRUCTION.
- SILT FENCE BARRIER SHALL BE INSTALLED IN ALL AREAS SUBJECT TO SOIL EROSION SEDIMENTATION.
- STORMWATER RETENTION AREAS SHALL BE SODDED.
- GRADES AT CURBS ARE AT FLOWLINE.

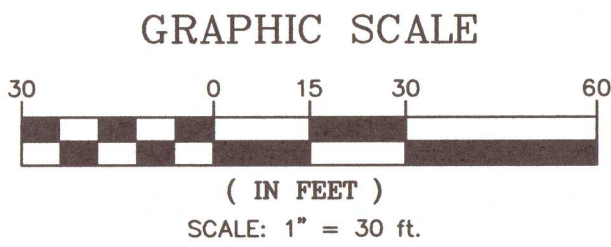

16 VIA DE LUNA HOTEL
PENSACOLA BEACH

GRADING PLAN

Not valid unless bearing Engineer's embossed seal.

MARK C. SNER, P.E.
FL. REG. NO. 49831

Revisions:
1 JUNE 2001- PER COUNTY COMMENTS



CHOCTAW ENGINEERING, INC.
ENGINEERING • ENVIRONMENTAL • SURVEYING
112 TRUXTON AVENUE
FORT WALTON BEACH, FLORIDA 32547
PHONE: 850-862-6611
FAX: 850-862-6059
EMAIL: ce@choctaweng.com

CEI

THIS SHEET IS THE PROPERTY OF CEI & IS NOT TO BE REPRODUCED WITHOUT WRITTEN CONSENT FROM CEI.


Job No.: 2017-161-B
Date: 4 MAY 2021
Flt. Vol.: N/A
Scale: 1"=40'
Disk No.: 17161B-ENG
Designed: MCS
Drawn: SJW
Checked: MCS
Sheet 4 of 12

REVIEWED BY
SANTA ROSA
ISLAND AUTHORITY

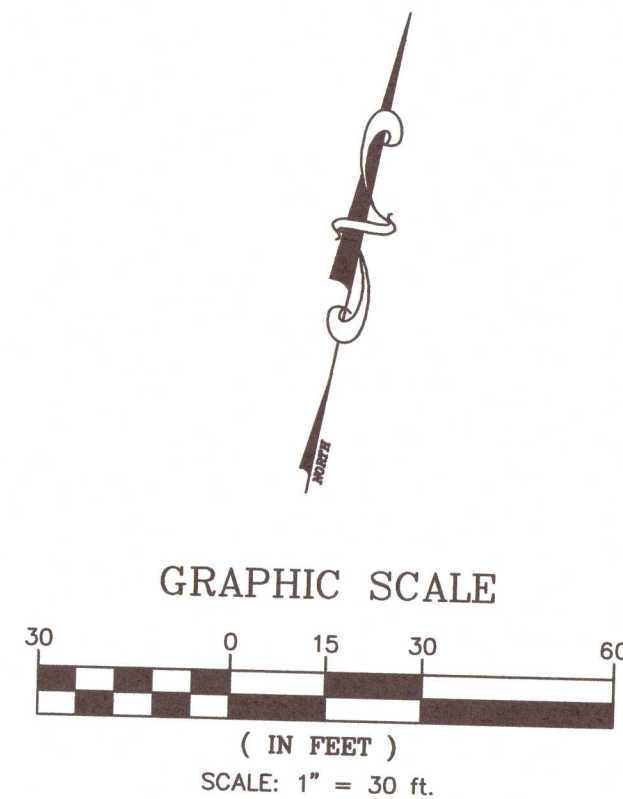
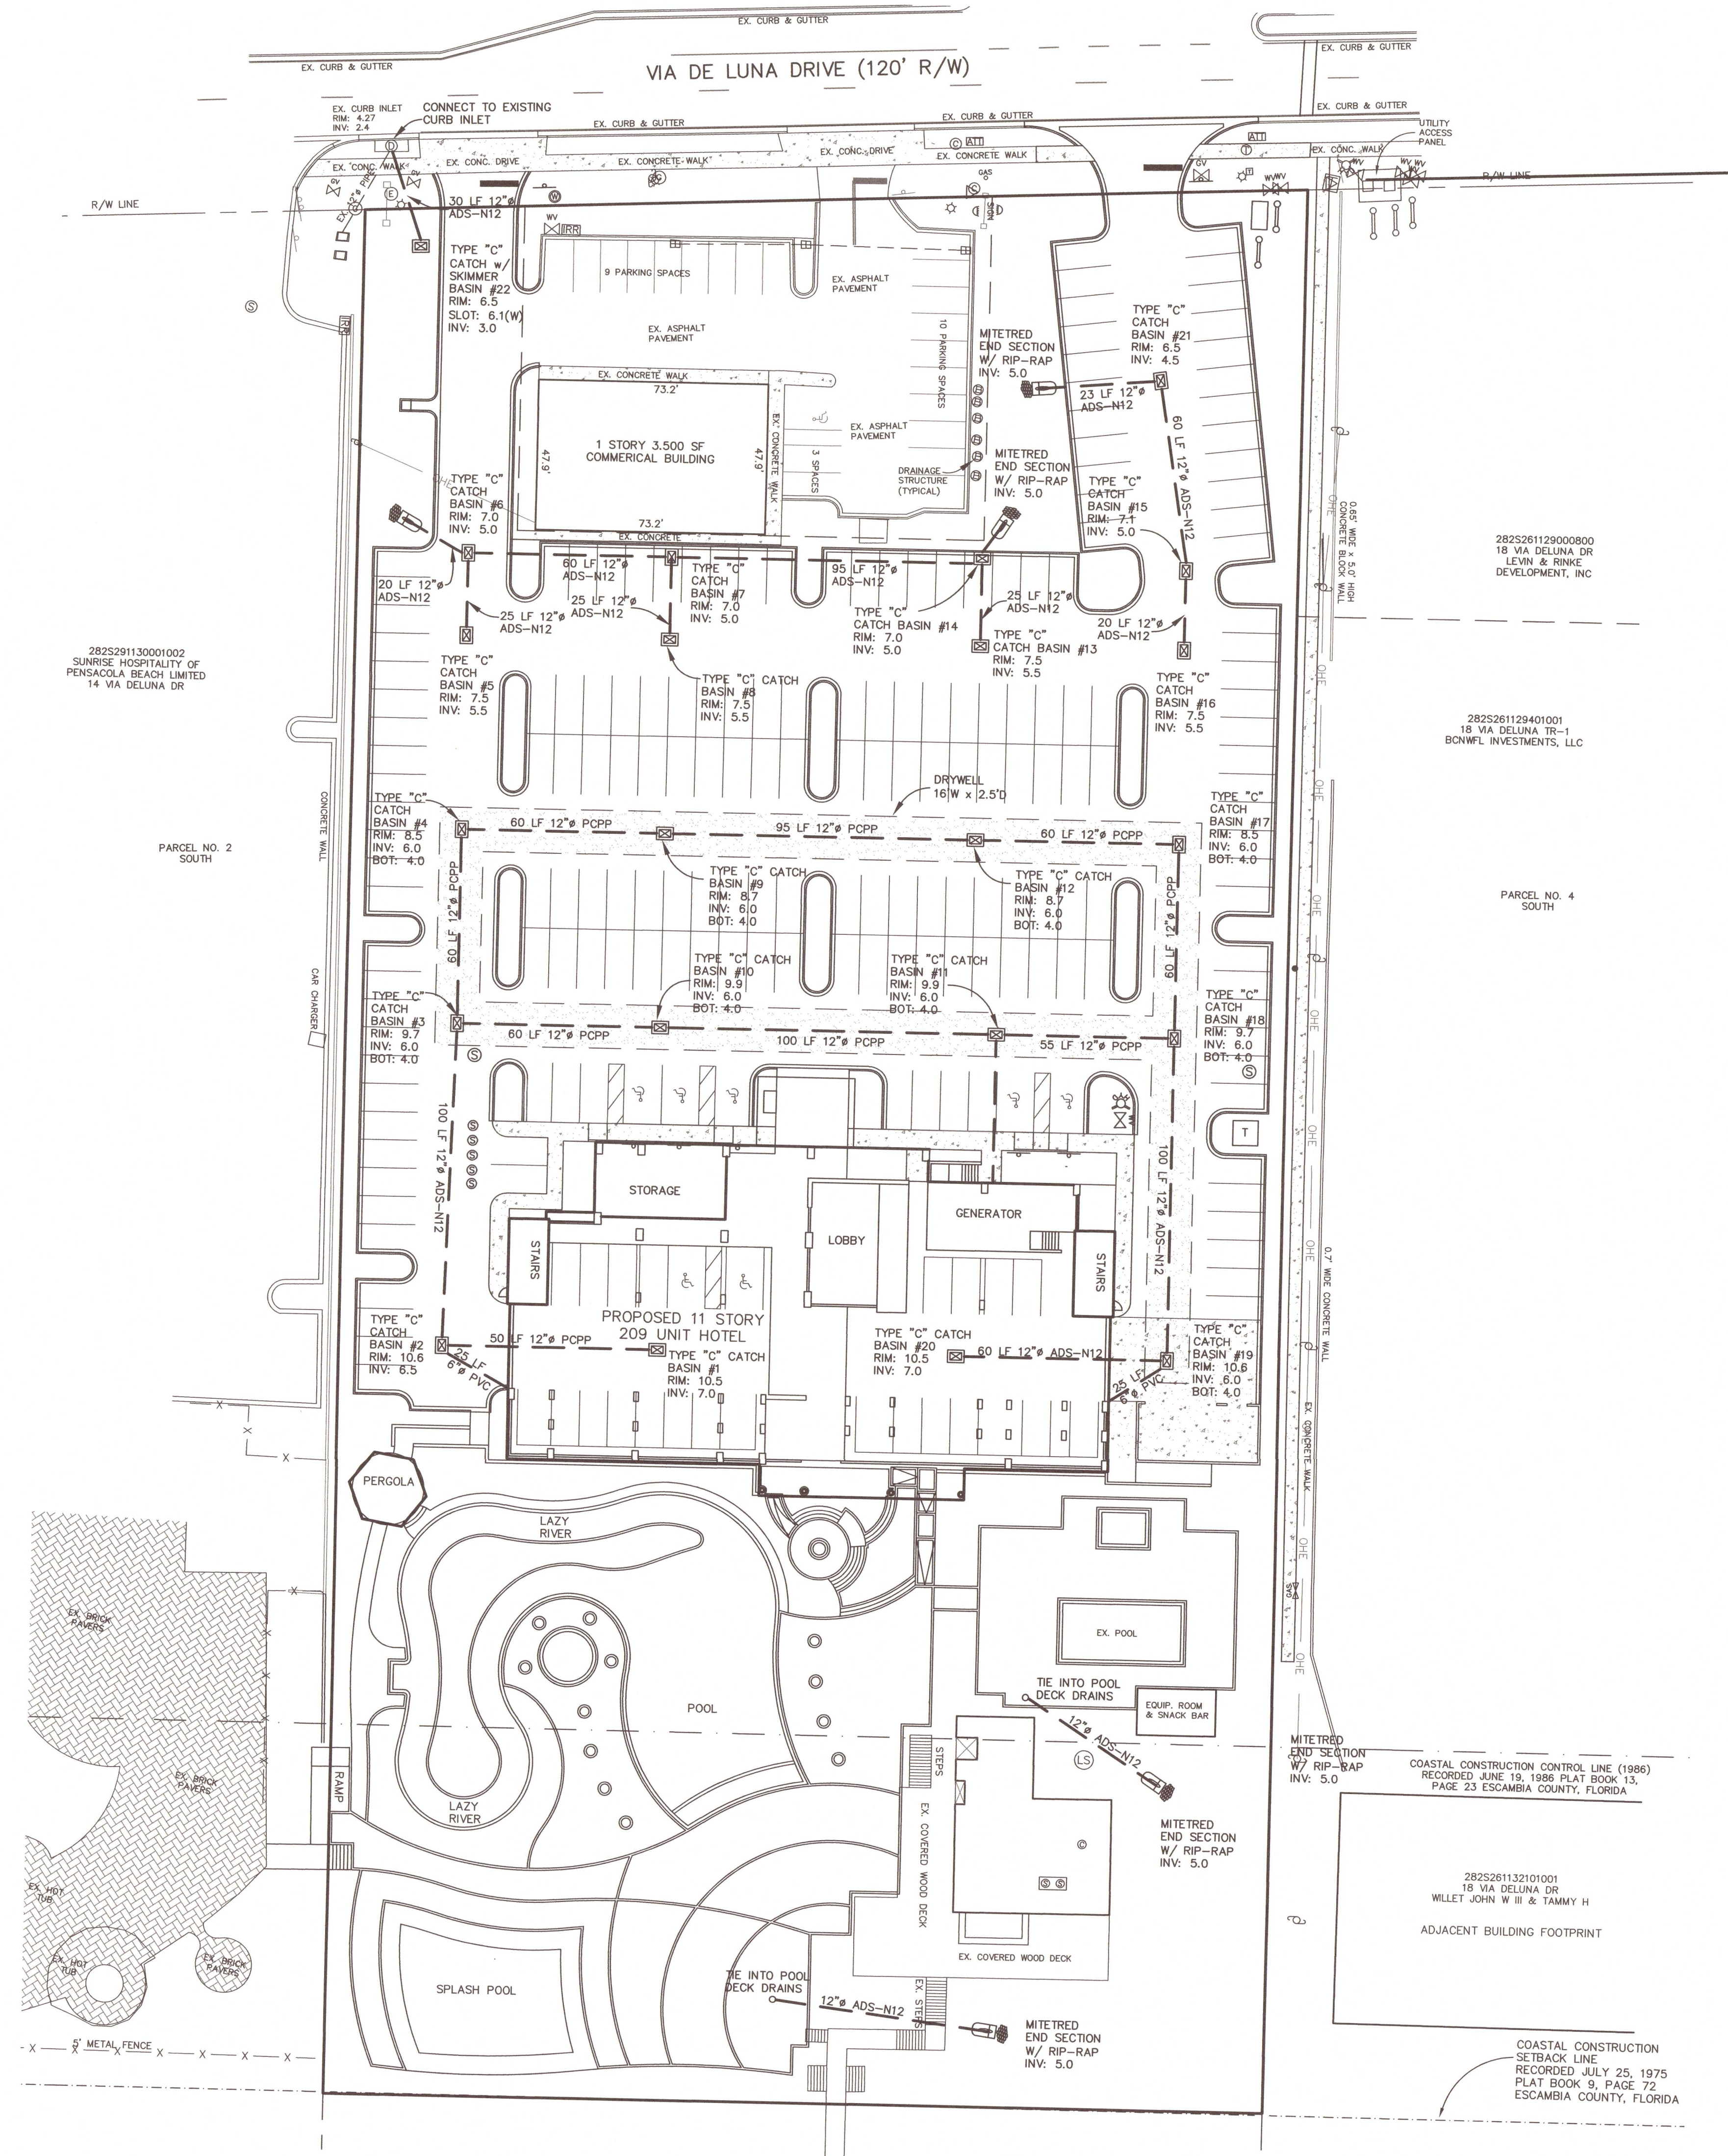


LEGEND

- PROPOSED STORM SEWER PIPE
- CORRUGATED POLYETHYLENE PIPE
- PERFORATED CORRUGATED POLYETHYLENE PIPE
- EXISTING STORM SEWER PIPE
- STORM DRAIN MANHOLE
- CATCH BASIN
- TYPE "9" CURB INLET
- TYPE "3" CURB INLET
- TYPE "4" CURB INLET
- MITERED END SECTION

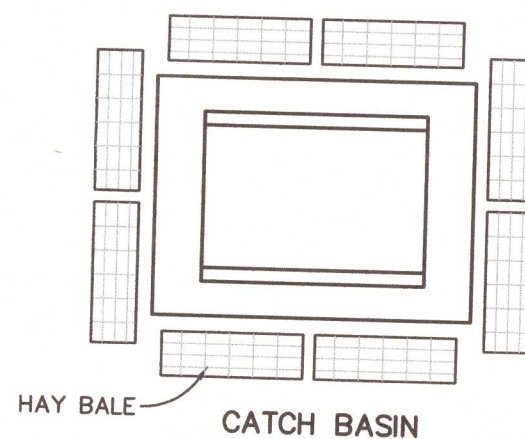

NOTE:
ANCHOR BALES WITH
2-2"x2"x4" STAKES
PER BALE.

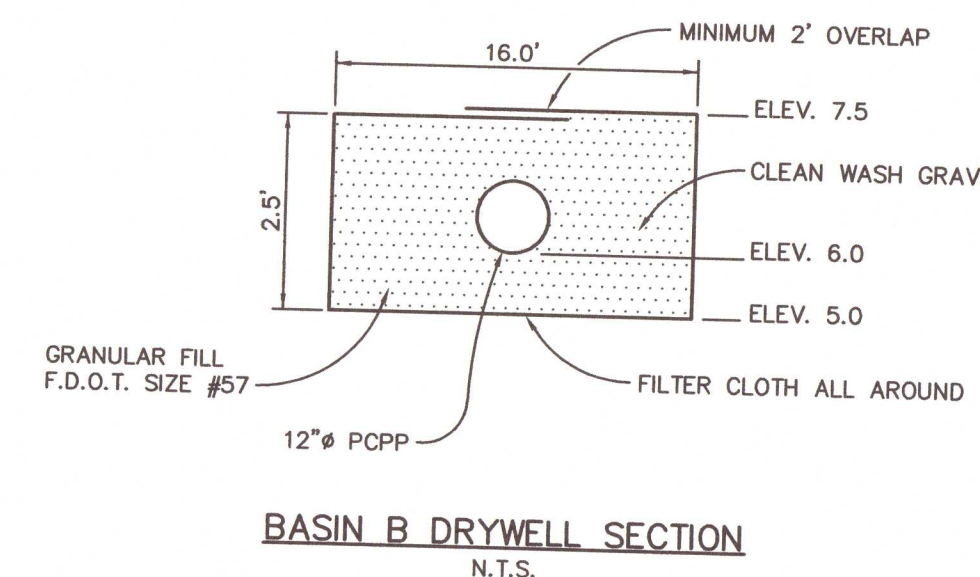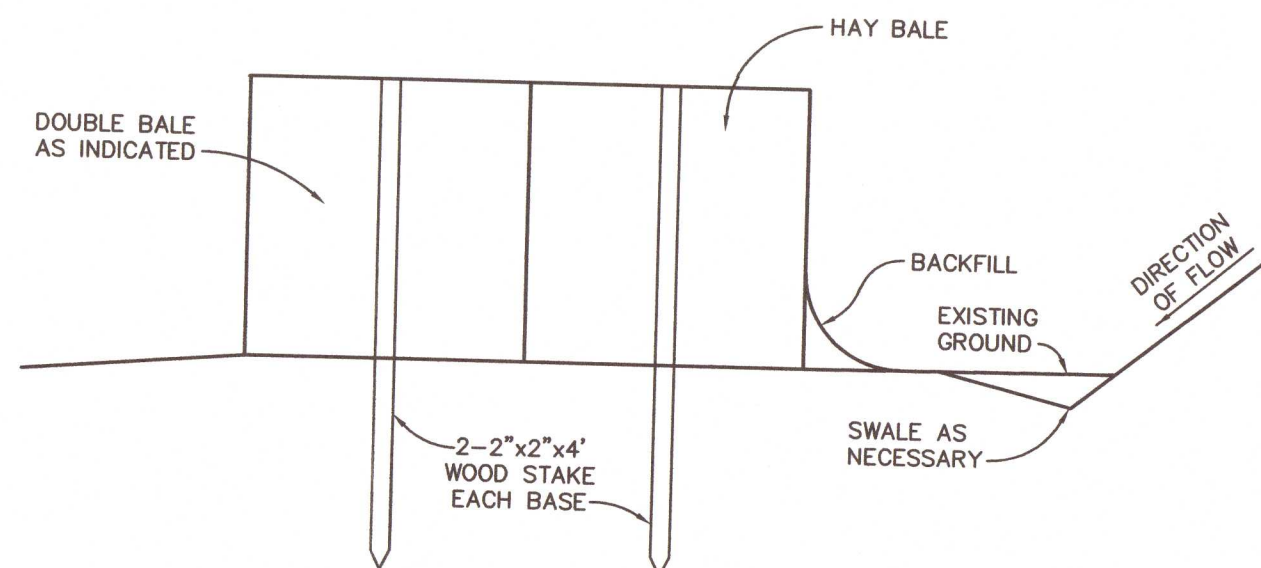

Revisions:
1 JUNE 2001- PER COUNTY COMMENTS

16 VIA DE LUNA HOTEL
PENSACOLA BEACH
DRAINAGE PLAN

Not valid unless bearing Engineer's embossed seal.

MARK C. SNIER, P.E.
FL. REG. NO. 48831



Job No.: 2017-161-B
Date: 4 MAY 2021
Fld. Vol.: N/A
Scale: 1"=40'
Disk No.: 17161B-ENG
Designed: MCS
Drawn: SJW
Checked: MCS
Sheet

REVIEWED BY
SANTA ROSA
ISLAND AUTHORITY

CHOCTAW ENGINEERING, INC.
ENGINEERING • ENVIRONMENTAL • SURVEYING
112 TRUXTON AVENUE
FORT WALTON BEACH, FLORIDA 32547
PHONE: 850-882-6611
FAX: 850-888-8069
EMAIL: ce@choctaweng.com

CERTIFICATE OF AUTHORIZATION No. 1532

THIS SHEET IS THE PROPERTY OF CEI & IS NOT TO BE REPRODUCED WITHOUT WRITTEN CONSENT FROM CEI

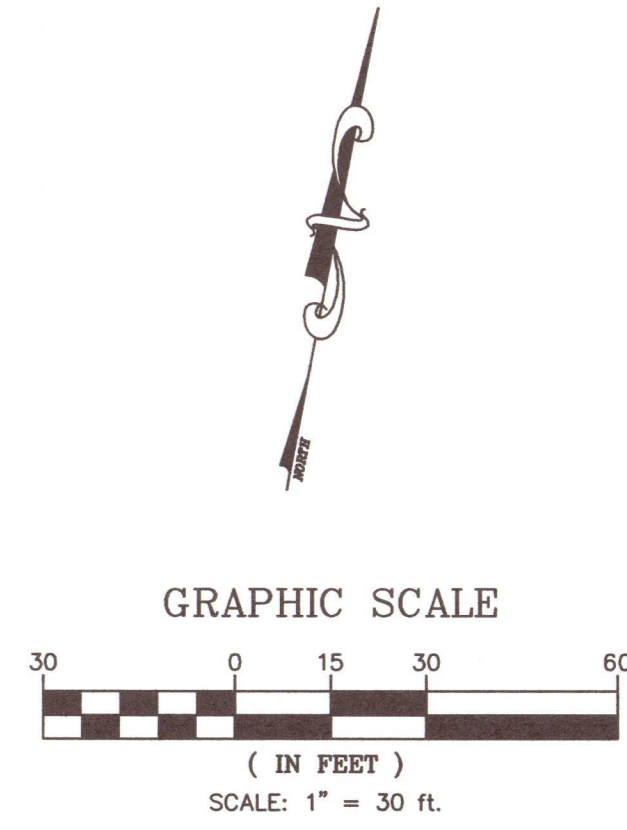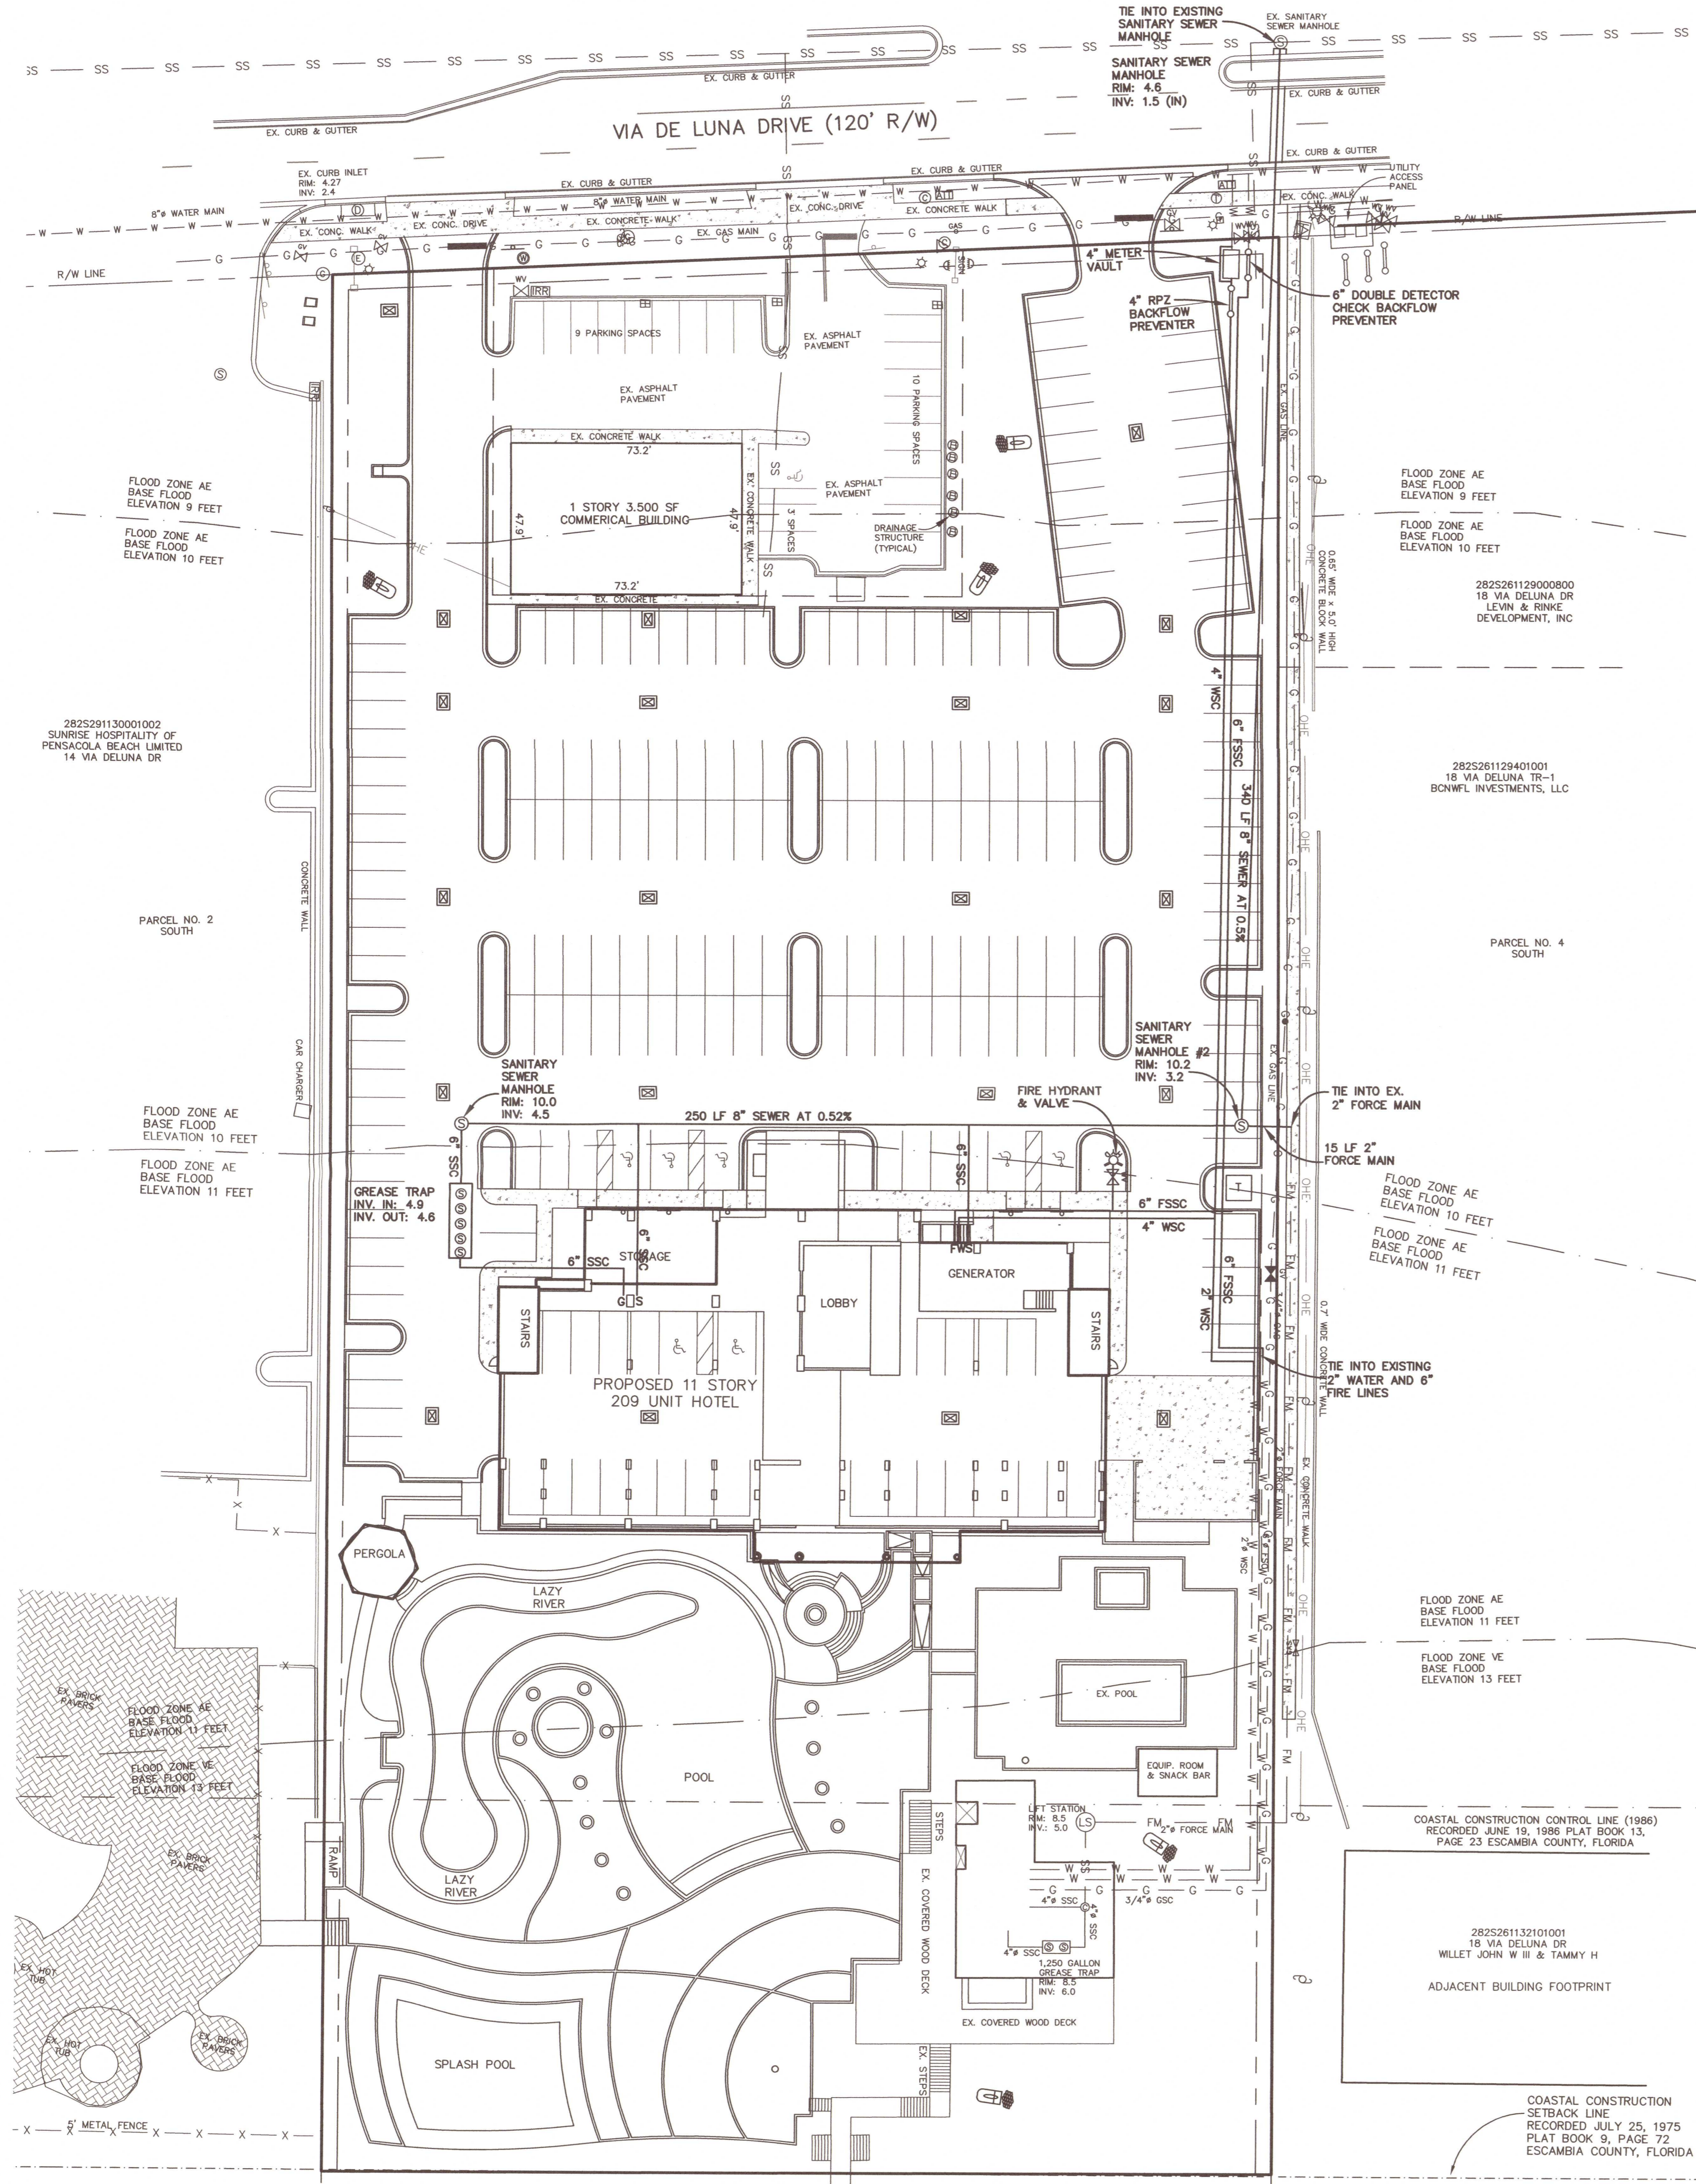

- LEGEND**
- PROPOSED SANITARY SEWER MAIN
 - PROPOSED WATER MAIN
 - WSC WATER SERVICE CONNECTION
 - FSC FIRE SERVICE CONNECTION
 - SSC SEWER SERVICE CONNECTION
 - EXISTING GAS MAIN
 - EXISTING SANITARY SEWER MAIN
 - EXISTING WATER MAIN
 - GAS VALVE
 - GAS METER
 - BACKFLOW PREVENTER
 - WATER METER
 - FIRE HYDRANT
 - WATER VALVE
 - IRRIGATION VALVE
 - WATER SHUT-OFF
 - SANITARY SEWER MANHOLE
 - SANITARY SEWER CLEANOUT

NOTE:
CONTRACTOR MUST ACQUIRE A SEPARATE
"CONSTRUCTION IN THE RIGHT-OF-WAY"
PERMIT FOR UTILITY CROSSINGS.

NOTE:
ALL WORK SHALL BE DONE IN ACCORDANCE WITH THE REQUIREMENTS OF
EQUA'S ENGINEERING MANUAL, LATEST EDITION. ALL CONNECTIONS (I.E., TAPS)
AND TESTING (I.E., PRESSURE AND BACTERIOLOGICAL) SHALL BE SCHEDULED
WITH EQUA INSPECTOR AT LEAST 3 BUSINESS DAYS PRIOR. CONTRACTOR
SHALL REQUEST UTILITY LOCATES BY CALLING SUNSHINE STATE ONE CALL OF
FLORIDA (SSOCOF) AT 811 AT LEAST 3 DAYS PRIOR TO EXCAVATIONS.

REVIEWED BY
SANTA ROSA
ISLAND AUTHORITY

16 VIA DE LUNA HOTEL
PENSACOLA BEACH

UTILITY PLAN

Not valid unless bearing Engineer's embossed seal.


MARK C. SINGER, P.E.
FL. REG. NO. 48831

Revisions:
1 JUNE 2001- PER COUNTY COMMENTS

Job No.: 2017-161-B
Date: 4 MAY 2021
Fld. Vol.: N/A
Scale: 1"=40'
Disk No.: 17161B-ENG
Designed: MCS
Drawn: SJW
Checked: MCS
Sheet 6 of 12

CHOCTAW ENGINEERING, INC.
ENGINEERING • ENVIRONMENTAL • SURVEYING
112 TRUXTON AVENUE
FORT WALTON BEACH, FLORIDA 32547
PHONE: 850-863-6611
FAX: 850-866-8059
EMAIL: ce@choctaweng.com
CERTIFICATE OF AUTHORIZATION No. 1532

THIS SHEET IS THE PROPERTY OF CEI & IS NOT TO BE REPRODUCED WITHOUT WRITTEN CONSENT FROM CEI.

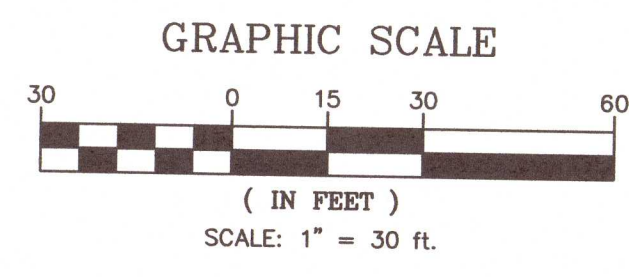


	MANGROVE TREE
	CRAPPE MYRTLE
	MARSH / WETLANDS
	OAK TREE
	PALM TREE
	PINE TREE
	CEDAR TREE
	DOGWOOD TREE
	PECAN TREE
	SHRUB / BUSH

KEY	COMMON NAME	MIN. HEIGHT	REMARKS
LI	CRAPE MYRTLE	9 FT.	MULTI TRUCK, TREE FORM, 3 TRUNK MIN., 30 GAL.
QV	LIVE OAK	12 FT.	2 INCH CAL., SINGLE TRUNK, 30 GAL.
SP	CABBAGE PALM	14 FT.	BR, MATCHED, BOOTED
TD	CYPRESS	12 FT.	2 INCH CAL., SINGLE TRUNK, 30 GAL.
DNO	DWARF OLEANDER	18 IN. SPD.	3 GAL., PLANT 3 FT. O.C.
CS	PAMPAS GRASS	2 - 3 FT.	5 GAL.
RI	DWARF HAWTHORN	18 - 24 IN.	3 GAL., PLANT 3 FT. O.C.
LME	GREEN LIRIOPE	8 IN. SPD.	1 GAL., PLANT 18 IN. O.C.


LANDSCAPE AREA	PLANTING REQUIREMENTS	SITE INFORMATION	PLANTS REQUIRED	PROPOSED VEGETATION
10' FRONT BUFFER	1 TREE / 50 LF RIGHT OF WAY	300 L.F. FRONTAGE	6 TREES	6 TREES
PARKING LOT	1 TREE/END OF PARKING ROW	29 ISLANDS	29 TREES	29 TREES
5' WEST BUFFER	N/A	N/A	N/A	GROUND COVER
5' EAST BUFFER	N/A	N/A	N/A	12 TREES
		TOTAL REQUIRED:	35 TREES	47 TREES

1. ALL LANDSCAPING SHALL BE INSTALLED IN A SOUND AND WORKMANLIKE MANNER AND ACCORDING TO ACCEPTED NURSERY PLANTING PROCEDURES. ALL ELEMENTS OF LANDSCAPING SHALL BE INSTALLED SO AS TO MEET ALL APPLICABLE SECTIONS OF THE SANTA ROSA ISLAND AUTHORITY AND THE RESPECTIVE DISTRICT REQUIREMENTS.
2. ALL PLANT MATERIALS SHALL CONFORM TO THE STANDARDS FOR FLORIDA NO. 1 OR BETTER AS GIVEN IN "GRADES AND STANDARDS FOR NURSERY PLANTS," PART I, CURRENT EDITION, AND PART II, STATE OF FLORIDA, DEPARTMENT OF AGRICULTURE, TALLAHASSEE, FLORIDA.
3. TREES SHALL BE PLANT SPECIES HAVING AN MINIMUM HEIGHT OF NINE FEET AT TIME OF PLANTING AND SHALL HAVE A TRUNK THAT IS EXPECTED TO BE MAINTAINED IN A CONDITION CLEAR OF LATERAL WOODY GROWTH OF FIVE FEET OR GREATER. CONTRACTOR SHALL USE "NATIVE SPECIES" IF POSSIBLE.
4. SHRUBS AND HEDGES SHALL BE SELF SUPPORTING, WOODY EVERGREEN OR FLOWERING SPECIES GENERALLY GROWING OR MAINTAINED AT A HEIGHT OF NOT LESS THAN THREE FEET. SHRUBS SHALL BE A MINIMUM OF 12 INCHES IN HEIGHT WHEN MEASURED IMMEDIATELY AFTER PLANTING AND SHALL BE PLANTED AT EQUAL DISTANCES ON CENTER.
5. GROUND COVER SHALL BE LOW GROWING PLANTS OR VINES PLANTED IN SUCH A MANNER AS TO FORM A CONTINUOUS COVER OVER THE GROUND AND USUALLY GROWING NO HIGHER THAN 2 FEET.
6. GRASS AREAS SHALL BE PLANTED WITH SPECIES NORMALLY GROWN AS PERMANENT LAWNS IN ESCAMBIA COUNTY, FLORIDA. ALL SOD SHALL BE CLEAN AND REASONABLY FREE OF WEEDS, NOXIOUS PESTS, AND DISEASES.
7. THE OWNER, LEASOR, OR PARTY RESPONSIBLE FOR A BUILDING GROUNDS MAINTENANCE OR THE RESPECTIVE AGENT OF EACH IF ANY SHALL BE JOINTLY AND SEVERALLY RESPONSIBLE FOR THE MAINTENANCE OF ALL REQUIRED LANDSCAPE PLANT MATERIALS AND ALL IRRIGATION EQUIPMENT, IF ANY.
8. ALL DISTURBED AREAS SHALL BE TURFED. TURFING SHALL BE BERMUDA GRASS, SEED, AND MULCH, EXCEPT WHERE SLOPES ARE GREATER THAN 3:1. WILL HAVE SOD STAKED IN PLACE.
9. ALL PROPOSED LANDSCAPING MATERIALS SHALL MEET THE MINIMUM REQUIREMENTS AS SET FORTH IN SECTION 7.01 OF THE ESCAMBIA COUNTY LAND DEVELOPMENT CODE AND ESCAMBIA COUNTY ORDINANCE 2000-45.


IN SECTION 701 OF THE
REVIEWED BY
SANTA ROSA
ISLAND AUTHORITY

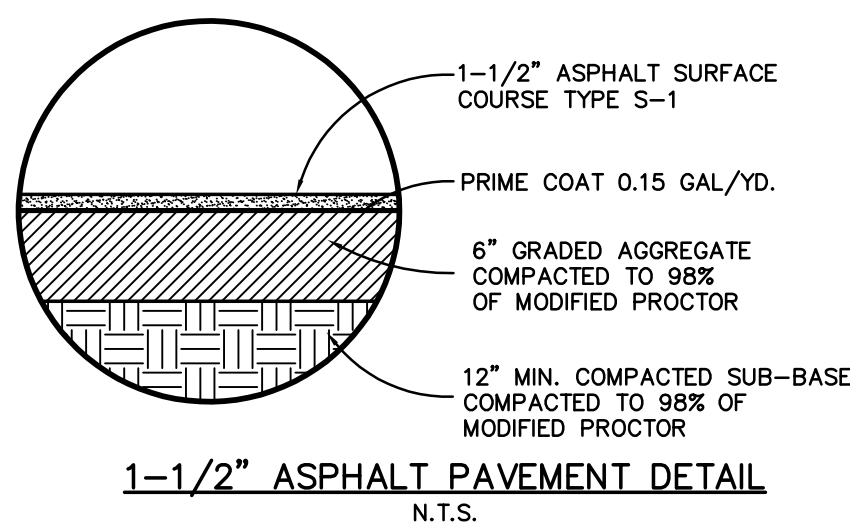


1-1/2" ASPHALT PAVEMENT DETAIL
N.T.S.

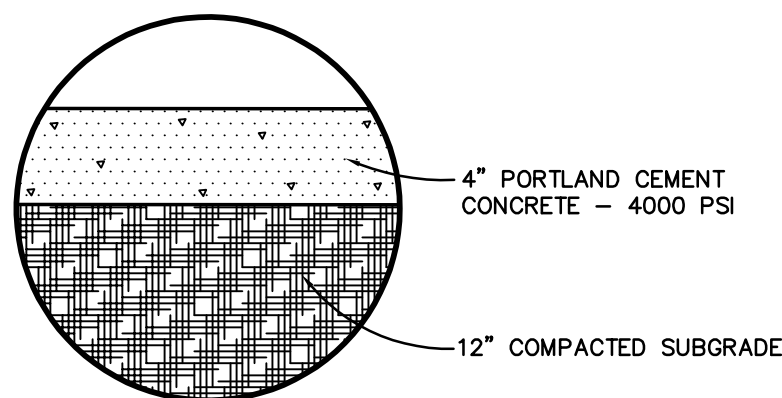

4" CONCRETE PAVEMENT DETAIL
N.T.S.

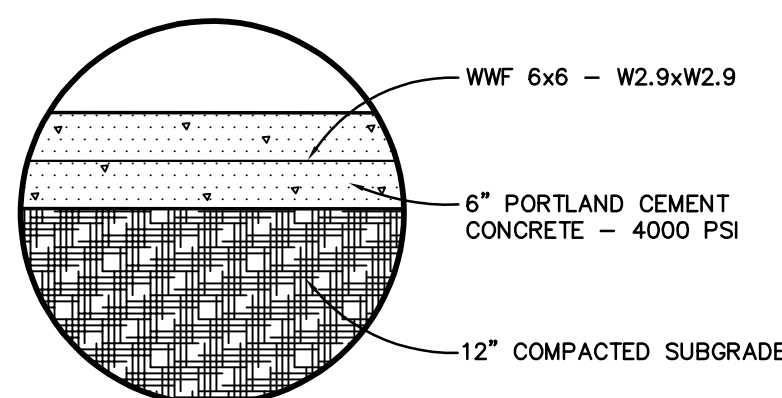


6" CONCRETE PAVEMENT DETAIL
N.T.S.

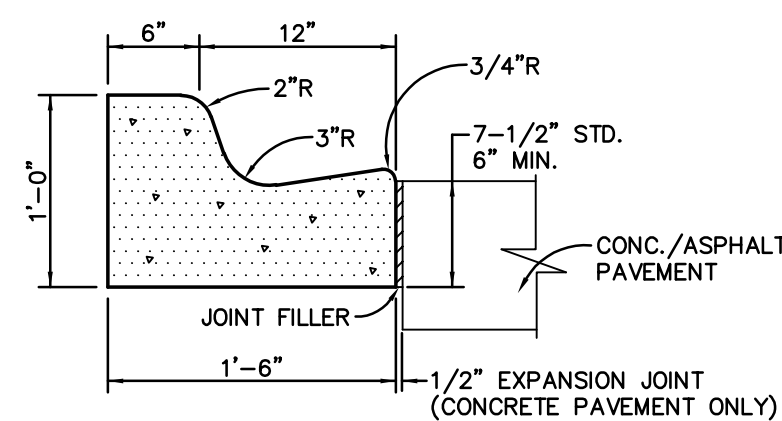


CONCRETE CURB AND GUTTER DETAIL
N.T.S.

WHEN USED ON HIGH SIDE OF ROADWAYS, THE CROSS SLOPE OF THE GUTTER SHALL MATCH THE CROSS SLOPE OF THE ADJACENT PAVEMENT AND THE THICKNESS OF THE LIP SHALL BE 6" MIN., UNLESS OTHERWISE SHOWN ON PLANS. EXPANSION JOINT, PREFORMED JOINT FILLER AND JOINT SEAL ARE REQUIRED BETWEEN CURBS AND CONCRETE PAVEMENT OR CONCRETE STRUCTURES.

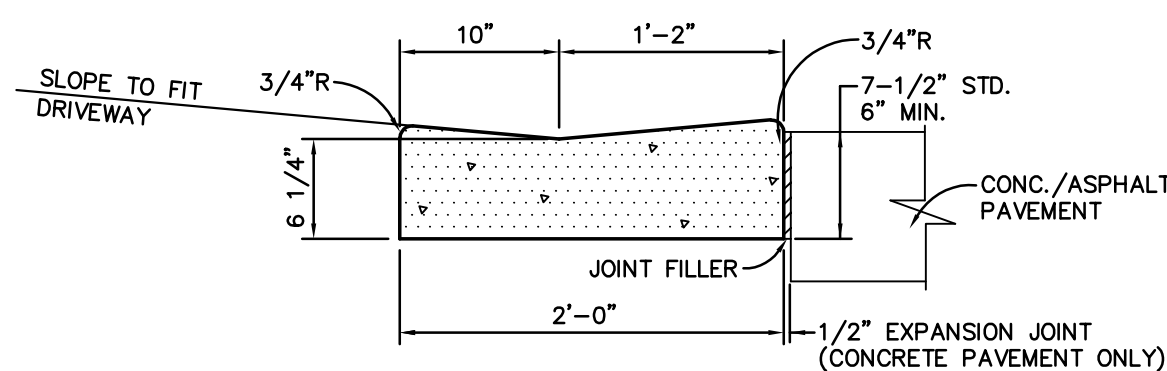




DROP CURB DETAIL
N.T.S.

WHEN USED ON HIGH SIDE OF ROADWAYS, THE CROSS SLOPE OF THE GUTTER SHALL MATCH THE CROSS SLOPE OF THE ADJACENT PAVEMENT AND THE THICKNESS OF THE LIP SHALL BE 6" MIN., UNLESS OTHERWISE SHOWN ON PLANS. EXPANSION JOINT, PREFORMED JOINT FILLER AND JOINT SEAL ARE REQUIRED BETWEEN CURBS AND CONCRETE PAVEMENTS OR CONCRETE STRUCTURES.

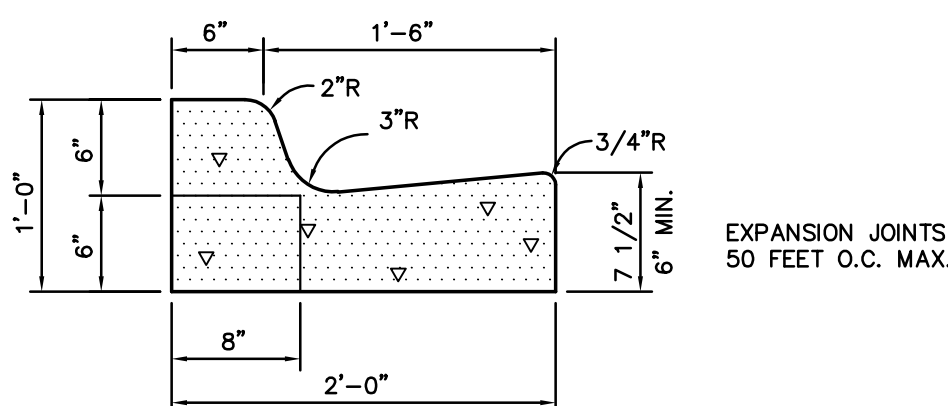


TYPE "F" CONCRETE CURB AND GUTTER DETAIL
(F.D.O.T. INDEX No. 520-001)
N.T.S.


WHEN USED ON HIGH SIDE OF ROADWAYS, THE CROSS SLOPE OF THE GUTTER SHALL MATCH THE CROSS SLOPE OF THE ADJACENT PAVEMENT AND THE THICKNESS OF THE LIP SHALL BE 6", UNLESS OTHERWISE SHOWN ON PLANS.

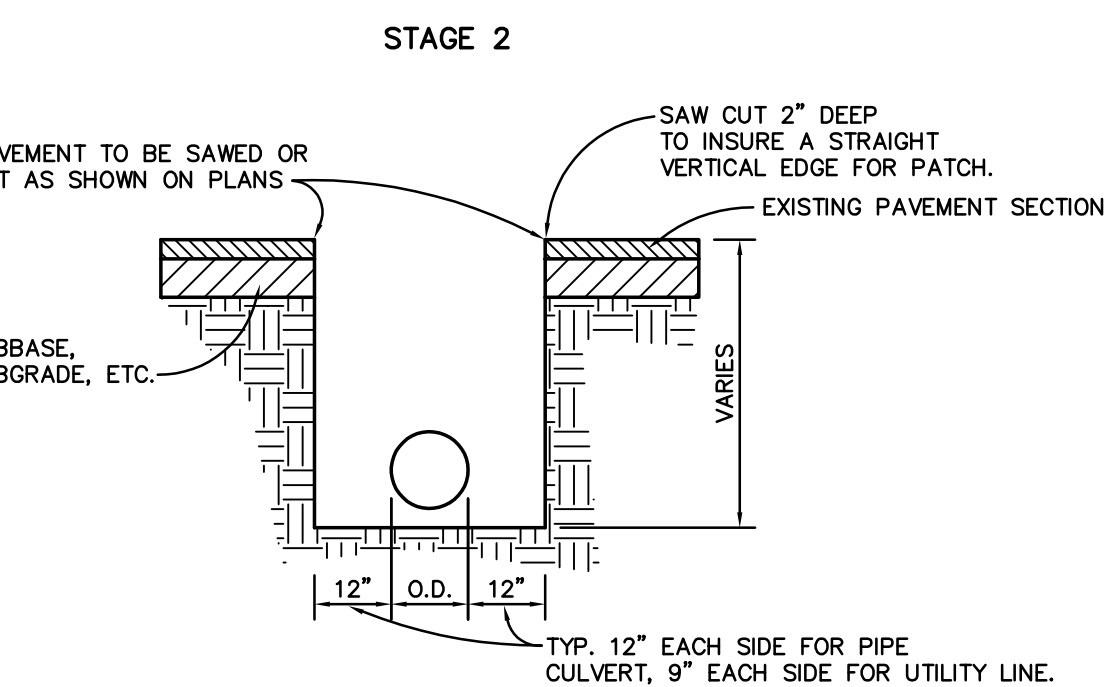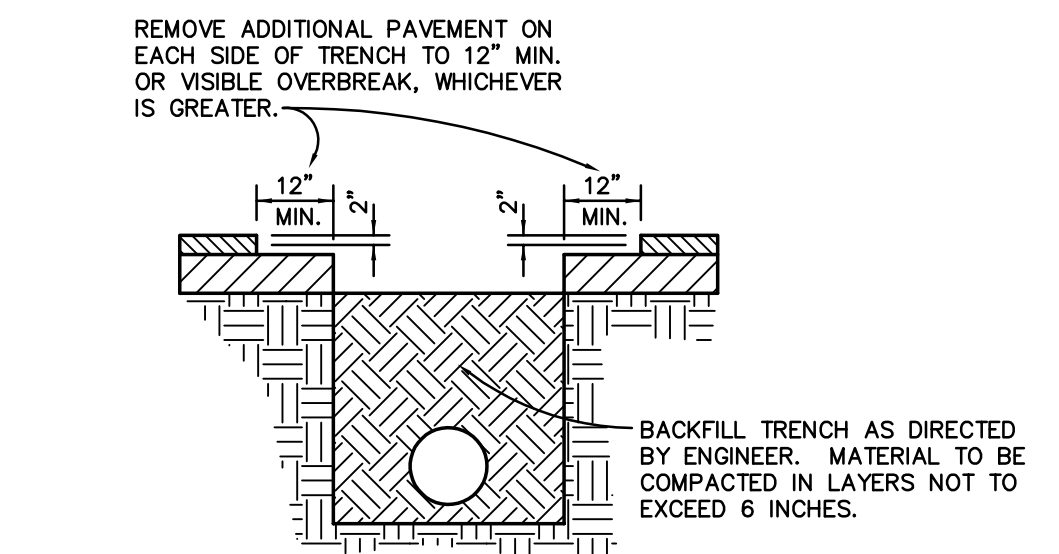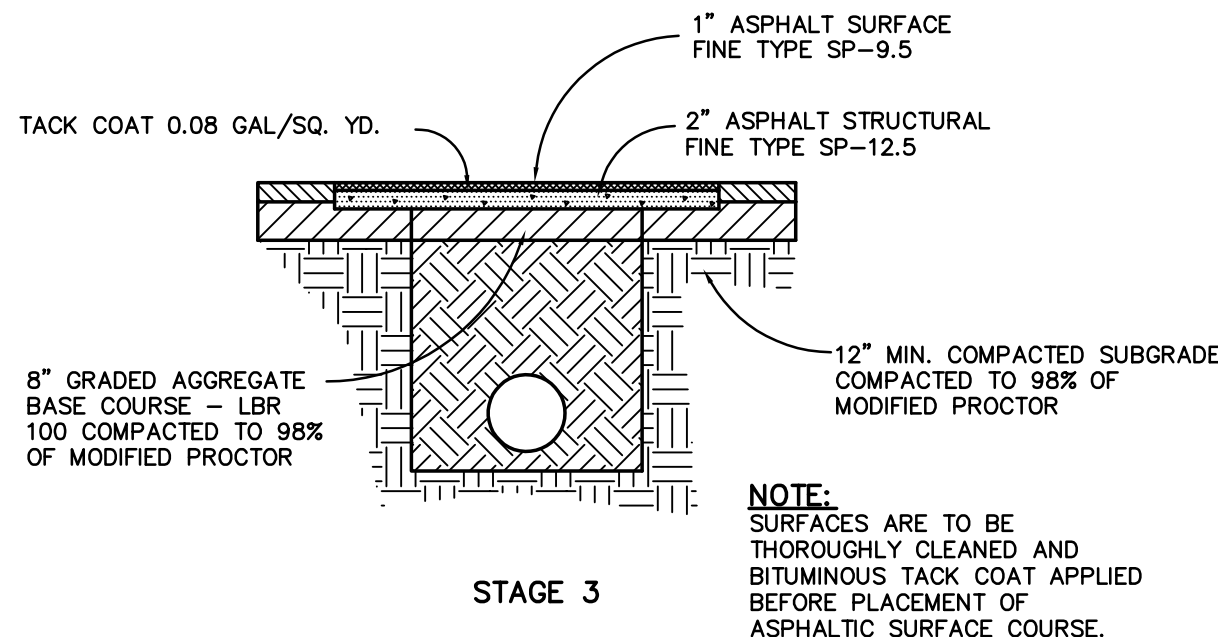

PAVEMENT PATCHING DETAIL
(UTILITY INSTALLATIONS BY OPEN CUT ACROSS EXISTING PAVEMENT)
N.T.S.

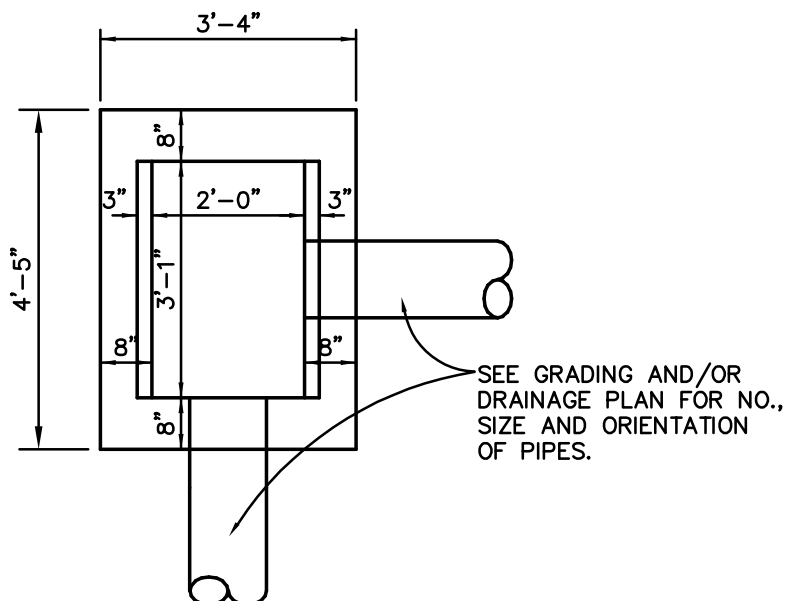


PLAN VIEW

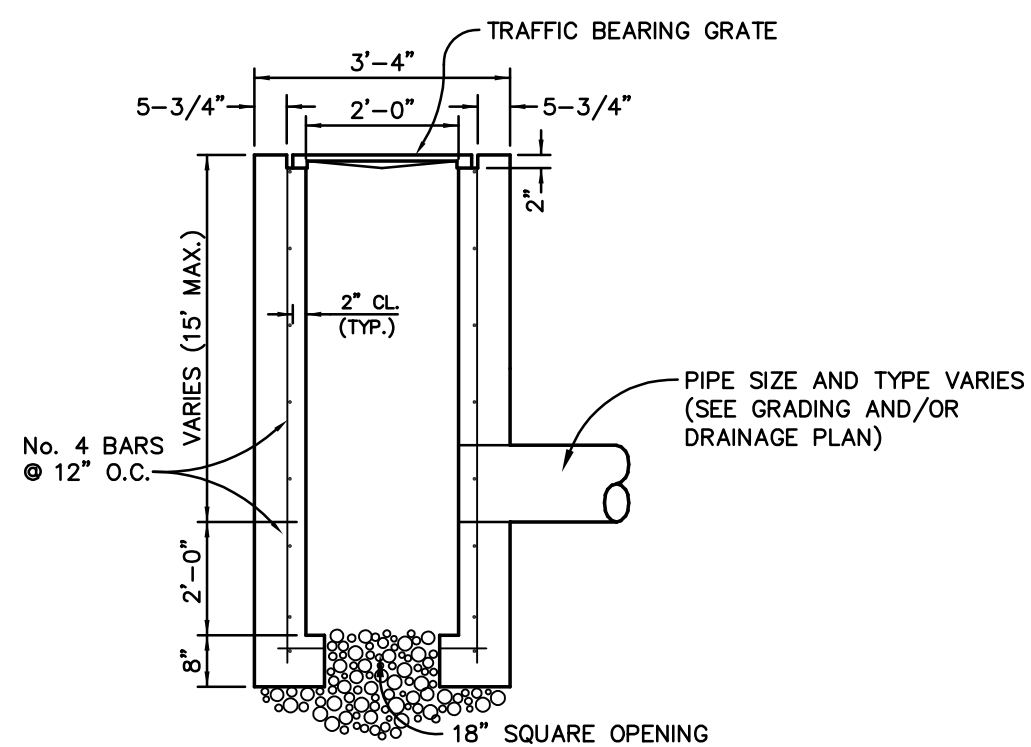

SECTION VIEW


**TYPE "C" CATCH BASIN
W/ 2' SUMP DETAIL**
(F.D.O.T. INDEX No. 232)
N.T.S.

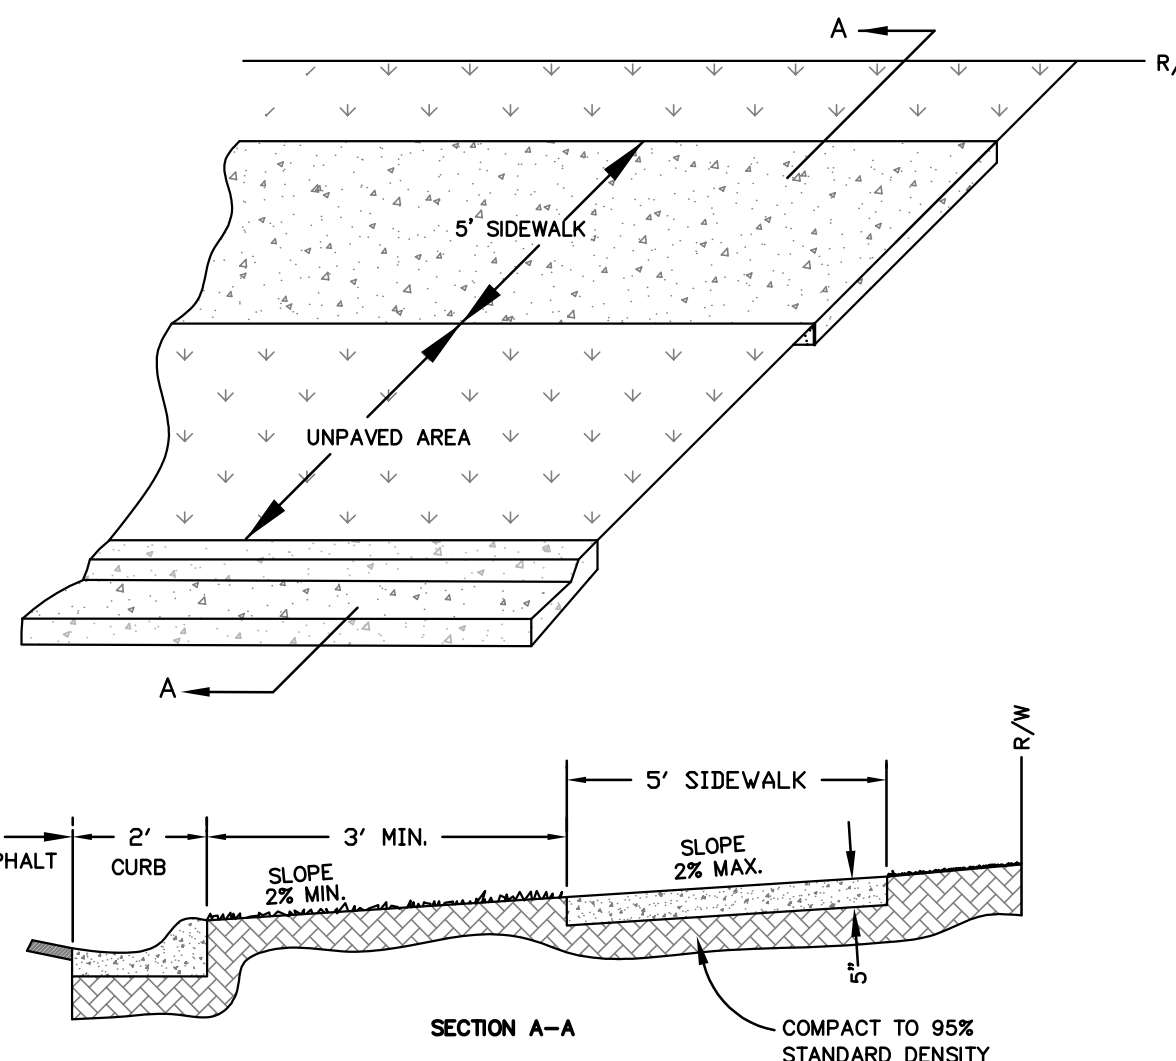


NOTES:

1. CROSS SLOPE NOT TO EXCEED 1:50 (2%).
2. SIDEWALK TO BE A MIN. 3,000 PSI CONCRETE.
3. CONCRETE SHALL BE CURED MIN. 24 HOURS AFTER POURING.
4. 3/4" DEEP, TOOLED CONTROL JOINTS SHALL BE PROVIDED AT A DISTANCE EQUAL TO THE SIDEWALK WIDTH OR EVERY 5', WHICHEVER IS LESS.
5. EXPANSION JOINTS SHALL BE PROVIDED AT A MAX. OF 50' AND WHERE CONCRETE IS PLACED ADJACENT TO EXISTING CURB, DRIVEWAYS, BUILDINGS AND WALKWAYS.


STANDARD SIDEWALK DETAIL

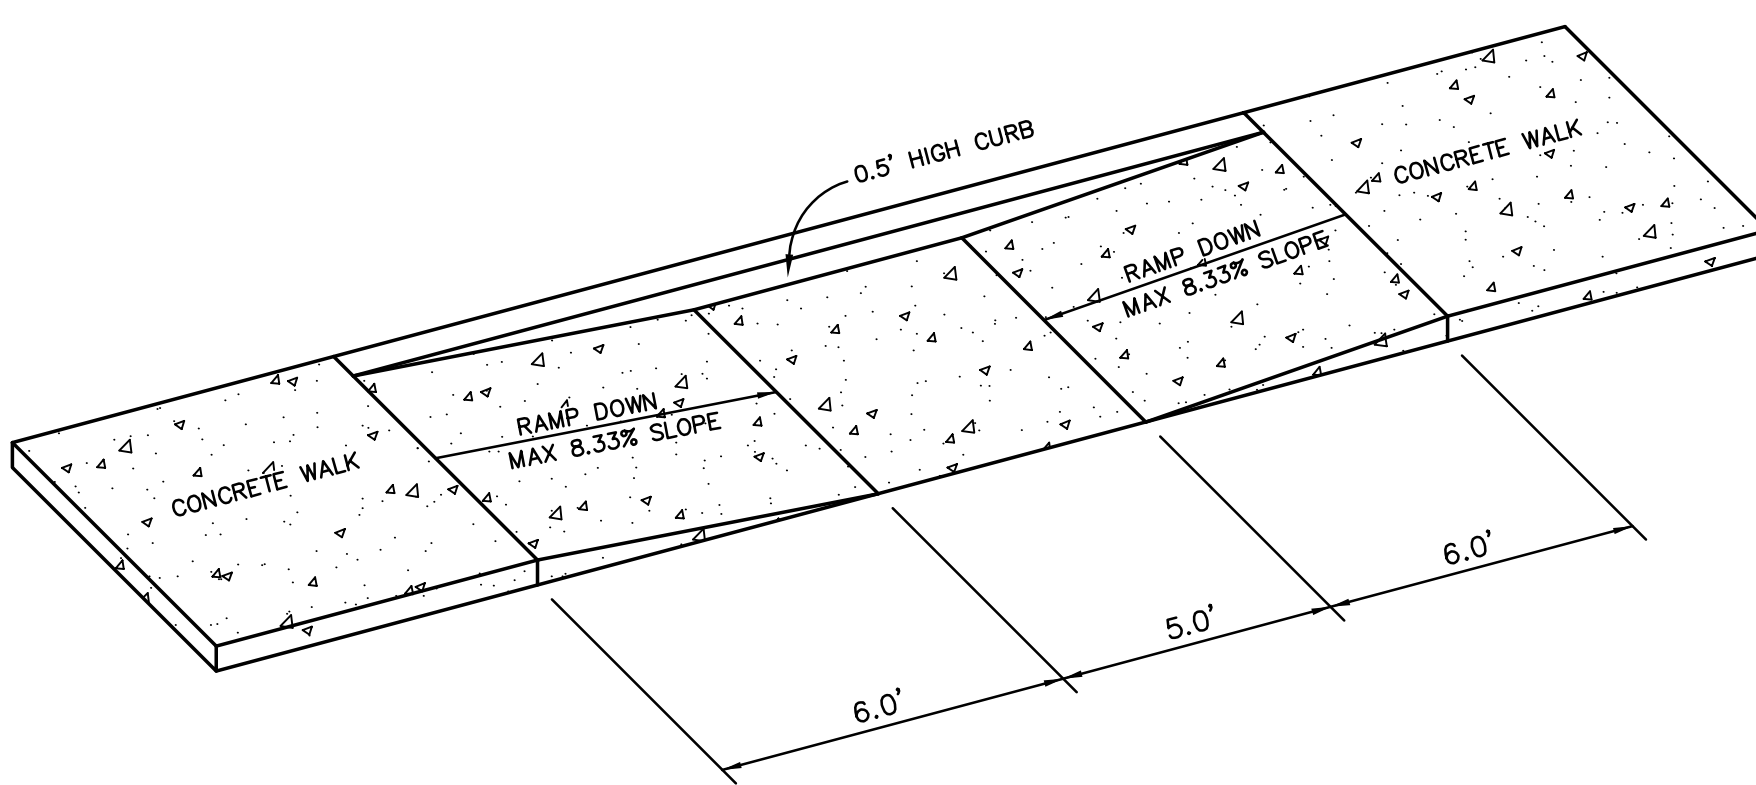

SIDEWALK HANDICAP RAMP DETAIL
N.T.S.

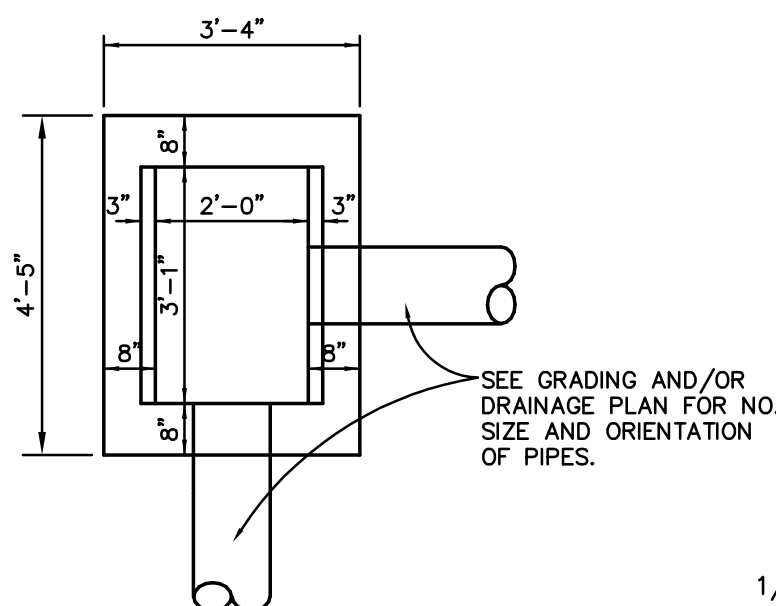


PLAN VIEW

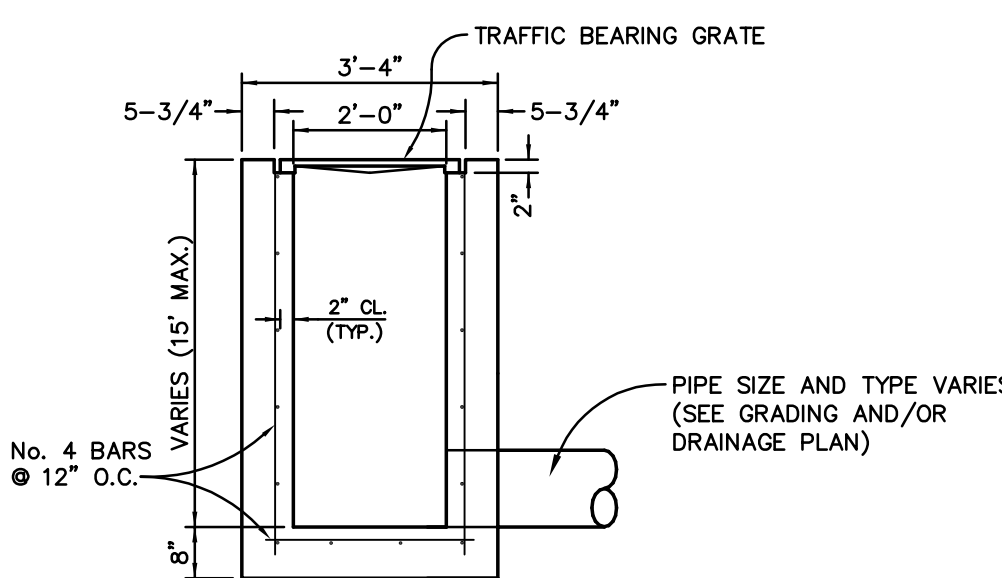


SECTION VIEW

TYPE "C" CATCH BASIN DETAIL
(F.D.O.T. INDEX No. 425-052)
N.T.S.

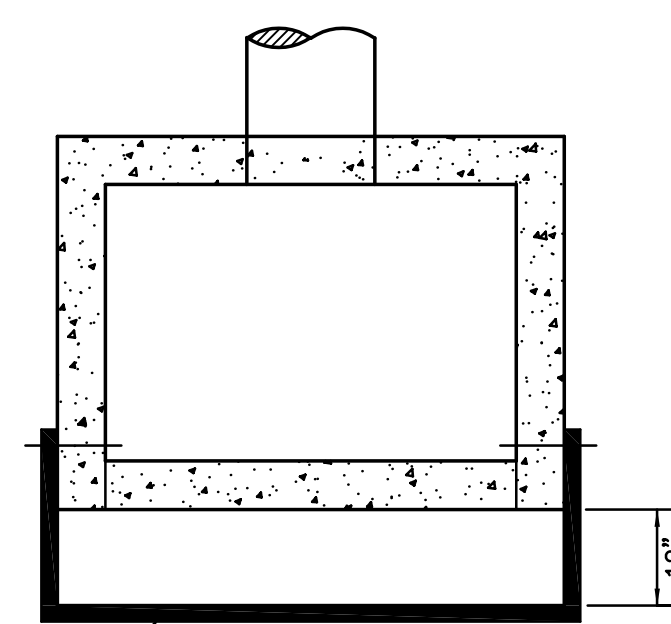


PLAN VIEW

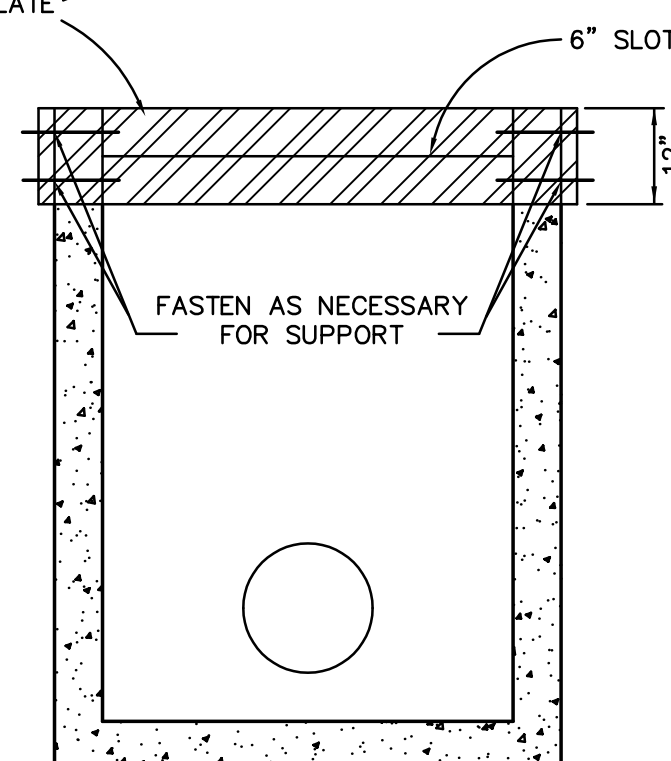



SECTION VIEW

**OIL SKIMMER FOR
OUTFALL STRUCTURE DETAIL**
N.T.S.

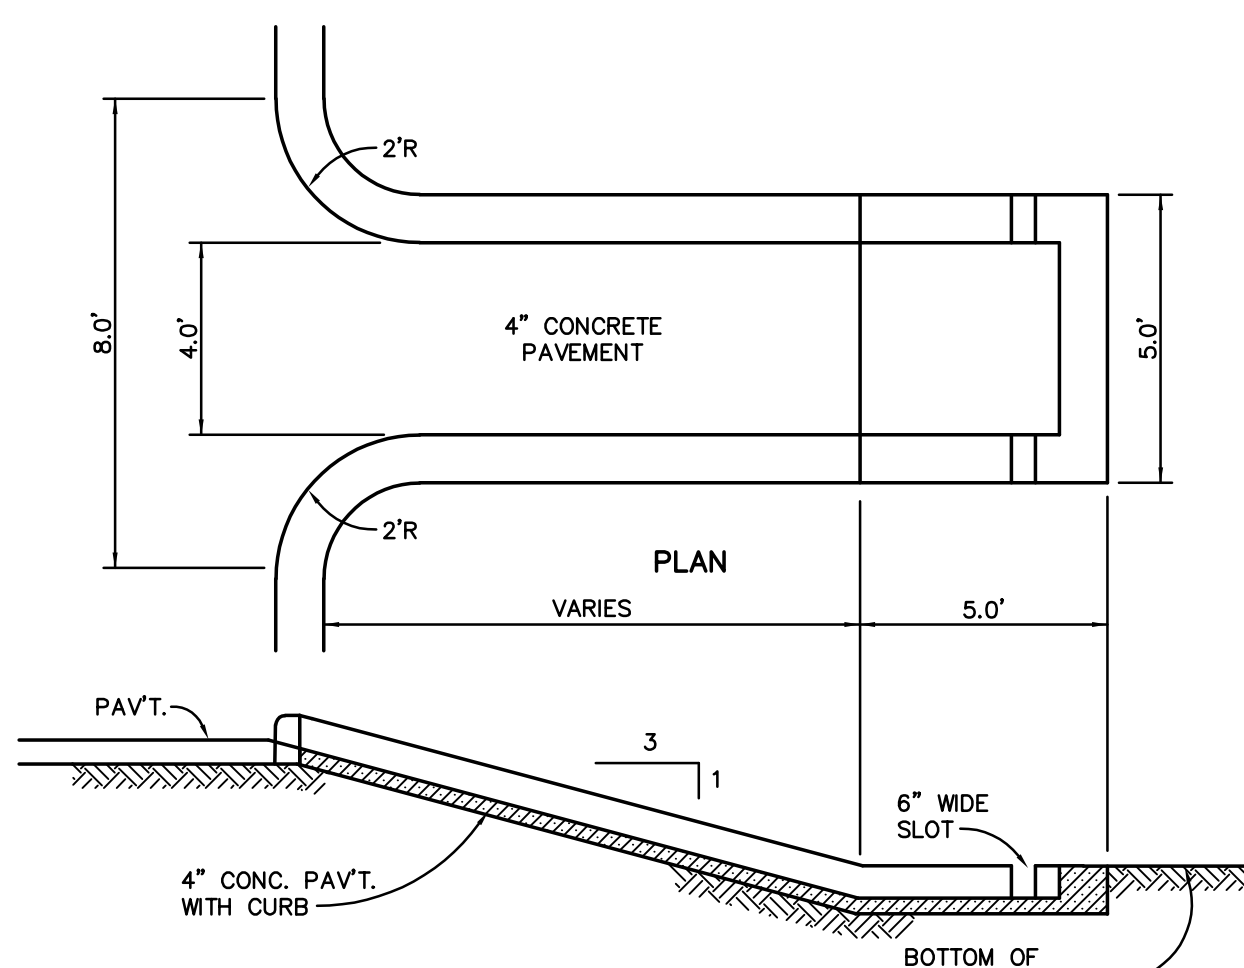

SECTION


FLAT SPLASH PAD DETAIL
N.T.S.

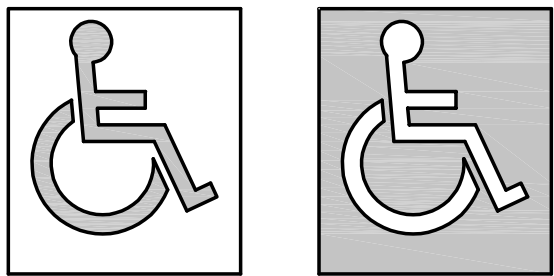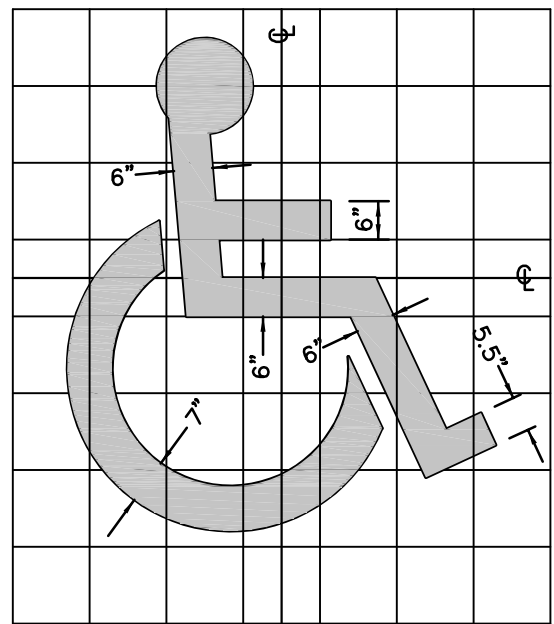


COLOR CONTRAST
CHARACTERS AND SYMBOLS SHALL CONTRAST WITH THEIR BACKGROUNDS - EITHER LIGHT CHARACTERS ON A DARK BACKGROUND OR DARK CHARACTERS ON A LIGHT BACKGROUND.

HANDICAP SYMBOL DETAIL
N.T.S.

SYMBOL SHALL BE PAINTED BLUE AND TO THE DIMENSIONS SHOWN

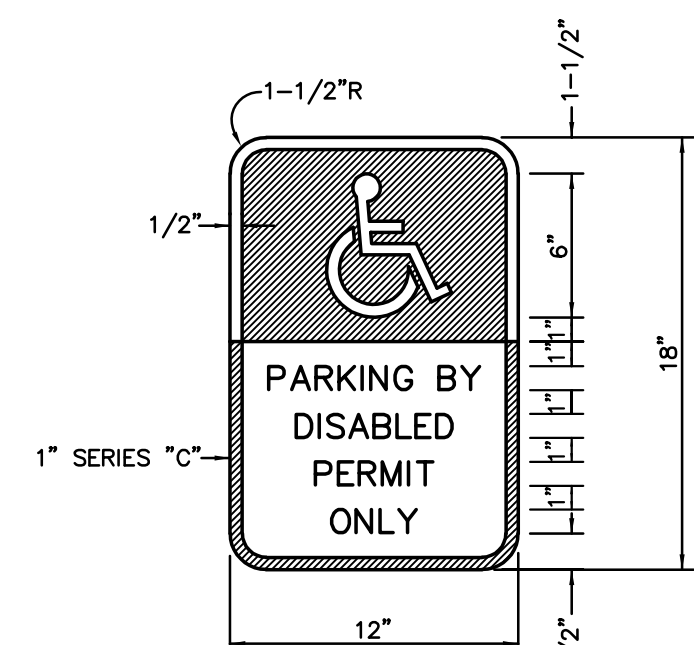

(F.D.O.T. INDEX #17355)

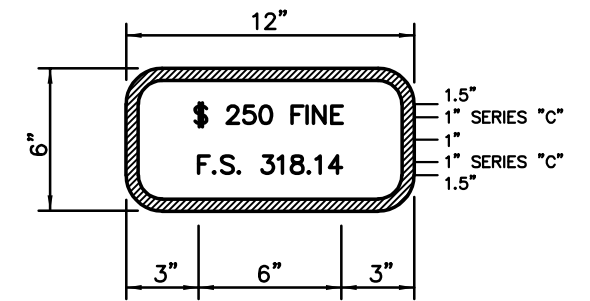


(FTP - 55)


COLOR
BACKGROUND & BORDER WHITE
LEGEND & BORDER BLACK

THIS PANEL SHALL BE INSTALLED UNDER THE FTP-25 OR FTP-26 HANDICAP PARKING SIGN. BOTTOM OF SIGN TO BE 7'-0" FROM GROUND.

HANDICAP SIGN DETAIL
(F.D.O.T. INDEX No. 17355)
N.T.S.

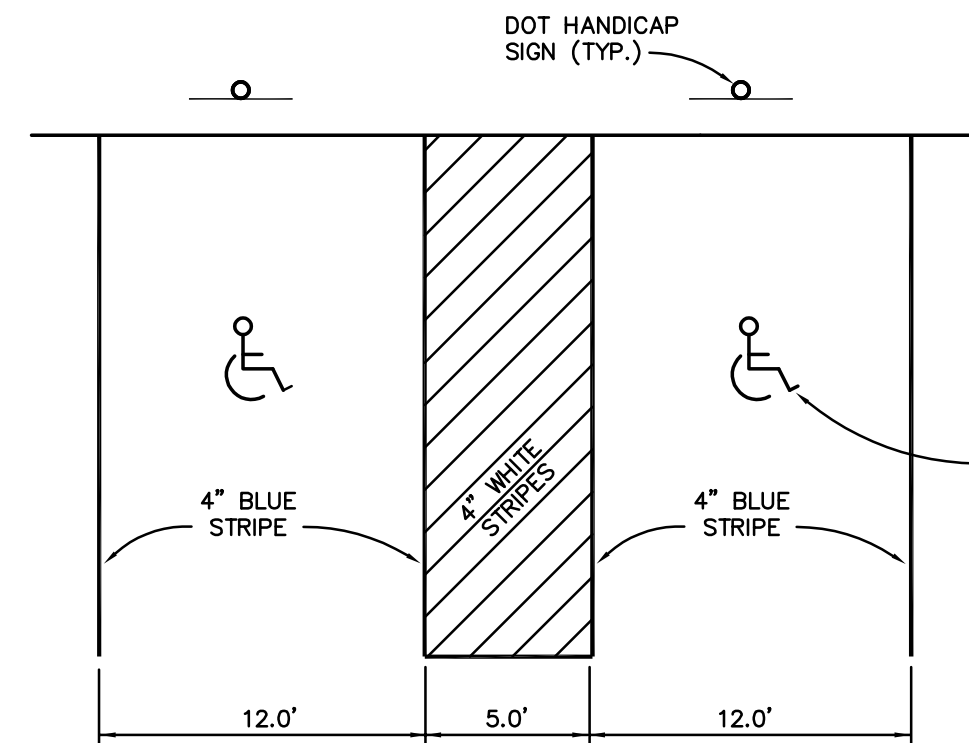

HANDICAP AREA STRIPING DETAIL
N.T.S.

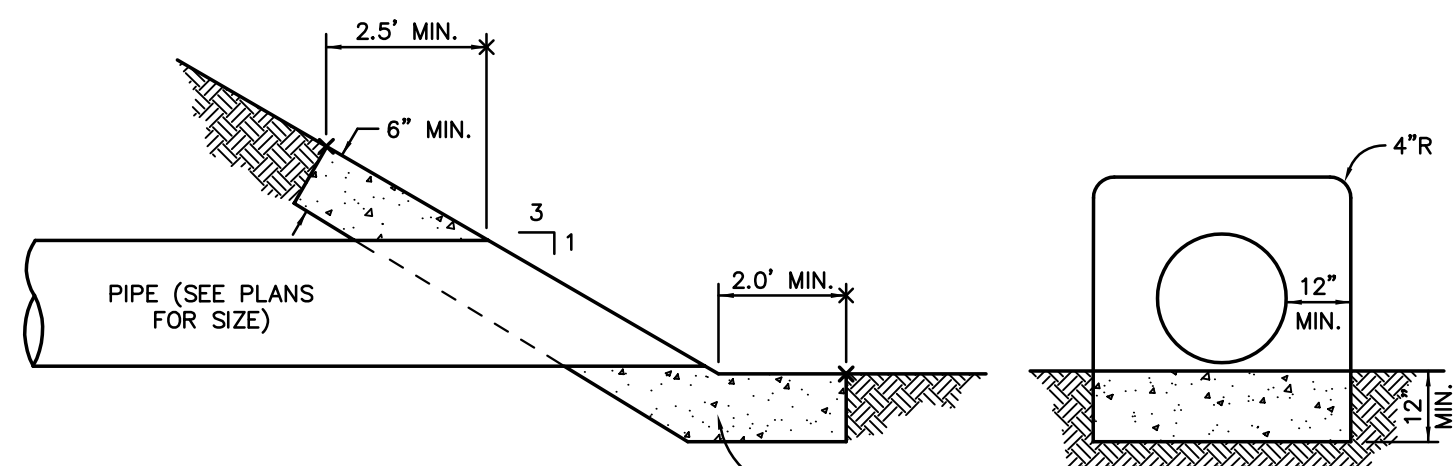

**MITERED END SECTION
AND CONCRETE COLLAR DETAIL**
N.T.S.

CHOCTAW ENGINEERING, INC.
ENGINEERING • ENVIRONMENTAL • SURVEYING
112 TRUXTON AVENUE
FORT WALTON BEACH, FLORIDA 32547
PHONE: 850-862-6611
FAX: 850-863-8059
EMAIL: cei@choctaweng.com


CEI

Revisions:
1 JUNE 2001- PER COUNTY COMMENTS

**16 VIA DE LUNA HOTEL
PENSACOLA BEACH**
MISCELLANEOUS DETAILS
Not valid unless bearing Engineer's embossed seal.


MARK C. SNER, P.E.
FL REG. NO. 48831

Job No.: 2017-161-B
Date: 4 MAY 2021
Fld. Vol.: N/A
Scale: N/A
Disk No.: 17161B-MISC
Designed: MCS
Drawn: CRG
Checked: MCS
Sheet

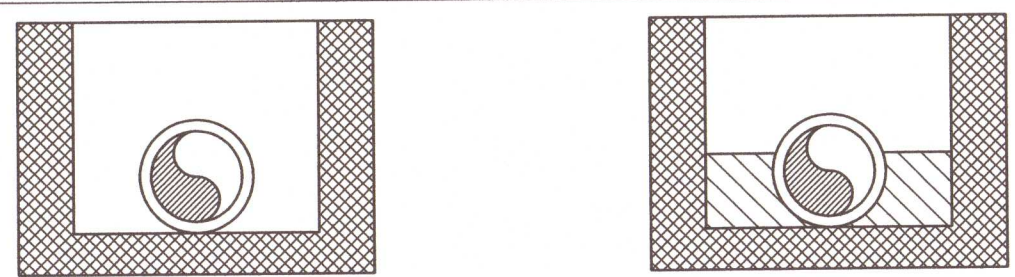


TYPE 1
FLAT-BOTTOM TRENCH, LOOSE EMBEDMENT
E = 50 psi (340 kPa), K = 0.110


TYPE 2
FLAT-BOTTOM TRENCH, EMBEDMENT LIGHTLY CONSOLIDATED TO CENTERLINE OF PIPE.
E = 200 psi (1,380 kPa), K = 0.110

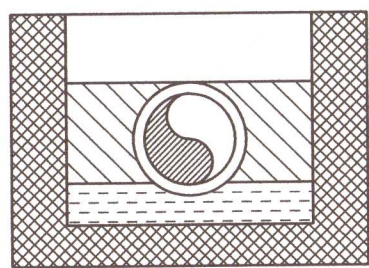

TYPE 3
PIPE BEDDED ON 4" (100 mm) MINIMUM OF LOOSE SOIL, EMBEDMENT LIGHTLY CONSOLIDATED TO TOP OF PIPE
E = 400 psi (2,760 kPa), K = 0.102

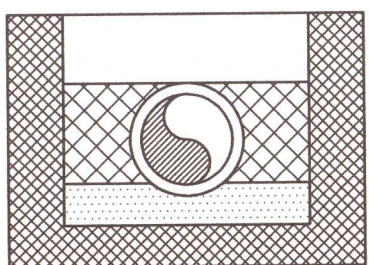

TYPE 4
PIPE BEDDED ON SAND, GRAVEL OR CRUSHED STONE TO DEPTH OF 1/8 PIPE DIAMETER, 4" (100 mm) MINIMUM. EMBEDMENT COMPACTED TO TOP OF PIPE (APPROXIMATELY 80% STANDARD PROCTOR, AASHTO T-99 OR ASTM D 698)
E = 1,000 psi (6,900 kPa), K = 0.096

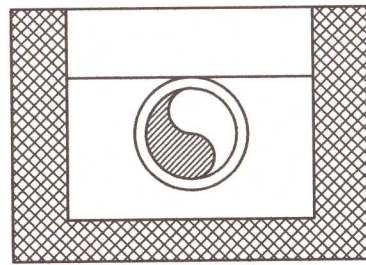


TYPE 5
PIPE EMBEDDED IN COMPACTED GRANULAR MATERIAL TO CENTERLINE OF PIPE. COMPACTED GRANULAR OR SELECT MATERIAL TO TOP OF PIPE (APPROXIMATELY 90% STANDARD PROCTOR, AASHTO T-99 OR ASTM D 698)
E = 2,000 psi (13,800 kPa), K = 0.083

NOTE: REQUIRED EMBEDMENT TYPE WILL DEPEND ON THE PIPE'S DIMENSION RATIO, INTERNAL OPERATING PRESSURE, AND EXTERNAL LOAD, AND SHALL BE SPECIFIED BY THE PURCHASER (SEE SEC. 5.3)


PIPE ENVELOPE REQUIREMENTS

N.T.S. (D-10)

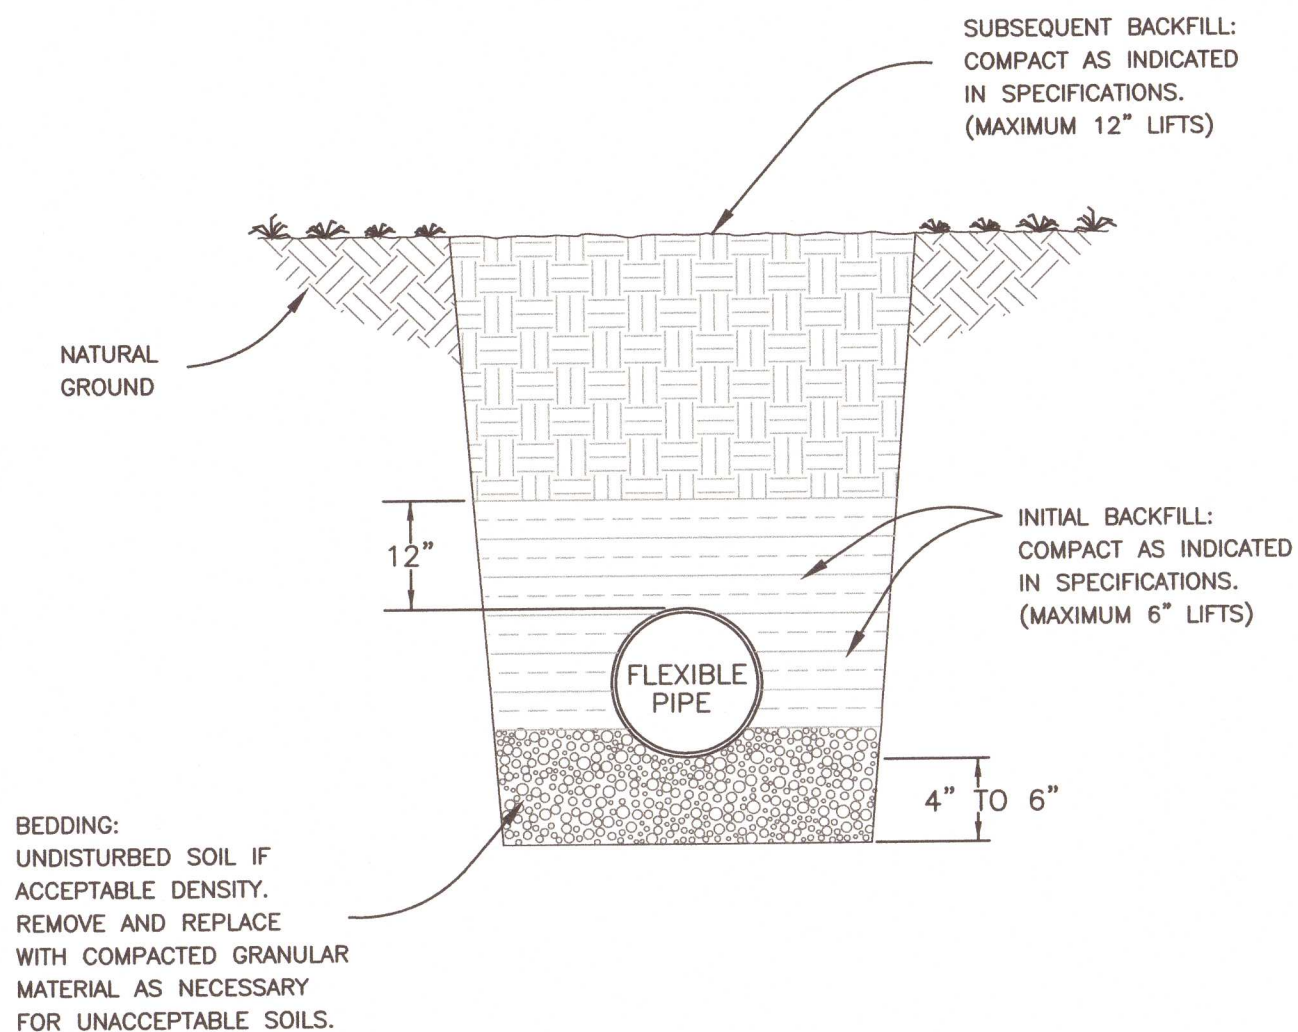


FLEXIBLE PIPE BEDDING

N.T.S. (D-11)

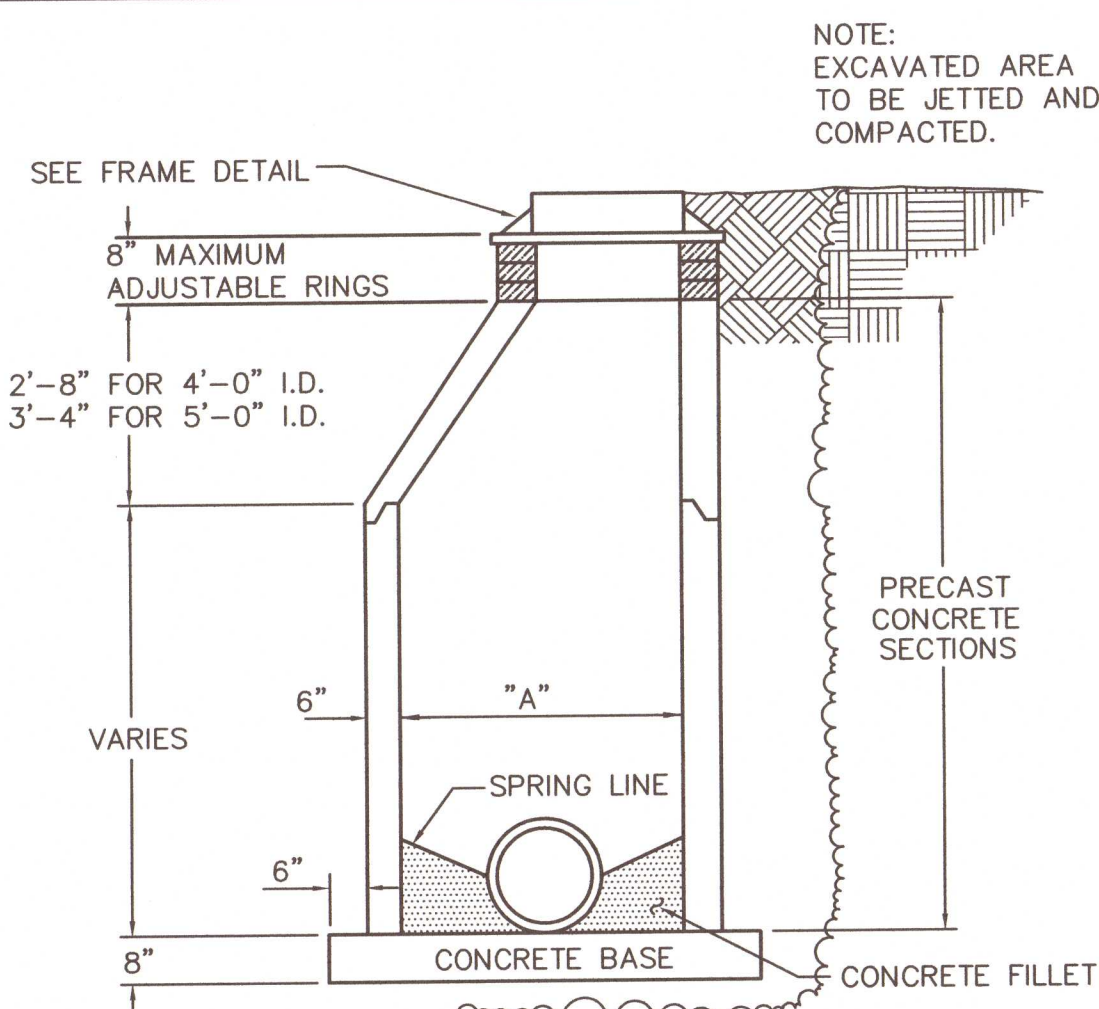


DIAMETER FOR BASE IS 12" LARGER THAN OUTSIDE DIAM. OF M.H. WALLS
NOTE:
"A" DIMENSION =
48" DIAM. FOR 36" DIAM. SEWER AND SMALLER
60" DIAM. FOR 42"-48" DIAM. SEWER.

TYPICAL MANHOLE

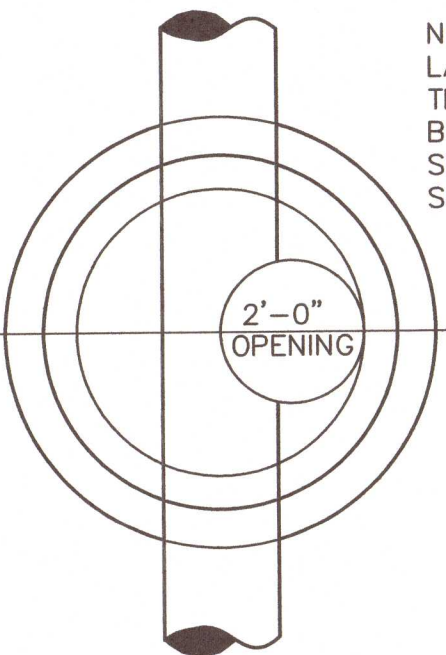

NOTE: LAY SEWER PIPE THROUGH M.H. & BREAK OUT TOP SECTION ABOVE SPRING LINE

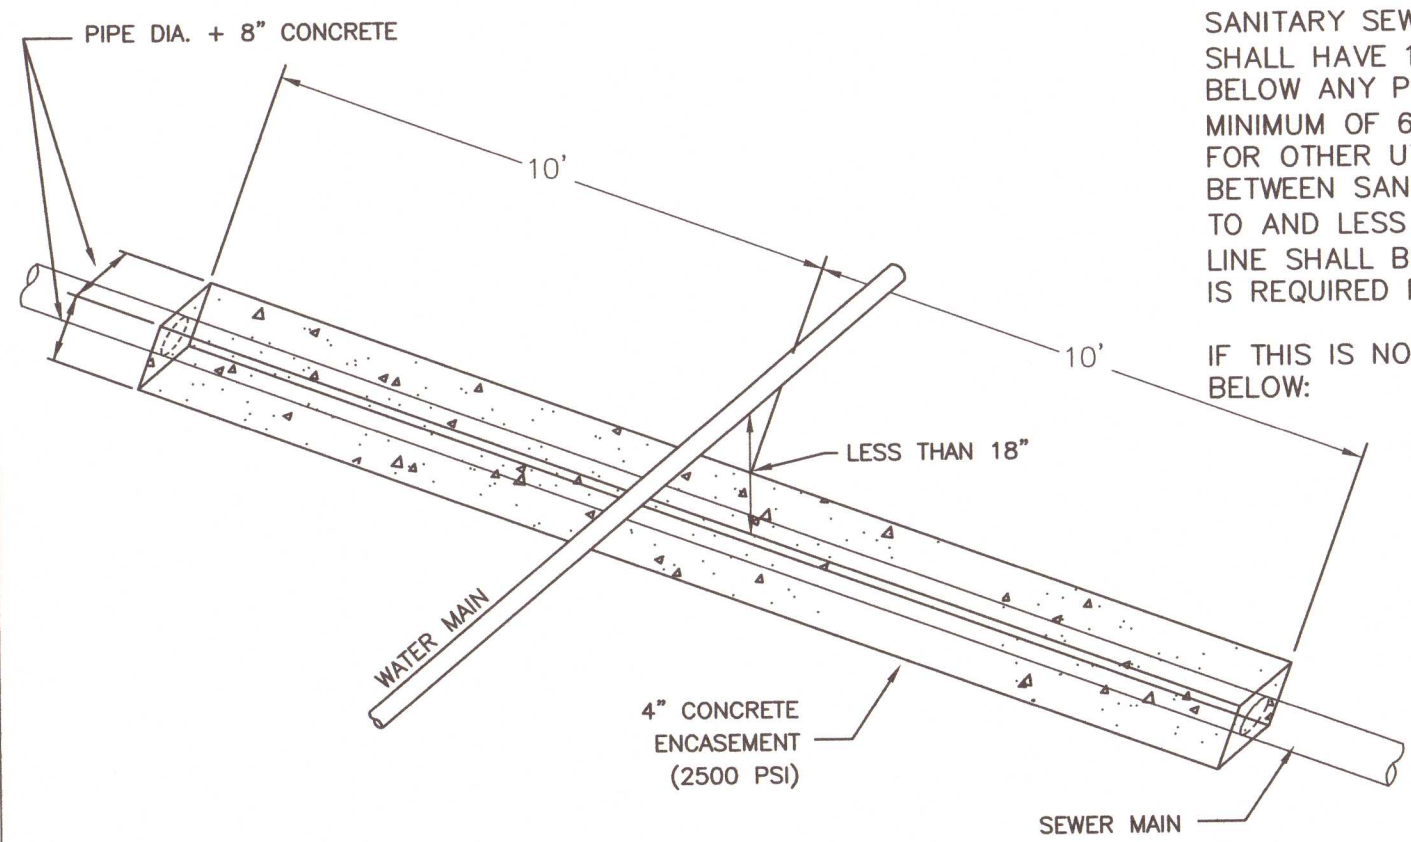

SANITARY SEWER LINES (GRAVITY OR PRESSURE) SHALL HAVE 18" OR GREATER VERTICAL CLEARANCE BELOW ANY POTABLE WATER LINE WHEN CROSSING. A MINIMUM OF 6" VERTICAL CLEARANCE IS REQUIRED FOR OTHER UTILITIES. HORIZONTAL CLEARANCE BETWEEN SANITARY SEWER LINE THAT IS PARALLEL TO AND LESS THAN 18" BELOW A POTABLE WATER LINE SHALL BE 10' OR GREATER. A MINIMUM OF 30" IS REQUIRED FOR OTHER UTILITIES.

IF THIS IS NOT POSSIBLE OR PRACTICAL, SEE NOTES BELOW:

FOR CROSSING: ENCASE AS ABOVE SO THAT THE ENDS OF ENCASEMENT ARE AT LEAST 12' FROM ANY WATER LINE JOINT. WATER LINE JOINT MUST NOT BE CLOSER THAN 5' TO THE POINT OF CROSSING, OR IT MUST ALSO BE ENCASED.


ALTERNATE 1: USE EQUALLY (OR HIGHER) RATED PRESSURE PIPE FOR SEWER WITH NO JOINTS CLOSER THAN 12' APART AND 6" VERTICAL.

ALTERNATE 2: PLACE SEWER LINE INTO STEEL CASING AND CENTER 20' PIECE WITH 4' VERTICAL CLEARANCE AND SEAL ENDS.

FOR PARALLEL: AND 6' TO 10' APART USE ALTERNATE 2, BUT IF MORE THAN 40' IN LENGTH, ALTERNATE 1 MUST BE USED AND JOINTS ARE TO BE STAGGERED. IF LINES MUST BE 3' TO 6' APART, ALTERNATE 1 MUST BE USED WITH A HIGHER RATED PRESSURE PIPE FOR SEWER (i.e., WATER LINE IS DR25 THEN USE DR18 OR 21 FOR SEWER).

SEWER / WATER SEPARATION & CLEARANCES

N.T.S. (D-56)

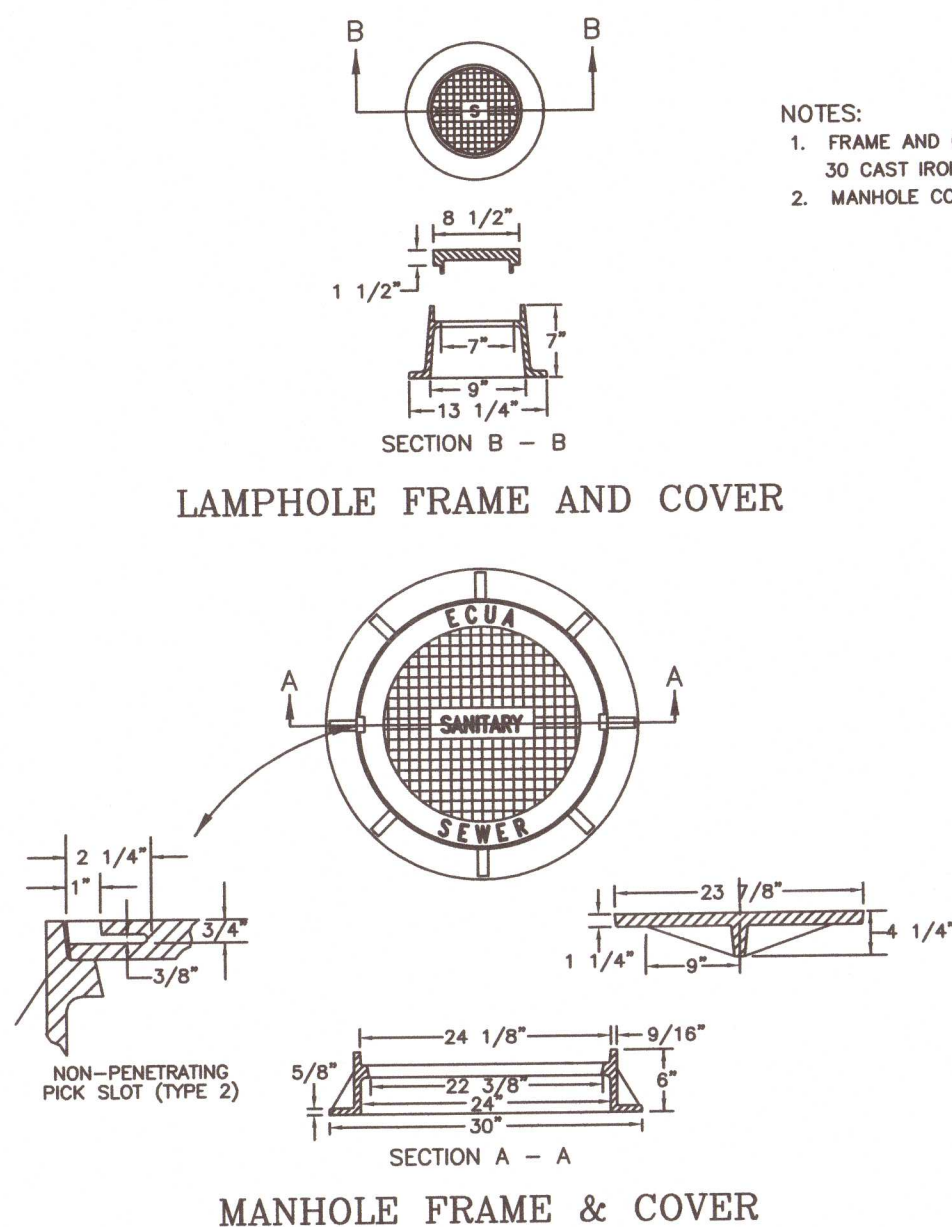


NOTES:

1. FRAME AND COVER SHALL BE VULCAN 1337-2 (ASTM SPEC. A-48, CLASS 30 CAST IRON) OR APPROVED EQUAL. REFER TO SPECIFICATIONS
2. MANHOLE COVER IS TO BE NON-VENTING.

TYPICAL MANHOLE DETAILS

N.T.S. (D-4)

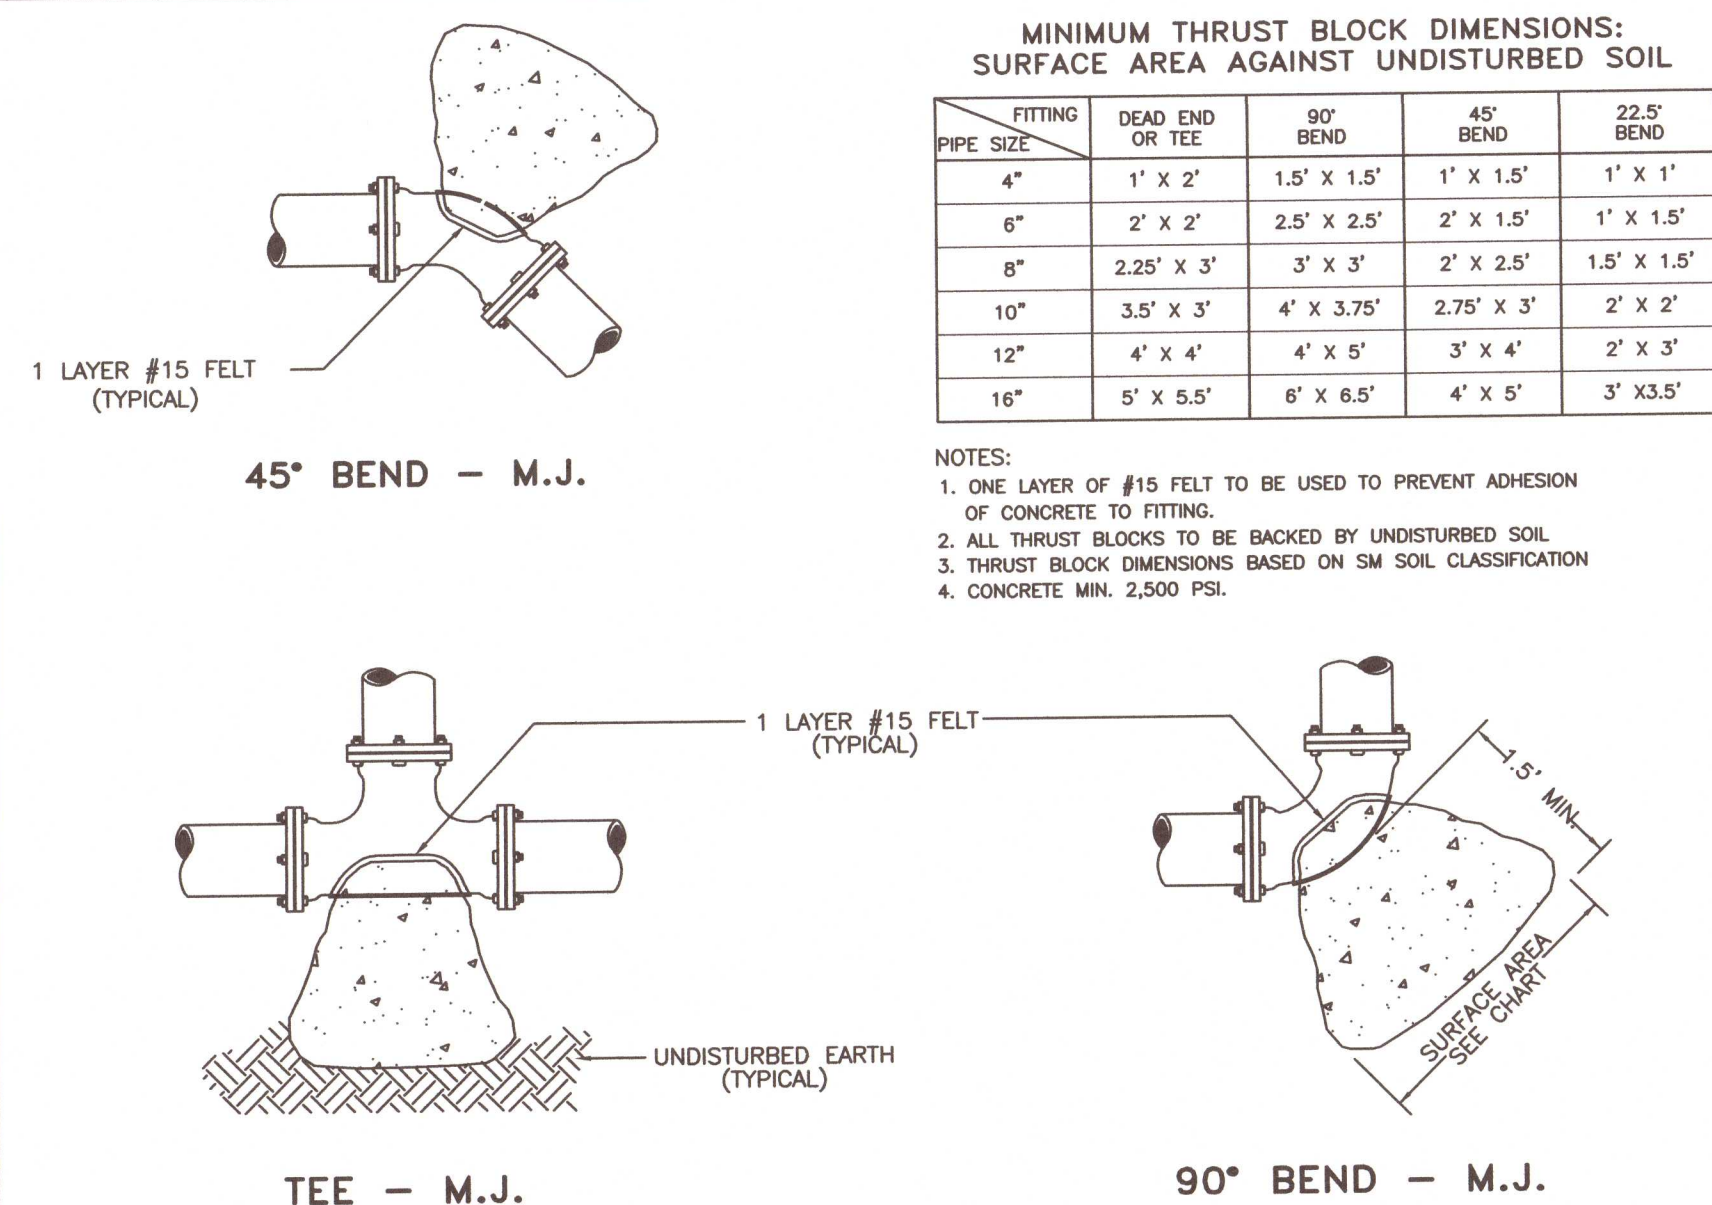


MINIMUM THRUST BLOCK DIMENSIONS: SURFACE AREA AGAINST UNDISTURBED SOIL

FITTING PIPE SIZE	DEAD END OR TEE	90° BEND	45° BEND	22.5° BEND
4"	1' X 2'	1.5' X 1.5'	1' X 1.5'	1' X 1'
6"	2' X 2'	2.5' X 2.5'	2' X 1.5'	1' X 1.5'
8"	2.25' X 3'	3' X 3'	2' X 2.5'	1.5' X 1.5'
10"	3.5' X 3'	4' X 3.75'	2.75' X 3'	2' X 2'
12"	4' X 4'	4' X 5'	3' X 4'	2' X 3'
16"	5' X 5.5'	6' X 6.5'	4' X 5'	3' X 3.5'

NOTES:

1. ONE LAYER OF #15 FELT TO BE USED TO PREVENT ADHESION OF CONCRETE TO FITTING.
2. ALL THRUST BLOCKS TO BE BACKED BY UNDISTURBED SOIL.
3. THRUST BLOCK DIMENSIONS BASED ON SM SOIL CLASSIFICATION
4. CONCRETE MIN. 2,500 PSI.

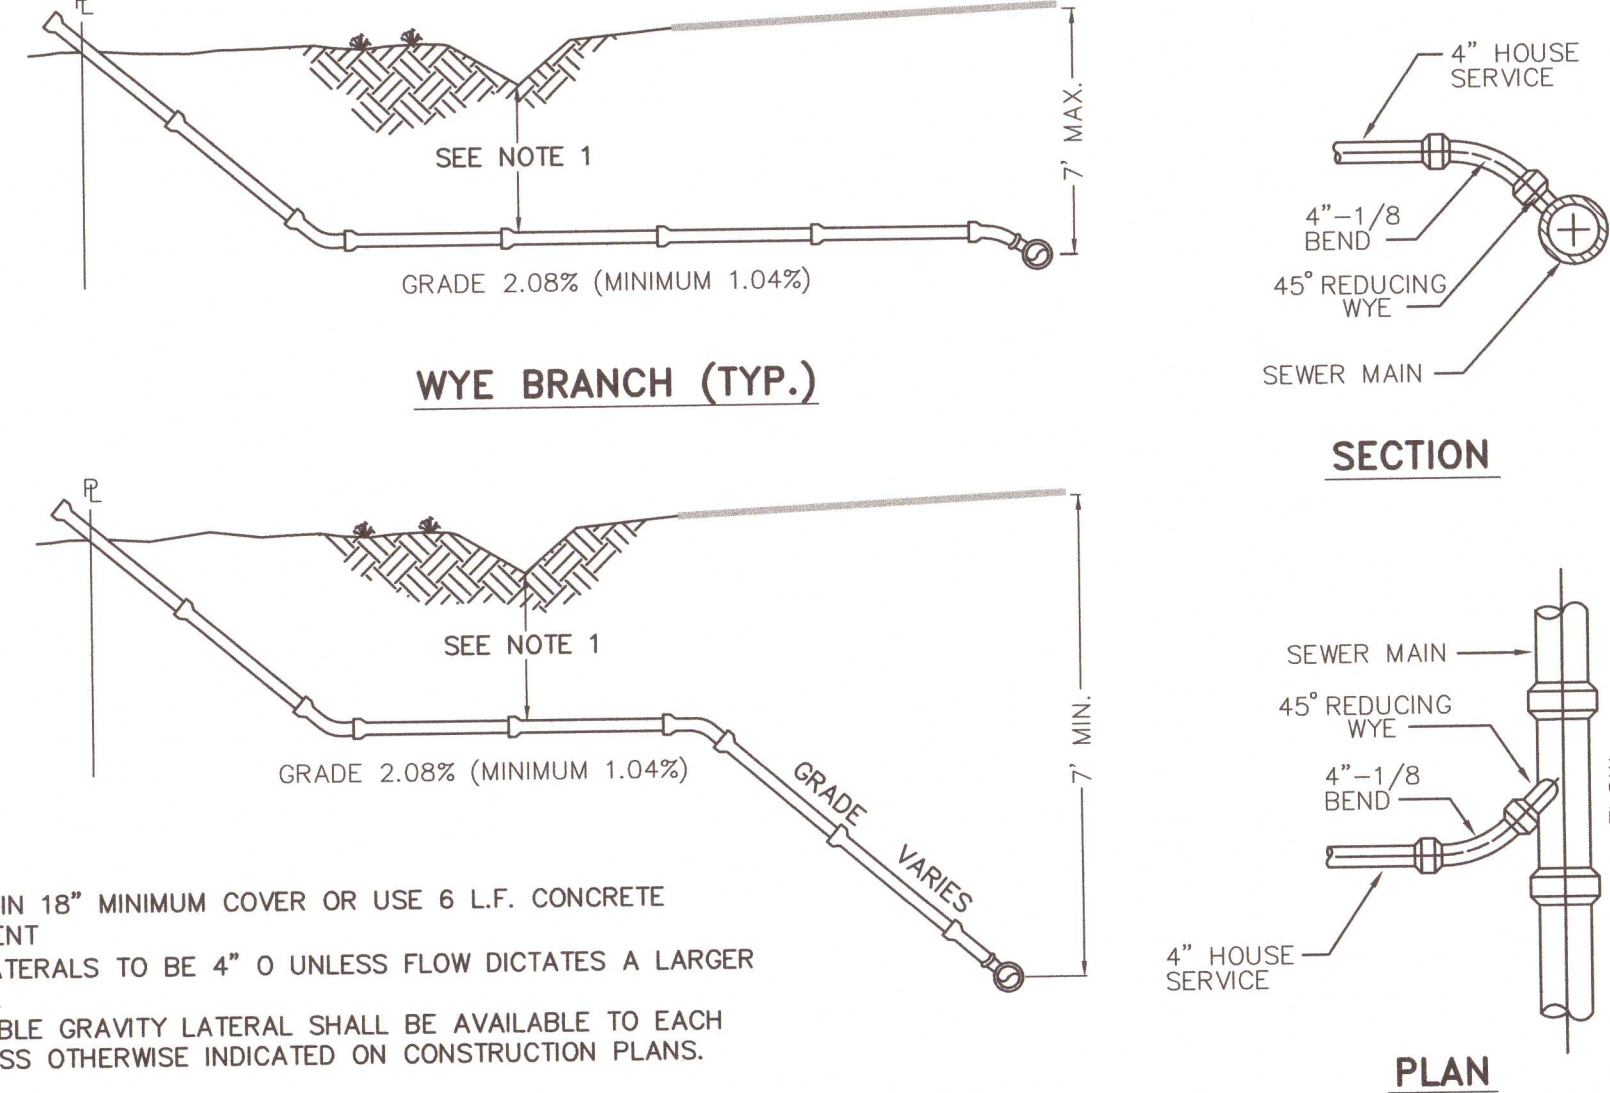


NOTES:

1. MAINTAIN 18" MINIMUM COVER OR USE 6 L.F. CONCRETE ENCASEMENT
2. ALL LATERALS TO BE 4" O UNLESS FLOW DICTATES A LARGER DIAMETER.
3. A USABLE GRAVITY LATERAL SHALL BE AVAILABLE TO EACH LOT UNLESS OTHERWISE INDICATED ON CONSTRUCTION PLANS.

TYPICAL LATERAL SEWER CONNECTION

N.T.S. (D-7)

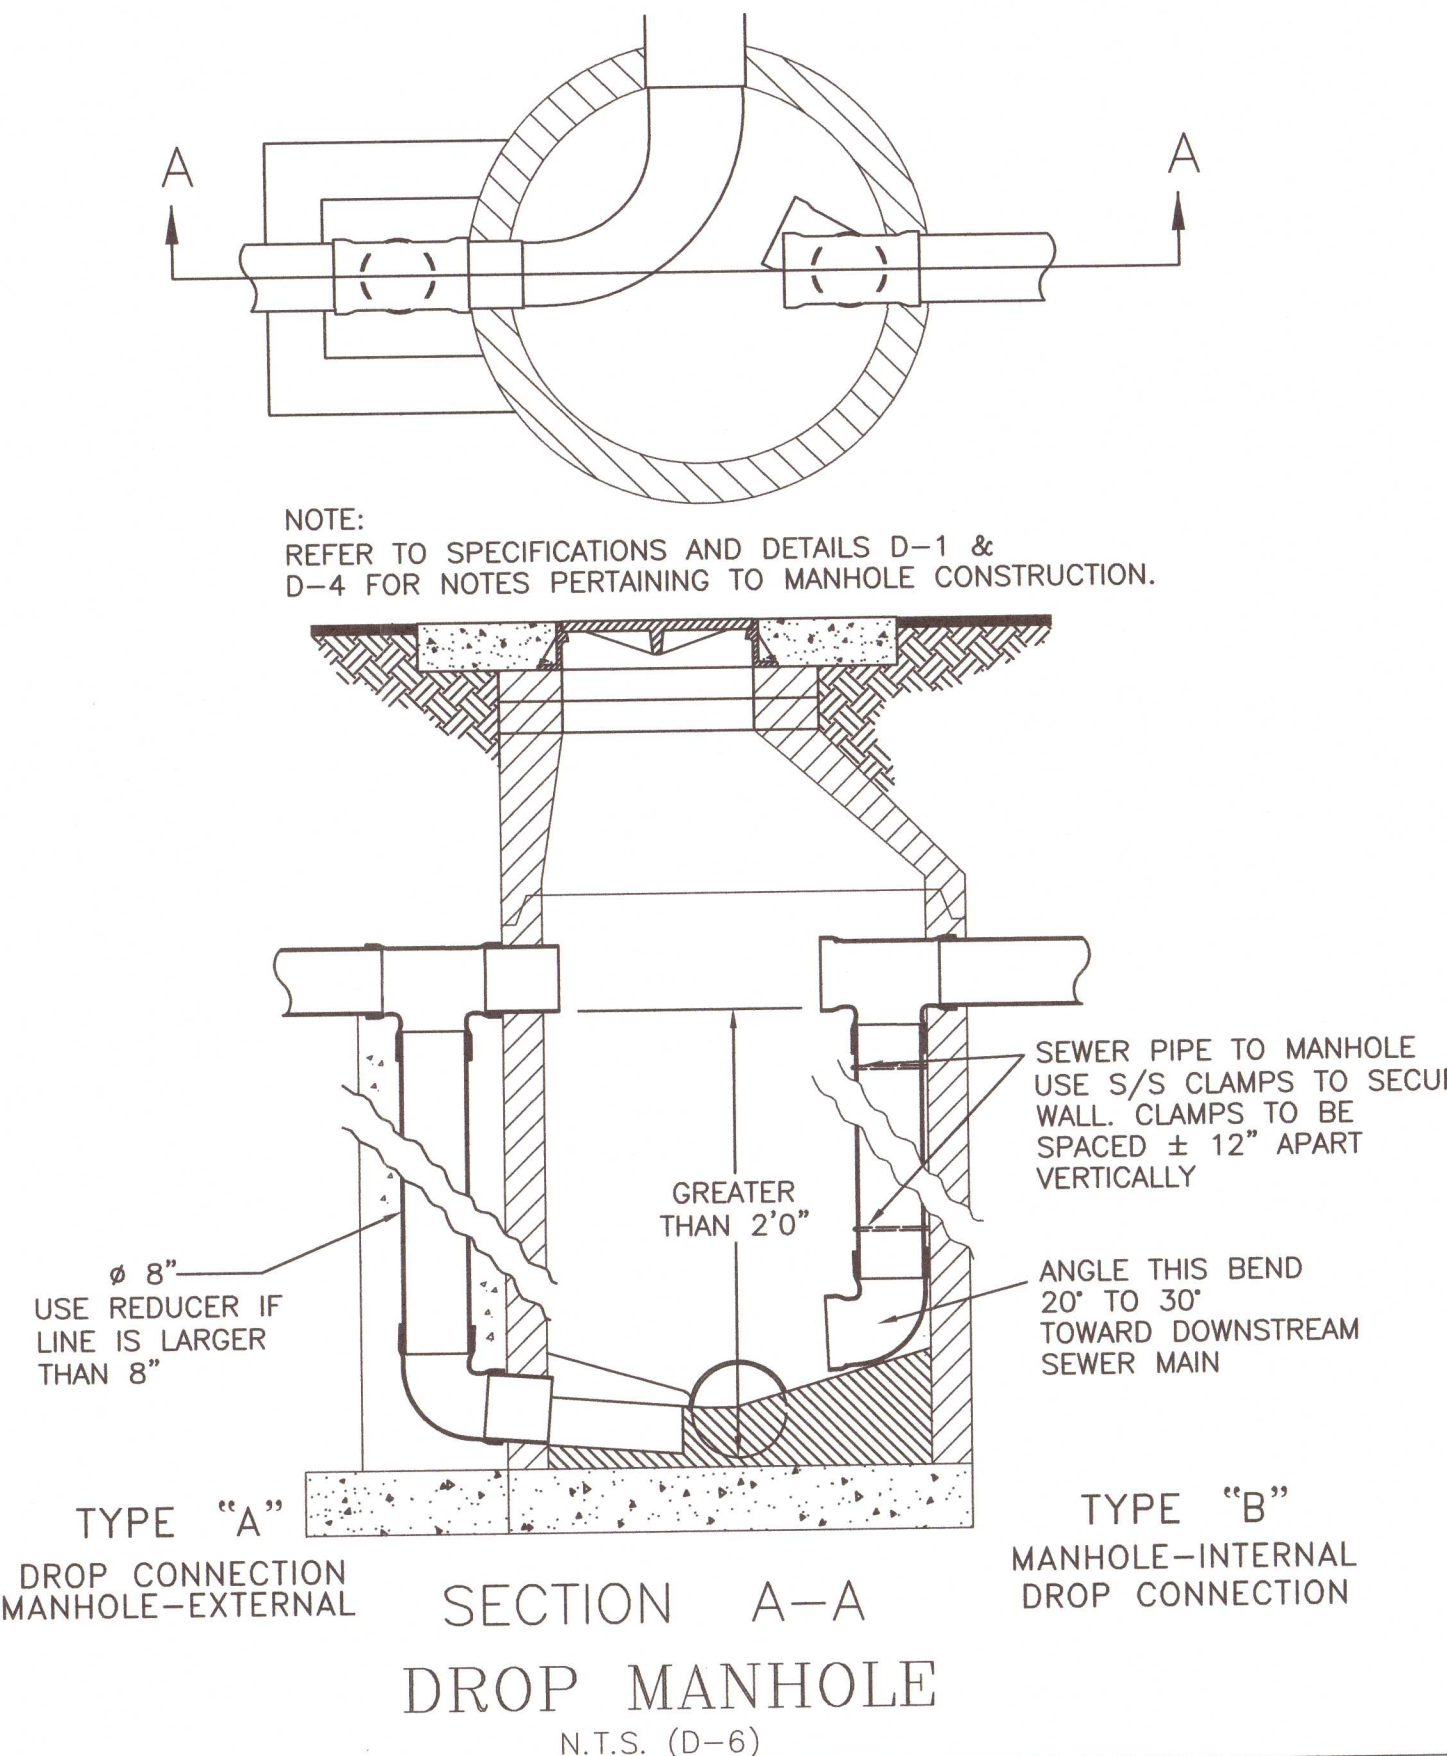

PIPE JOINT RESTRAINT TABULATION

SHOWING DISTANCES IN FEET FROM THE FITTING TO BE RESTRAINED TO THE LAST RESTRAINING GLAND REQUIRED

PIPE SIZE AND TYPE	HORIZONTAL BENDS				DEAD ENDS	EQUAL TEES See note 3
	90 Deg.	45 Deg.	22.5 Deg.	11.25 Deg.		
3" DI	18	8	4	2	33	1
4" DI	22	9	4	2	39	1
6" DI	31	13	6	3	55	1
8" DI	40	17	8	4	72	1
10" DI	48	20	9	5	86	1
12" DI	56	23	11	5	101	1
16" DI	70	29	14	7	129	1
20" DI	84	35	17	8	156	18
24" DI	96	40	19	9	181	41
4" PVC	28	12	6	3	62	1
6" PVC	39	16	8	4	87	1
8" PVC	50	21	10	5	114	1
10" PVC	60	25	12	6	136	1
12" PVC	70	29	14	7	160	1
16" PVC	88	36	17	9	205	1
20" PVC	105	43	21	10	247	29
24" PVC	120	50	24	12	287	64

NOTES :

1. Test pressure = 150 psi, soil group = SM, trench type = 3, depth = 2.5', safety factor = 1.5
2. Restrained lengths for vertical offsets, reducers & unequal size tees must be individually calculated.
3. With equal tees, the distances shown are with a run length of 40' as an example only. For other lengths and for unequal tees, individual calculations must be made.

PIPE JOINT RESTRAINT TABULATION

N.T.S. (D-44)

CHOCTAW ENGINEERING, INC.
ENGINEERING • ENVIRONMENTAL • SURVEYING
112 TRUXTON AVENUE
FORT WALTON BEACH, FLORIDA 32547
PHONE: 850-862-6611
FAX: 850-863-8059
EMAIL: ce@choctaweng.com

CEI

Revisions:

16 VIA DE LUNA HOTEL
PENSACOLA BEACH
ECUA WATER-SEWER DETAILS
Not valid unless bearing Engineer's embossed seal.

MARK C. SNER, P.E.
FL. REG. NO. 46651

THIS SHEET IS THE PROPERTY OF CEI & IS NOT TO BE REPRODUCED WITHOUT WRITTEN CONSENT FROM CEI.

Job No.: 2017-161-B
Date: 4 MAY 2021
Fld. Vol.: N/A
Scale: N/A
Disk No.: 17161B-MISC
Designed: MCS
Drawn: CRG
Checked: MCS
Sheet
10 of 12

SPECIFICATION: CLEARING AND GRUBBING

All site Clearing and Grubbing shall be in accordance with section 110 of the "Florida Department of Transportation Specifications for Road and Bridge Construction" unless modified herein. This work shall be performed in the following areas:

- A. All street rights-of-way.
- B. All areas where excavation or embankment are to take place.
- C. Detention areas.

In addition, certain other areas where underground utilities are to be installed are to be cleared and grubbed to the extent necessary to properly install the utilities. Such work shall be incidental to the contract unit price for the utility to be installed.

SCOPE: Site clearing work includes, but is not limited to:

- A. Removal of trees and other vegetation.
- B. Topsoil stripping.
- C. Clearing and grubbing.
- D. Removing above grade improvements.
- E. Removing below grade improvements.

JOB CONDITIONS:

Traffic:
Conduct site clearing operations to ensure minimum interference with roads, streets, walks, and other adjacent occupied or used facilities. Do not close or obstruct streets, walks, or other occupied or used facilities without permission from the Owners and or Local approving authority.

Clearing and Protection in Construction Areas:
Preserve trees 6 inches or larger measured breast height (6"dbh) where possible within construction area.

Protection of Existing Improvements:
Provide protection necessary to prevent damage to existing improvements indicated to remain in place.

Protect improvements on adjoining properties and on project site.

Restore damaged improvements to original condition as acceptable to the Owner.

LIMITATIONS:

Clearing will be limited to the extent necessary to allow for construction of the proposed improvements as a result of:

- Need for access to the project site for construction equipment.
- Essential grade changes.
- Surface water drainage and utility installation.
- Location of driveways, buildings, and required parking.

CLEARING AND GRUBBING:

Remove trees, shrubs, grass, other vegetation, improvements, or obstructions interfering with the installation of new construction. Removal includes digging out stumps and roots. Do not remove items elsewhere on site or premises unless specifically indicated. Disposal of trees, limbs, stumps, and debris shall be the responsibility of the Contractor.

Strip topsoil to whatever depths encountered to prevent intermingling with underlying subsoil or other objectionable material. Cut heavy growths of grass from areas before stripping.

Stockpile topsoil in storage piles in areas shown or where directed by the Owner. Construct storage piles to freely drain surface water. Cover storage piles if required to prevent windblown dust.

Dispose of unsuitable or excess topsoil same as specified for waste material.

FILLING:

Fill depressions caused by clearing and grubbing operations with satisfactory soil material, unless further excavation or earthwork is indicated.

Place fill material in horizontal layers not exceeding 6" loose depth, and thoroughly compact to density equal to adjacent ground, unless otherwise shown on the plans.

REMOVAL OF IMPROVEMENTS:

Remove existing above and below grade improvements and abandoned underground piping or conduit necessary to permit construction and other work.

DISPOSAL OF WASTE MATERIALS:

No burning of any material, debris, or trash will be allowed.

Remove waste materials from project site on a daily basis and dispose of off-site in an approved area.

SPECIFICATION: EXCAVATION, EMBANKMENT AND SUBGRADE:

EXCAVATION, EMBANKMENT AND SUBGRADE: Shall be performed in accordance with Section 120 of the Florida D.O.T. Specifications. All subgrade fill material, and the top 12 inches in cut area, shall be compacted to 100 percent of maximum density as determined by AASHTO T-99. The Subgrade Compaction (Stabilization) shall conform to Section 160 of the Florida D.O.T. Specifications. In most cases this will consist of compacting existing cleaned soil. However, it is the contractor's responsibility to assure that the finished roadbed section meets bearing value requirements, regardless of the quantity of stabilizing materials to be added. One field density test shall be taken for each 5000 square feet or fraction thereof.

Where required subgrade density cannot be obtained, unsuitable material shall be removed so that the road base will be constructed on a minimum of 3 feet of suitable, properly compacted material. This work shall be included in the contract lump sum price for earth excavation.

SOIL CEMENT BASE: As a minimum the soil cement base course will conform generally to Section 270 of the Florida D.O.T. Specifications for Road and Bridge Construction. The detailed specifications of the soil cement base course are to be determined by an independent testing laboratory after testing of the material the contractor proposes to use. Moisture and cement content will be specified by the laboratory. However, as a guide for bid purposes, estimate 12% cement by weight and include a price reduction schedule if tests show less cement is required. The soil cement mix will be at optimum moisture content, i.e., neither mushy nor dry, but containing sufficient moisture to make a firm case when squeezed in the hand. Water should not appear on the hand when so squeezed. This requires 5 to 6 gallons per square yard but actual quantity of water to be added will depend on latent moisture in the base material. From a practical standpoint the highest moisture content should be maintained that permits packing and finishing without surface checking, shoving or rutting during compaction and finishing operations.

The freshly compacted and finished soil-cement mix must be adequately cured. An application of bituminous material such as RC-2, MC-3, RT-5 or asphaltic emulsion at the rate of 0.15 to 0.20 gal per square yard is preferred as the curing medium. Waterproof paper or moist hay is acceptable if properly maintained.

SAND-CLAY BASE COURSE: Shall comply with the requirements of Sections 240 and 912 of the Florida D.O.T. Specifications. Tests necessary to determine compliance with Section 912 shall be performed prior to placing the material on the roadbed. These tests include:

1. Composition and gradation.	Percent of material passing the 10-mesh sieve
Clay (material smaller than 0.005mm)	8 to 21
Silt (material from 0.005 to 0.005mm)	0 TO 10
Combined clay and silt	0 to 25
2. Limerock Bearing Ratio Value(LBR)	at least 75
3. Liquid Limit	Not greater than 25
4. Plasticity Index	Not greater than 6

The results of these tests shall be submitted to the engineer for approval. After approval of the material, the sand-clay base course shall be placed in accordance with Section 240. The base course shall be compacted to not less than 98 percent of the maximum density as determined by AASHTO T-180. One density test shall be taken for each 5000 square feet or fraction thereof.

NOTE: Sand Clay base material shall not be used in areas where the seasonal high groundwater table is within two (2) feet of the bottom of the base material.

LIMEROCK BASE COURSE: Shall be constructed in accordance with Section 200 of the Florida D.O.T. Specifications for Road and Bridge Construction. The material shall meet the requirements of Section 911 of the Specifications. Tests necessary to determine compliance with Section 911 shall be performed prior to placing the material on the subgrade. These tests include:

Test	Requirement
1. Liquid Limit	Less than 35
2. Plastic Index	Non-Plastic
3. Gradation	97% passing 3.5 inch sieve
4. Limerock Bearing Ratio	Not less than 100

The results of these tests shall be submitted to the engineer for approval. After approval of the material, the limerock base course shall be placed in accordance with Section 200. The base course shall be compacted to not less than 98 percent of the maximum density as determined by AASHTO T-180. A minimum of three density tests shall be made on each day's compaction operations. More frequent tests shall be made as deemed necessary by the Engineer. The base shall be installed to a compacted thickness as shown on the plans, plus or minus one half inch. Deviations from this specification shall be corrected as indicated in the State Specifications.

CONTINUED ON NEXT COLUMN

GRADED AGGREGATE BASE COURSE: Shall comply with the requirements of Section 204 of the Florida D.O.T. Specifications. Tests necessary to determine compliance with Section 204 shall be performed prior to placing the material. These tests include:

- 1. Soundness Loss, Sodium, Sulfate: AASHTO T 104.
- 2. Percent Wear: AASHTO T 96 (Grading A).
- 3. Sieve Analysis.
- 4. Limerock Bearing Ratio Value.

The results of these tests shall be submitted to the engineer for approval. After the approval of the material, the graded aggregate base course shall be placed in accordance with Section 204. The base course shall be compacted to a density of not less than 100 percent of the maximum density as determined by AASHTO T 180. At least three density tests shall be made on each day's final compaction operation of each course, and the density determinations shall be made at more frequent intervals if deemed necessary by the Engineer.

ASPHALT BASE COURSE: Shall comply with the requirements of Sections 280, 330, 331 and 916 of the Florida D.O.T. Specifications. The design mix for Asphaltic Base Course Type 3 shall conform to the requirements in Tables 331-1 and 331-2. The Minimum Marshall stability shall be 1000 lbs./sq. in. as indicated in Table 331-2. Percent bitumen by weight of total mix: 5.0 (minimum). Two copies each of the actual design mix shall be submitted to the Engineer. Written approval of the Asphalt base course design mix must be obtained from the engineer prior to commencing base course construction. Once the design mix has been approved by the engineer, sieve analysis tolerances indicated in Table 331-5 are allowable during construction. If sieve analysis values fall outside these tolerances, design mix must be resubmitted for acceptance. After the approval of the mix design, the Asphalt base course shall be placed in accordance with Section 280 and compacted in accordance with Section 330-10.

NOTE: STORMWATER DRAINAGE SHALL BE CONTROLLED DURING ALL PHASES OF CONSTRUCTION.

SPECIFICATION: ASPHALT CONCRETE PAVING

SCOPE: This section includes materials and work required for installation of flexible asphaltic concrete pavement for parking and drive areas shown on the plans.

APPLICABLE PUBLICATIONS: The publications listed below form a part of this specification to the extent referenced. The publications shall be the most current issue and are referred to in the text by the basic designation only. The following are minimum requirements and shall govern except that all local, state, and/or federal codes and ordinances shall govern when their requirements are in excess hereof. All asphalt construction shall be in accordance with applicable sections of the "Florida Department of Transportation Specifications for Road and Bridge Construction" unless modified herein.

A. Florida Department of Transportation Specifications:

Section 901	Course Aggregate
Section 902	Fine Aggregate
Section 916	Bituminous Materials
Section 917	Mineral Filler
Section 300	Bituminous Treatments, Surface Courses and Concrete Pavement
Section 331	Type S Asphalt Concrete

B. American Society for Testing and Materials (ASTM) Publications:

D 1557	Moisture-Density Relations of Soils and Soil-Aggregate Mixtures Using 10 lb (4.54 kg) Rammer and 18-in. (457 mm) Drop.
D 1559	Marshall Stability Mix Design

SUBMITTALS:

- A. Asphalt Design Mix:
 - 1. Before any asphalt surface is constructed, submit two copies of each of the actual design mix to the Engineer and Owner.
 - 2. Written approval of the asphaltic concrete design mix must be obtained from the Engineer and Owner prior to commencing asphalt pavement construction.
- B. Material Certificates: Furnish copies of materials certificates signed by material producer and Contractor, certifying that each material item complies with, or exceeds specified requirements.
- C. Asphalt extraction tests.
- D. Aggregate gradation tests.
- E. Marshall stability tests.

JOB CONDITIONS:

- A. Weather limitations: Apply prime and tack coats when ambient temperature is above 40 degrees, and when temperature has not been below 35 degrees for 12 hours prior to application. Do not apply when base is wet or contains excess moisture.

MATERIALS:

- A. Mineral Filler: Rock dust, hydraulic cement, or other inert material complying with section 917 of the Florida DOT Specifications.
- B. Asphalt Cement: The bituminous material shall be AC-20, viscosity grade and comply with section 916 of the Florida DOT Specifications.
- C. Course Aggregate: Comply with section 901 of the Florida DOT Specifications.
- D. Fine Aggregate: Comply with section 902 of the Florida DOT Specifications.
- E. Prime Coat and Tack Coat: The bituminous material for the Prime Coat shall be MC-70. The bituminous material for the Tack Coat shall be AC-20, or Emulsified asphalt, grade RS-2 and comply with the requirements in Section 300 and 916 of the Florida DOT Specifications.
- F. Asphaltic Concrete Design Mixes:
 - 1. Asphalt shall conform to the requirements for Type S Asphalt as indicated in Section 331 of the Florida DOT Specifications.
 - 2. Mix shall be within sieve analysis and bitumen range given in Section 331 of the Florida DOT Specifications.
 - 3. Minimum Marshall stability shall be in 1500 lbs./sq. in. as indicated in Table 331-2 of the Florida DOT Specifications.
 - 4. Percent bitumen by weight of total weight mix: 5.0 - 8.5.
 - 5. Once design mix has been accepted by Engineer and Owner, sieve analysis tolerances indicated in Table 331-5 are allowable during construction. If sieve analysis analysis values fall outside these tolerances, design mix must be resubmitted for acceptance.
 - 6. Provide asphalt-aggregate mixture as recommended by local or state paving authorities to suit project conditions. Use locally available materials and gradations which meet Florida DOT Specifications and exhibit satisfactory record on previous installations.

- A. Prior to construction of the base course, the top 12 inches of subgrade shall be compacted to a minimum soil density of 98% of the Modified Proctor Test Density (ASTM 1557). The subgrade shall be sterilized by a borate or chlorate sterilant containing not less than 25% sodium chlorate and shall be mixed thoroughly with water at the rate of 1-1/2 lbs. of sterilant per gallon of water. The sterilant shall be applied evenly at the rate of 0.2 gallons per square yard to subgrades that are less than 12" below original grades. If prepared base course will not be immediately covered with asphalt on the same day and wind-blown seeds will contaminate the base course surface, the sterilants shall be applied to the base course contaminate the base course.
- B. Remove loose material from compacted base material surface immediately before applying prime coat.
- C. Proof roll prepared base material surface to ensure unstable areas have been corrected and are ready to receive paving.

BASE COURSE PREPARATION:

- A. Prior to construction of the base course, the top 12 inches of subgrade shall be compacted to a minimum soil density of 98% of the Modified Proctor Test Density (ASTM 1557). The subgrade shall be sterilized by a borate or chlorate sterilant containing not less than 25% sodium chlorate and shall be mixed thoroughly with water at the rate of 1-1/2 lbs. of sterilant per gallon of water. The sterilant shall be applied evenly at the rate of 0.2 gallons per square yard to subgrades that are less than 12" below original grades. If prepared base course will not be immediately covered with asphalt on the same day and wind-blown seeds will contaminate the base course surface, the sterilants shall be applied to the base course contaminate the base course.
- B. Remove loose material from compacted base material surface immediately before applying prime coat.
- C. Proof roll prepared base material surface to ensure unstable areas have been corrected and are ready to receive paving.

CONTINUED ON NEXT COLUMN

D. Prime Coat:

- 1. Apply bituminous prime coat to base material surfaces where asphaltic concrete paving will be constructed.
- 2. Apply bituminous prime coat in accordance with Section 300 of Florida DOT Specifications.
- 3. Apply at minimum rate of not less than 0.15 gal./sq. yd. over compacted base material. Apply material to penetrate and seal, but not flood, surface.
- 4. Cure and dry as long as necessary to attain penetration and evaporation of volatile.

E. Tack Coat:

- 1. Tack coat shall be applied in accordance with Section 300 of Florida DOT Specifications. Apply to contact surfaces of previously constructed asphalt or portland cement and concrete and surfaces abutting or projecting into asphalt concrete pavement.
- 2. Apply tack coat to full depth asphalt base course and sand asphalt base course. Apply emulsified asphalt tack coat between each lift or layer of full depth asphalt and sand asphalt bases and on surface of such bases where asphaltic concrete paving will be constructed.
- 3. Distribute at rate of 0.08 gal./sq. yd. of surface.
- 4. Allow to dry until at proper condition to receive paving.

PLACING ASPHALT MIX:

A. Place asphalt concrete mixture on prepared surface, spread, and strike off. Spread mixture at the following minimum temperatures:

- 1. When ambient temperature is between 40 degrees F and 50 degrees F: 285 degrees F.
- 2. When ambient temperature is between 50 degrees F and 60 degrees F: 280 degrees F.
- 3. When ambient temperature is higher than 60 degrees F: 275 degrees F.

B. Place inaccessible and small areas by hand. Place each course to required grade, cross-section, and compacted thickness.

C. Paver Placing:

- 1. Place in strips not less than 10'-0" wide, unless otherwise acceptable to the Contracting Officer.
- 2. After first strip has been placed and rolled, place succeeding strips and extend rolling to overlap previous strips.

D. Joints:

- 1. Construct joints between old and new pavements as detailed in the plans.
- 2. Joints between successive days' work shall be constructed to ensure continuous bond between adjoining work.
- 3. Construct joints to have same texture, density, and smoothness as other sections of asphalt concrete course.
- 4. Clean contact surfaces and apply tack coat.

COMPACTION:

- A. Each lift of asphalt shall be compacted to a minimum of 98% of the Marshall test ASTM D1559).
- B. Begin rolling when mixture will bear roller weight without excessive displacement.
- C. Compact mixture with hot hand tampers or vibrating plate compactors in areas inaccessible to rollers.
- D. Breakdown Rolling:
 - 1. Accomplish breakdown or initial rolling immediately following rolling of joints and outside edge.
 - 2. Check surface after breakdown rolling, and repair displaced areas by loosening and filling, if required, with hot material.

E. Second Rolling:

- 1. Follow breakdown rolling as soon as possible, while mixture is hot.
- 2. Continue second rolling until mixture has been thoroughly compacted.

F. Finish Rolling:

- 1. Perform finish rolling while mixture is still warm enough for removal of roller marks.
- 2. Continue rolling until roller marks are eliminated and course has attained maximum density.

G. Patching:

- 1. Remove and replace paving areas mixed with foreign materials and defective areas.
- 2. Cut out such areas and fill with fresh, hot asphalt concrete.
- 3. Compact by rolling to maximum surface density and smoothness.

H. Protection:

- 1. After final rolling, do not permit vehicular traffic on pavement until it has cooled and hardened.
- l. Erect barricades to protect paving from traffic until mixture has cooled enough not to become marked.

FIELD QUALITY CONTROL:

- A. An Independent Testing Laboratory, selected and paid by the contractor shall be retained to perform construction testing of in-place asphalt courses for Asphalt Extraction, Aggregate gradation, Marshall Stability, thickness and surface smoothness.
- B. Thickness: In-place compacted thickness shall not be less than thickness specified on the drawings.
- C. Surface Smoothness: Testing shall be performed on the finished surface of each asphalt concrete course for smoothness, using 10'-0" straightedge applied parallel with, and at right angles to centerline of paved area. The variation of the surface from the edge of the straight edge between any two contact points shall not exceed 1/4". Check surface areas at intervals necessary to eliminate ponding areas. Repair or remove and replace unacceptable paving as directed by the Contracting Officer.
- D. Asphalt content, Aggregate gradation, and Marshall Stability shall be as specified in Section 331 of the Florida DOT Specifications.

SPECIFICATION: PORTLAND CEMENT CONCRETE PAVING

SCOPE: This section includes sidewalks, curbs, and miscellaneous concrete pavement.

APPLICABLE PUBLICATIONS: The publications listed below form a part of this specification to the extent referenced. The publications shall be the most current issue and are referred to in the text by the basic designation only. The following are minimum requirements and shall govern except that all local, state, and/or federal codes and ordinances shall govern when their requirements are in excess hereof. All concrete construction shall be in accordance with applicable sections of the "Florida Department of Transportation Specifications for Road and Bridge Construction" unless modified herein.

A. Florida Department of Transportation Specifications:

Section 345	Portland Cement Concrete
Section 350	Cement Concrete Pavement
Section 520	Concrete Gutter, Curb Elements and Traffic Separator
Section 931	Metal Accessory Materials for Concrete Pavement and Concrete Structures

B. American Society for Testing and Materials (ASTM) Publications:

A 615	Deformed and Plain Billet Steel Bars for Concrete Reinforcement
D 1557	Moisture-Density Relations of Soils and Soil-Aggregate Mixtures Using 10-lb. (4.54 kg) Rammer and 18-in. (457 mm) Drop.
D 1751	Preformed Expansion Joint Filler for Concrete Paving and Structural Construction. (Nonextruding and Resilient Bituminous Types)

SUBMITTALS:

A. Material Certifications: Furnish copies of materials certificates signed by material producer and Contractor, certifying that each material item complies with, or exceeds, specified requirements.

MATERIALS:

A. Forms:

- 1. Steel, wood, or other suitable material of size and strength to retain horizontal and vertical alignment until removal. Use straight forms, free of distortion and defects.
- 2. Use flexible spring steel forms or laminated boards to form radius bends as required.

B. Form Release Agent:

- 1. Coat forms with nonstaining type coating that will not discolor or deface surface of concrete.

C. Welded Wire Mesh:

- 1. Welded plain cold-drawn steel wire fabric. Furnish in flat sheets, not rolls, unless otherwise acceptable to Contracting Officer. Welded wire mesh shall be free from rust, dirt, foreign matter and shall not be stored directly on the ground. Wire fabric shall comply with Sections 931 of the Florida DOT Specifications.

D. Reinforcing Bars:

- 1. Deformed steel bars, ASTM A 615, Grade 40. Reinforcing bars shall be free from rust, dirt, foreign matter and shall not be stored directly on the ground. Deformed steel bars shall comply with Section 931 of the Florida DOT Specifications.

E. Concrete Materials:

- 1. Comply with requirements of Sections 345 and 350 of the Florida DOT Specifications for concrete materials, admixture, bonding materials, curing materials, and others as required.

F. Joint Fillers:

- 1. Resilient preformed bituminous impregnated fiberboard units complying with ASTM D1751. Joint fillers shall comply with Section 932 of the Florida DOT Specifications.

MIXING:

A. Design mix to produce normal weight concrete consisting of Portland cement, aggregate, water-reducing or high-range water reducing admixture (super-plasticizer), air-entraining admixture and water to produce following properties:

- 1. Compressive Strength: Minimum 3,000 psi for curb and walkways and 4,000 psi for pavement, at 28 days. In addition, concrete for pavement shall have a minimum modulus of rupture of 600 psi.
- 2. Slump Range: 3"-5".
- 3. Air Content: 3% to 6%.

PREPARATION:

A. Surface Preparation:

- 1. Remove loose material from compacted base material surface immediately before placing concrete.
- B. Compact the top 12 inches of subgrade to a minimum soil density of 98% of the Modified Proctor Test (ASTM D1557) to result in a minimum modulus of subgrade reaction (k) of 150 psi/in. Proof-roll prepared base material surface to check for unstable areas. The paving work shall begin after the unsuitable areas have been corrected and are ready to receive paving. Compaction testing for the base material shall be completed prior to the placement of the paving.

CONCRETE INSTALLATION:

A. Form Construction:

- 1. Set forms to required grades and lines, rigidly braced and secured. Install sufficient quantity of forms to allow continuous progress of work and so that forms can remain in place at least 24 hours after concrete placement.
- 2. Check completed formwork for grade and alignment to following tolerances:
 - A. Top of forms not more than 1/8" in 10'-0".
 - B. Vertical face on longitudinal axis, not more than 1/4" in 10'-0".
- 3. Clean forms after each use, and coat with form release agent as often as required to ensure separation from concrete without damage.

B. Reinforcement:

- 1. Locate, place, and support reinforcement to ensure compliance with plans.

C. Concrete Placement:

- 1. Comply with requirements of Sections 345, 350, and 520 of Florida DOT Specifications for mixing and placing concrete.
- 2. Do not place concrete until base material and forms have been checked for line and grade. Moisten base material if required to provide uniform dampened condition at time concrete is placed. Concrete shall not be placed around manholes or other structures until they are at the required finish elevation and alignment.
- 3. Place concrete using methods, which prevent segregation of mix. Consolidate concrete along face of forms and adjacent to transverse joints with internal vibrator. Keep vibrator away from joint assemblies, reinforcement, or side forms. Consolidate with care to prevent dislocation of reinforcing, dowels, and joint devices.
- 4. Deposit and spread concrete in continuous operation between transverse joints, as far as possible. If interrupted for more than 1/2 hour place construction joint.

D. Curbs and Gutters:

- 1. Automatic machine may be used for curb and gutter placement at Contractor's option. Machine placement must produce curbs and gutters to required cross section, lines, grades, finish, and jointing as specified for formed concrete. If results are not acceptable, remove and replace with formed concrete as specified.

Revisions:

16 VIA DE LUNA HOTEL
PENSACOLA BEACH
SPECIFICATIONS (1 OF 2)

Not valid unless bearing Engineer's embossed seal.

MARK C. SENER, P.E.
FL REG. NO. 48831

Job No.: 2017-161-B
Date: 4 MAY 2021
Flid. Vol.: N/A
Scale: N/A
Disk No.: 17161B-MISC
Designed: MCS
Drawn: CRG
Checked: MCS
Sheet

CHOCTAW ENGINEERING, INC.
ENGINEERING • ENVIRONMENTAL • SURVEYING
112 TRUXTON AVENUE
PORT WALTON BEACH, FLORIDA 32547
PHONE: 850-862-6611
FAX: 850-863-8059
EMAIL: ce@choctaweng.com

CHOCTAW ENGINEERING, INC.
ENGINEERING • ENVIRONMENTAL • SURVEYING
112 TRUXTON AVENUE
PORT WALTON BEACH, FLORIDA 32547
PHONE: 850-862-6611
FAX: 850-863-8059
EMAIL: ce@choctaweng.com

THIS SHEET IS THE PROPERTY OF CEI & IS NOT TO BE REPRODUCED WITHOUT WRITTEN CONSENT FROM CEI.

CONTINUED ON NEXT SHEET

CONTINUED ON NEXT COLUMN

JOINT CONSTRUCTION:

- A. Construct expansion, weakened-plane (Contraction), and construction joints true-to-line with face perpendicular to surface of concrete. Construct transverse joints at right angles to centerline, unless otherwise indicated.
1. Weakened-Plane (Contraction) Joints:
- A. Provide weakened-plane (contraction) joints, sectioning concrete into areas at 15'-0" o.c. maximum each way.
 - B. Sidewalks shall have contraction joints at 5'-0" o.c.
 - C. Construct weakened-plane joints for depth equal to at least 1/4 concrete thickness.
2. Tooled Joints:
- A. Form weakened-plane joints in fresh concrete by grooving top portion with recommended cutting tool and finishing edges with jointer.
- B. Construction Joints:
- 1. Plan concrete placement such that construction joints fall at expansion joints as detailed in the plans.
- C. Expansion Joints:
- 1. Provide premolded joint filler for expansion joints abutting concrete curbs, catch basins, manholes, inlets, structures, walks, and other fixed objects.
 - 2. Locate expansion joints at 40'-0" o.c. maximum for each pavement lane or for curb.
 - 3. Locate expansion joints at 50'-0" o.c. maximum for walkways.
- D. Joint Fillers:
- 1. Extend joint fillers full-width and depth of joint, and not less than 1/2" or more than 1" below finished surface where joint sealer is indicated.
 - 2. Furnish joint filler in one-piece lengths for full width being placed, wherever possible. Where more than one length is required, lace or clip joint filler sections together.
- E. Joint Sealants:

- 1. Exterior pavement joint sealants shall be composed of a non-priming, pourable, self-leveling type polyurethane sealant, such as grey shep-calk, or approved equal suitable for use in pavements and sidewalks.

CONCRETE FINISHING:

- A. After striking-off and consolidating concrete, smooth surface by screeding and floating. Adjust floating to compact surface and produce uniform texture.
- B. After floating, test surface for trueness with 10'-0" straightedge (maximum deviation of 1/4 inch). Distribute concrete as required to remove surface irregularities, and refloat repaired areas to provide continuous smooth finish.
- C. Work edges of slabs, gutters, back top edge of curb, and formed joints with an edging tool, and round to 1/2" radius. Eliminate tool marks on concrete surface.
- D. After completion of floating and troweling when excess moisture or surface sheen has disappeared, complete surface finishing as follows:
- 1. Curbs, Gutters, and Walks:
 - A. Broom finish by drawing fine-hair broom across concrete surface perpendicular to line of traffic. Repeat operation if required to provide fine line texture.
 - 2. Inclined Slab Surfaces:
 - A. Provide coarse, nonslip finish by scoring surface with stiff-bristled broom perpendicular to line of traffic.
 - 3. Paving:
 - A. Burlap finish by dragging seamless strip of damp burlap across concrete perpendicular to line of traffic. Repeat operation to produce gritty texture.
- E. Do not remove forms for 24 hours after concrete has been placed. After form removal, clean ends of joints and point up any minor honeycombed areas. Remove and replace areas or section with major defects, as directed.
- F. Protect and cure finished concrete paving in accordance with "Florida Department of Transportation Specifications for Road and Bridge Construction" section 350-13.

CLEANING AND ADJUSTING:

- A. Repair or replace broken or defective concrete as directed.
- B. Protect concrete from damage until acceptance of work. Exclude traffic from pavement for at least 14 days after placement. When construction traffic is permitted, maintain pavement as clean as possible by removing surface stains and spillage of materials.
- C. Sweep concrete pavement and wash free of stains, discolorations, dirt, and other foreign material just prior to final inspection.

SPECIFICATION: FENCING

The Contractor shall install fencing as shown on the plans and in accordance with the manufacturer's brochure. The following are minimum requirements and shall govern except that all local, state and/or federal codes and ordinances shall govern when their requirements are in excess hereof.

MATERIAL CERTIFICATES:

Furnish copies of materials certificates signed by material producer and Contractor, certifying that each material item complies with, or exceeds, specified requirements.

MATERIALS:

All materials and equipment incorporated in the work shall be new, clean, and free of visual defects unless otherwise specified, and that all work will be of good quality, free from faults and defects and in conformance with the Contract Documents. All work not conforming to these requirements may be considered defective.

Height shall be as required as shown on the construction plans.

Fabric shall be #9 gauge, chain link open hearth steel wire, hot-dipped galvanized after weaving with minimum coating of 2.0 ounce of zinc per square foot or aluminum coating with .40 ounces per square foot, woven in 2" diamond mesh.

Line post, top, intermediate and bottom rails, shall be 1 5/8" O.D. steel pipe, weight 2.27 lbs per foot, hot-dipped galvanized. Set 36" deep in concrete.

Terminal, corner, gate and pull posts shall be 3" O.D. pipe, 5.79 lbs. Set 36" deep in concrete.

Concrete for setting posts shall be Portland Cement complying with ASTM C-150, aggregates complying with ASTM C-33, and clean water. Mix materials to obtain concrete with a minimum 28-day compressive strength of 2,500 psi.

Stretcher bar bands, tie wires, hog rings, couplings, nuts, stretcher bars, bolts, and miscellaneous fastening devices shall be manufacturer's standard for heavy construction fence.

Swing gates shall consist of the following components.

2" O.D. steel pipe 2.72 lbs. per foot, hot-dipped galvanized. Each frame to be equipped with 3/8" diameter adjustable truss rods.

Hinges shall be hot-dipped galvanized pressed steel or malleable iron to suit gate size, non-lift-off type. Hinges shall be offset to permit 180 degrees opening. Provide one (1) pair of hinges per lead.

Latch shall be forked type to permit operation from either side with provisions to lock both leaves with padlock.

ACCEPTABLE MANUFACTURERS: Cyclone Fence, Page Fence, and Hackney Corporation.

SPECIFICATION: TRAFFIC STRIPING AND PAINTING

The Contractor shall paint traffic striping as shown on the plans. The following are minimum requirements and shall govern except that all local, state and/or federal codes and ordinances shall govern when their requirements are in excess hereof. All traffic striping and painting shall be in accordance with sections 710 and 971 of the "Florida Department of Transportation Specifications for Road and Bridge Construction" and "Florida Department of Transportation Roadway and Traffic Design Standards.

MATERIAL CERTIFICATES:

Furnish copies of materials certificates signed by material producer and Contractor, certifying that each material item complies with, or exceeds, specified requirements.

TRAFFIC STRIPING AND PAINTING:

Traffic control markings shall be marked on pavement as indicated on drawings.

Paint shall be in sealed containers that plainly show the designated name, formula or specification number, batch number, color, date of manufacture, manufacturer's name, formulation number, and date of expiration, all of which shall be plainly legible at the time of use. The paint shall be homogeneous, easily stirred to smooth consistency, and shall show no hard settlement or other objectionable characteristics during a storage period of six months.

All machines, tools, and equipment used in performance of the work shall be approved and maintained in satisfactory operating condition. Hand-operated push-type machines of a type commonly used for application of paint to pavement surfaces shall be acceptable for marking small street and parking areas. Applicator machines shall be equipped with necessary paint tanks and spraying nozzles, and shall be capable of applying paint uniformly at the coverage specified. Sandblasting equipment shall be provided as required for cleaning surfaces to be painted. Hand-operated spray guns shall be provided for use in areas where push-type machines cannot be used.

New pavement surfaces shall be allowed to cure for a period of not less than thirty days before application of marking materials. All surfaces to be marked shall be thoroughly cleaned before application of the paint. Dust, dirt, and other granular surface deposits shall be removed by sweeping, blowing with methods as required. Rubber deposits, surface laitance, existing paint markings and other coatings adhering to the pavement shall be completely removed with scrapers, wire brushes, sandblasting, approved chemicals, or mechanical abrasion as directed.

Paint shall be applied evenly to the pavement surface to be coated at a rate of 105 plus or minus 5 square feet per gallon. Paint shall be applied as shown on the drawings.

Paint shall be applied to clean, dry surfaces, and unless otherwise approved, only when air and pavement temperatures are above 40 degrees F and less than 95 degrees F. Paint temperature shall be maintained within these limits. Paint shall be applied pneumatically with approved equipment at rate of coverage specified herein. The Contractor shall provide guidelines and templates as necessary to control paint application. Special precautions shall be taken in marking numbers, letters, and symbols. All edges of marking shall be sharply outlined. The smoothness and uniformity of the paint specifications shall be strictly enforced, to prevent undue softening bitumen, and pickup, displacement, or discoloration by tires of traffic. If there is a deficiency in drying of the markings, painting operations shall be discontinued until cause of the slow drying is determined and corrected.

Suitable warning signs shall be placed near the beginning of the worksite and well ahead of the worksite for alerting approaching traffic from both directions. Small markers shall be placed along newly painted lines to control traffic and prevent damage to newly painted surfaces. Painting equipment shall be marked with large warning signs indicating that slow moving painting equipment is in operation.

Markings which must be visible at night shall be reflectorized unless ambient illumination assures adequate visibility.

SPECIFICATION: WATER DISTRIBUTION SYSTEM

The Contractor shall provide and install all materials for a potable water distribution system as shown on the drawings and in this specification. In addition, he shall obtain all permits and conduct all tests required by local, state and federal authorities and as specified on these drawings.

MATERIALS:

All materials and equipment incorporated in the Work shall be new, clean, and free of visual defects unless otherwise specified, and that all work will be of good quality, free from faults and defects and in conformance with the Contract Documents. All work not conforming to these requirements may be considered defective.

Piping:

- Less than 4" inches in diameter:
 - Polyvinyl Chloride (PVC) 160 psi, SDR 26
 - Polyethylene pipe 160 psi, SDR 9
 - Polyethylene tubing 200 psi, SDR 9
- Greater than 4" inches in diameter:
 - Polyvinyl Chloride (PVC) 150 psi
 - Ductile Iron (Class 50)

Joints:

- Joints for PVC pipes:
 - Joints shall comply with ASTM D-3139
 - No solvent cements or toxic lubricant will be allowed.
 - Expansion capability will be provided.
- Joints for Ductile Iron pipes:
 - Joints shall comply with AWWA C-153 or AWWA C-110 Valve box shall be CLOW F-2452 screw type & lids shall be marked "water" as required.

Gate Valves:

- Valves shall comply with AWWA C-509
- 200 psi iron body, bronze mounting, Non-rising stems with square operating nuts and a suitable valve box as manufactured by M & H, model 4067 NRS for valves > 2". Gate valves under 2" shall be bronze body, threaded ends, NRS solid wedge disc & shall be American model 3FG.

INSTALLATION:

Shall comply with all local, state and federal regulations. The Contractor shall provide proper facilities for handling and laying pipe and accessories. No pipe will be laid in unsuitable weather or in water. The Contractor will verify all field dimensions with the design Engineer (including Field Stake-Out) prior to commencing work. The contractor shall notify the Engineer at least 24 hours prior to installing any portion of the water main distribution system. He shall also stake all service connections and provide as-built dimensions to the Engineer. Connections to the existing system shall be coordinated with the utility company. Minimal service interruption shall occur and traffic safeguards shall be taken. Provide 30' minimum cover.

The Contractor shall conduct hydrostatic pressure and leakage tests as follows:

- Apply 150 psi or 150% of the working pressure whichever is greater, to the test line. Duration of the pressure test shall be at least two (2) hours. After 1/2 hour, check pressure, if pressure has dropped, inspect for leaks and correct as required. Repeat tests until there are no leaks or pressure loss. Pressure must hold for two hours.

NOTE: The contractor shall notify the utility company and the Engineer at least 48 hours prior to conducting pressure and leakage tests. A 3/4" hose bibb connection will be required for guage connection.

After satisfactory hydrostatic test contractor shall disinfect water system in accordance with AWWA specification C-601 which provides for contact with a 50 ppm solution of chlorine remaining for twenty-four hours, with the chlorine residual of at least 10 ppm. All valves or other appurtenances shall be operated while the pipe line is filled with the chlorinating agent. All treated water shall be thoroughly flushed from the pipes until the replacement water is approved, both chemically and bacteriologically, by the Florida Department of Environmental Protection. The chlorination procedure shall be repeated until tests show that the water sampled conforms to the requirements stated above. Samples shall be taken by and tested at the expense of the contractor.

NOTES:

- All water piping and fittings used shall be National Sanitation Foundation (N.S.F.) approved for potable water.

A minimum separation of 10 ft. horizontal, outside to outside and 18 inches vertical is required between all water lines and the sanitary sewer system.

When trench excavation depth exceeds five feet, the Contractor shall provide trench protection (shields, sloping, shoring, etc.) and shall comply with OSHA Standard 29 CFR, Section 1926.650 Subpart P.

In accordance with rules of the Florida Department of Environmental Protection (DEP), Chapter 62-555, the Engineer of record will be responsible for observation of construction of the Potable Water System. The Engineer SHALL be notified at commencement and completion of construction. To assure compliance with plans and specifications, said Engineer will report to DEP upon completion of construction and cleaning and disinfecting described above before the system can be placed in service.

All PVC potable water lines and services will be marked with No. 14 copper insulated tracer wire to enable location with a Ferrous Metal Detector. The tracer wire will be placed 12 inches above and throughout the length of all such pipe.

CONCRETE ENCASEMENT AND SPECIALS

Provide concrete pipe encasements or special pipe supports as shown on the drawings or directed by the Engineer. Various pipe supports shall be as worked out in the field to suit local conditions and emergencies. Where, in the opinion of Engineer that pipe covering is inadequate, concrete encasement for protection shall be provided in accordance with the details on the approved drawings. Concrete encasements shall be made using concrete with a 28-day strength of 2000 psi and on the construction plans and as required by the applicable Department of Transportation or Public Health regulations. All other concrete needed to build and protect the pipe work shall be used at the direction of the Engineer.

FIRE HYDRANTS:

All fire hydrants shall be 6 inch, three way hydrants with two 2-1/2 inch hose nozzles and one 4-1/2 inch pumper nozzle, designed for 150 lbs working pressure or 300 lbs hydrostatic pressure and shall conform to the latest specifications of the AWWA. All working parts shall be bronze. All hose threads shall be National Standard Threads. Hydrants shall have a mechanical joint and inlet. Hydrants shall be Traffic Breakaway Model. The hydrant main valve shall be a compression type that closes with the water pressure. Hydrants shall have not less than a 5-1/4 inch valve opening. All hydrants shall be equipped with automatic self-allowing reservoirs that lubricate the stem threads and all bearing surfaces each time the hydrant is operated. Hydrants shall be painted one coat of red iron oxide zinc oxide primer conforming to Steel Structures Painting Council SSPC-paint 25 and two finish coats of silicone alkyl paint conforming to Steel Structures Painting Council SSPC-paint 21. Fire hydrants shall be painted in accordance with NFPA 291, Recommended Practice For Fire Flow Testing and Marking of Hydrants.

SPECIFICATION: SANITARY SEWER SYSTEM

The Contractor shall provide and install all gravity sewer material shown on the drawings and in this specification. In addition, he shall obtain all permits and conduct all tests required by local, state and federal authorities and as specified on these drawings.

MATERIALS:

All materials and equipment incorporated in the Work shall be new, clean, and free of visual defects unless otherwise specified, and that all Work will be of good quality, free from faults and defects and in conformance with the Contract Documents. All Work not conforming to these requirements may be considered defective.

Piping:

- PVC Gravity Sewer
- Ductile Iron Pipe (D.I.P.)
- PVC Force Mains (160 psi)

ASTM D-3034, SDR-35

ANSI A21.51

ASTM D-1784 and D 2241

Joints:

- PVC, Rubber Ring
- D.I.P. Joints, Rubber Gasket

ASTM D-1869

ANSI A21.11

NOTE: ALL JOINTS TO BE BELL AND SPIGOT TYPE.

Concrete: Poured or Pre-cast

4000 psi at 28 days;

INSTALLATION:

Shall comply with all local, state and federal regulations. The Contractor shall provide proper facilities for handling and laying pipe and accessories. Trenches shall be properly prepared; pipe shall be supported over its full length and bell holes hand dug as required. No pipe will be laid in unsuitable weather or in water. The Contractor will verify all field dimensions and report all discrepancies (including field stake-out) prior to commencing work. The contractor shall notify the Engineer at least 24 hours prior to installing any portion of the sanitary sewer system. He shall also stake all service connections and provide as-built dimensions to the Engineer. Manholes, cleanouts and the like shall be located, built and sized as shown on the drawings. Connections with existing sewer systems shall be coordinated by the Contractor with the utility company.

A minimum separation of 10 ft. horizontal measured outside to outside and 18 inches vertical is required between sanitary sewer lines and all water lines.

When trench excavation depth exceeds five feet, the Contractor shall provide trench protection (shields, sloping, shoring, etc.) and shall comply with OSHA Standard 29 CFR, Section 1926.650 Subpart P.

In accordance with rules of the Florida Department of Environmental Protection (DEP), Chapter 62-604, the Engineer of record will be responsible for observation of construction of the Sanitary Sewer System. The Engineer SHALL be notified at commencement and completion of construction. To assure compliance with plans and specifications, said Engineer will report to DEP upon completion of construction before the system can be placed in service.

The Contractor shall coordinate all tests with the utility company and the Engineer. All lines, fittings and manholes shall be cleaned before conducting tests. Any subsequent corrections shall be at the expense of the Contractor. Provide 30' minimum cover.

GRAVITY SEWERS:

Leakage tests by exfiltration and/or infiltration will be made on all pipe. The Engineer shall have the option determining which test shall be employed. Generally, if the groundwater table is below the bottom of the pipe, an exfiltration test shall be used. Duration of test shall be not less than two (2) hours. Visible leaks encountered shall be corrected regardless of leakage test results. Leakage as measured by either the infiltration or exfiltration test shall not exceed 0.157 gallons per inch diameter per 100 feet of pipe per hour. When leakage exceeds the maximum amount specified, satisfactory correction shall be made and retesting accomplished.

Deflection testing shall be done on all flexible pipe at the direction of the Engineer. Testing shall be done using a mandrel having a diameter equal to 95 percent of the inside diameter of the pipe. When a deflection device is used in lieu of the mandrel, such device shall be approved by the Engineer prior to use. No pipe deflection shall exceed 5 percent.

FORCE MAINS:

The Contractor shall conduct hydrostatic pressure and leakage tests as follows:

- Apply 100 psi or 150% of the working pressure, whichever is greater, to the test line. Duration of the pressure test shall be at least two (2) hours. After 1/2 hour, check pressure, if pressure has dropped, inspect for leaks and correct as required. Repeat tests until there are no leaks or pressure loss. Pressure must hold for two hours.

NOTE: The contractor shall notify the utility company and the Engineer at least 24 hours prior to conducting pressure and leakage tests.

Force mains shall have thrust blocks designed for 100 PSI test pressure. Force Mains shall be colored other than white to distinguish from water lines. Force Mains in the right-of-way shall have 30 inches (minimum) cover over the crown.

All sanitary sewer force mains will be marked with No. 14 copper insulated tracer wire to enable location with a Ferrous Metal Detector. The tracer wire will be placed 12 inches above and throughout the length of all such pipe.

MANHOLES:

Shape: All manholes will be eccentric or as specified on the drawings.

Setting Manhole Castings: The frame of the casting shall be set in a full mortar bed composed of one part Portland Cement to two parts of fine aggregate.

Concrete: The minimum compressive strength required at twenty-eight days is 4,000 pounds per square inch. The minimum amount of water shall be used to produce a workable mix and shall not exceed six (6) U.S. Gallons per sack of cement. Concrete shall conform to ASTM Specification ASTM C-94.

Pre-cast Reinforced Concrete Manhole Sections: Pre-cast reinforced concrete manhole sections shall conform to ASTM Specification C-478. All joints for pre-cast sections shall be approved by the Engineer.

Castings: Cast iron frames and covers shall conform to the drawings in all essentials of design. All castings shall be made of clean, even grain, tough gray cast iron. The quality of iron in the castings shall conform to the current ASTM Specification A-48 for Class 20 Gray Iron Castings. The weight of castings shall be as shown in the plans. Castings shall be smooth, true to pattern, and free from projections, sand holes, or defects. A raised word "SEWER" shall be cast on the upper non-skid surface of all manhole covers. The portion of the frame and cover which forms the cover seat shall be machined so that no rocking of the cover is possible. The castings shall be coated with cool tar pitch varnish. On roadways the frame and cover shall be set flush with and in the plane of the surface. In other locations they shall be set to grades determined by the Engineer. A shop drawing of the manhole frame and cover must be approved by the Engineer for all covers and frames furnished on the project.

Water-Proofing: Both concrete and pre-cast sections below grade shall be painted on the outside with either two coats of bituminous paint or a heavy layer of emulsified asphalt to water-proof completely. Manholes shall be inspected for water tightness prior to being placed in service. All incoming and outgoing sewer lines shall be plugged and the manhole filled with water to a level to create a minimum positive head of two feet or above the highest section joint. If the water level drop exceeds 1/8" per vertical foot of manhole depth in 5 minutes, the manhole shall have failed the test.

GENERAL:

Grout all riser joints and entry pipes.

Invert neat cement seals for pre-cast units.

Minimum radius allowed is 20 inches.

Invert grouting shall be uniform and smooth-sloped to center line of pipe.

NOTE: Roof drains, foundation drains and all other clean water connections to the sanitary sewer system are prohibited.

THRUST BLOCKS

Suitable concrete reaction or thrust blocks shall be applied on all lines (except those having screwed or flanged joints), at all manholes, caps, and bends deflecting 22-1/2 degrees or more, or movements shall be prevented by attaching metal rods to straps approved by the Engineer. Unless otherwise directed, the pipe shall be laid with bell ends facing in the direction of laying. Whenever it is necessary to deflect the pipe from a straight line, either in the vertical or horizontal plane, to avoid obstruction, to plumb stems, or where long radius curves are permitted, the degree of deflection shall be as recommended by the manufacturer of the pipe.

SPECIFICATION: STORM SEWER SYSTEM

The Contractor shall provide and install all storm sewer material shown on the drawings and in this specification. In addition, he shall obtain all permits and conduct all tests required by local, state and federal authorities and as specified on these drawings.

MATERIALS:

All materials and equipment incorporated in the Work shall be new, clean, and free of visual defects unless otherwise specified, and that all Work will be of good quality, free from faults and defects and in conformance with the Contract Documents. All Work not conforming to these requirements may be considered defective.

Corrugated Polyethylene Pipe:

- Shall comply with section 948 of the latest edition "Florida Department of Transportation Specifications for Road and Bridge Construction" unless modified herein. Pipes 12 inches to 24 inches in diameter shall comply with ASTM F-405 and ASTM F-667. Joints shall be by means of dimpled band. If used outside of dry wells, joints shall be wrapped in filtercloth 2 feet in width and with 2 feet of overlap on the diameter. This pipe, in the perforated form, shall be used inside dry wells only when used with a filter sock. Perforations shall be 1/4 inch diameter and spaced 10 inches on center in the valley of the corrugations.

Polyvinyl-Chloride Pipe:

- Shall comply with section 948 of the latest edition "Florida Department of Transportation Specifications for Road and Bridge Construction" unless modified herein. Polyvinyl-Chloride Pipe shall meet the requirements of ASTM D 3034, SDR-35, or ASTM F 949, profile wall without perforations. Polyvinyl-Chloride Pipe for use as underdrain shall conform to the requirements of ASTM F 758 or ASTM F 949. Also, PVC underdrain manufactured from PVC pipe meeting ASTM D 3033 or ASTM D 3034, perforated in accordance with the perforation requirements given in AASHTO M 36, or AASHTO M 196 will be permitted.

Reinforced Concrete Pipe:

- Shall comply with requirements of ASTM C 76, Class III, unless otherwise indicated on the Drawings, and shall be installed with rubber gasketed joints complying with ASTM C 443. Install rubber gaskets in strict accordance with pipe manufacturer's recommendations.

Manholes:

- Precast reinforced concrete manhole sections shall conform to ASTM Specification C-478. Construct manholes of precast concrete sections as required by Drawings to size, shape, and depth indicated, but never less than 4'-0" inside diameter. All joints for precast sections shall be approved by the engineer.

Inlets/Catch Basins:

- Precast reinforced concrete inlets/Catch Basins sections shall conform to ASTM Specification C-478. Construct inlets/Catch Basins of precast concrete construction as required by Drawings to size, shape, and depth indicated.

Main and Lateral Pipes:

- Neatly cut off main and lateral pipes flush with inside of manhole or inlet where they enter structure walls. Dress all irregularities and rough edges with non-shrinking grout (inside and outside).

Where pipes enter or exit manholes, a "Kor-N-Seal" molded neoprene boot with stainless steel internal and external bands as manufactured by the National Pollution Control Systems, Inc., Nashua, New Hampshire, or a polyurethane joint with a short transition joint as manufactured by Moorform Corporation, Centralia, Illinois, or an approved equal (or superior) connection shall be provided.

Cast Iron Frames, covers, and Gates:

- After completion of manhole inlet, set cast iron frame in full mortar bed after adjusting to required elevation. Cast iron frames and covers shall conform to the drawings in all essentials of design. All castings shall be made of clean, even grain, tough gray cast iron. The quality of iron in the castings shall conform to the current ASTM Specification A-48 for Class 20 Gray Iron Castings. The weight of castings shall be as shown in the plans. Castings shall be smooth, true to pattern, and free from projections, sand holes, or defects. A raised word "STORM SEWER" shall be cast on the upper non-skid surface of all manhole covers. The portion of the frame and cover which forms the cover seat shall be machined so that no rocking of the cover is possible. The castings shall be coated with cool tar pitch varnish. On roadways the frame and cover shall be set flush with and in the plane of the surface. In other locations they shall be set to grades determined by the engineer. The frame and cover shall be heavy duty traffic bearing.

Plastic Filter Fabric:

- Plastic Filter Fabric shall be the non-woven type and shall comply with sections 514 and 955 of the latest edition "Florida Department of Transportation Specifications for Road and Bridge Construction" unless modified herein.

Concrete:

- Concrete shall comply with sections 345 of the latest edition "Florida Department of Transportation Specifications for Road and Bridge Construction" unless modified herein.. Minimum compressive strength at 28 days shall be 4,000 psi.

DETENTION AREAS AND GRASSED SWALES:

- Swales must be landscaped with seeding, sodding, or sprigging, which does not inhibit the infiltration rate of the soil. Engineer requires 48 hours notice prior to landscaping of infiltration areas to make appropriate inspections.

The system will require periodic maintenance for continued proper operation. This will include, as a minimum: A) removal of silt debris from surface infiltration areas and catch basins, and B) maintenance of vegetative cover in surface infiltration areas.

STORMWATER DRYWELLS:

- Drywells shall be constructed to the dimensions as detailed in the plans. The washed granular material shall have of a void ratio of not less than 0.4 and the gradation shall conform to section 901 of the latest edition "Florida Department of Transportation Specifications for Road and Bridge Construction". The dry well shall be completely wrapped in woven (as opposed to spun) filter cloth with a minimum 2 feet of overlap at field joints. The dry well shall contain a perforated pipes as detailed in the plans.

INSTALLATION:

The Contractor shall comply with all local, state and federal regulations. The Contractor shall provide proper facilities for handling and laying pipe and accessories. Trenches shall be properly prepared; pipe shall be supported over its full length and bell holes hand dug as required. No pipe will be laid in unsuitable weather or in water. The Contractor will verify all field dimensions and report all discrepancies (including field stake-out) prior to commencing work. The contractor shall notify the Engineer at least 24 hours prior to installing any portion of the storm sewer system. He shall also stake all service connections and provide as-built dimensions to the Engineer. Manholes, cleanouts and the like shall be located, built and sized as shown on these drawings. Connections with existing storm sewer systems shall be coordinated by the Contractor with the Utility Authority. Adequate traffic control shall be provided.

A minimum separation of 10 ft. horizontal measured outside to outside and 18 inches vertical is required between storm sewer lines and all water lines.

When trench excavation depth exceeds five feet, the Contractor shall provide trench protection (shields, sloping, shoring, etc.) and shall comply with OSHA Standard 29 CFR, Section 1926.650 Subpart P.

In accordance with rules of the Florida Department of Environmental Protection (DEP), Chapter 62-25, the Engineer of record will be responsible for observation of construction of the Storm Sewer System. The Engineer SHALL be notified at commencement and completion of construction. To assure compliance with plans and specifications, said Engineer will report to DEP upon completion of construction before the system can be placed in service.

TESTS:

The Contractor shall coordinate all Tests and Inspections with the Utility Authority and the Engineer. All lines, fittings and manholes shall be clean and dry before the Inspector is summoned. Tests and subsequent corrections shall be at the expense of the Contractor.

Non-Perforated Storm Sewers:

- Leakage tests by exfiltration and/or infiltration will be made on all pipe as deemed by the Engineer. The Engineer shall have the option determining which test shall be employed. Generally, if the groundwater table is below the bottom of the pipe, an exfiltration test shall be used. Duration of test shall be not less than two (2) hours. Visible leaks encountered shall be corrected regardless of leakage test results. Leakage as measured by either the infiltration or exfiltration test shall not exceed 0.2 gallons per inch diameter per 100 feet of pipe per hour. When leakage exceeds the maximum amount specified, satisfactory correction shall be made and retesting accomplished.

Deflection testing shall be done on all flexible pipe at the direction of the Engineer. Testing shall be done using a mandrel having a diameter equal to 95 percent of the inside diameter of the pipe. When a deflection device is used in lieu of the mandrel, such device shall be approved by the Engineer prior to use. No pipe deflection shall exceed 5 percent.

EROSION PROTECTION:

New and existing drainage structures shall be protected from soil erosion sedimentation by placing baled hay around structures.

Staked baled hay and silt fence barriers shall be installed downhill from any earthwork activity, and in all areas subject to soil erosion, prior to start of construction.

Soil erosion sedimentation shall be controlled during all phases of construction.

ALL SOIL EROSION SEDIMENTATION SHALL BE RETAINED ON SITE.

16 VIA DE LUNA HOTEL
PENSACOLA BEACH
SPECIFICATIONS (2 OF 2)

Not valid unless bearing Engineer's embossed seal.

MARK C. SNIER, P.E.
FL REG. NO. 48831

Revisions:

16 VIA DE LUNA HOTEL
PENSACOLA BEACH
SPECIFICATIONS (2 OF 2)

Not valid unless bearing Engineer's embossed seal.

MARK C. SNIER, P.E.
FL REG. NO. 48831

Job No.: 2017-161-B

Date: 4 MAY 2021

Flt. Vol.: N/A

Scale: N/A

Disk No.: 17161B-MISC

Designed: MCS

Drawn: CRG

Checked: MCS

Sheet

12 of 12

CHOCTAW ENGINEERING, INC.

ENGINEERING • ENVIRONMENTAL • SURVEYING

PHONE: 850-862-6611

PAX: 850-863-8059

EMAIL: ce@choctaweng.com

112 TRUXTON AVENUE

PORT WALTON BEACH, FLORIDA 32547

CERTIFICATE OF AUTHORIZATION NO. 1532

THIS SHEET IS THE PROPERTY OF CEI & IS NOT TO BE REPRODUCED WITHOUT WRITTEN CONSENT FROM CEI.